

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760988

Luminaire Tested: LD6D15D010-EU6DR1515309035-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760988
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR1515309035-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1352.5 lumens
Efficiency: N/A
Efficacy: 85.6 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760988

CATALOG NUMBER: LD6D15D010-EU6DR1515309035-6LBSQW1MW

Luminous Intensity Polar Plot

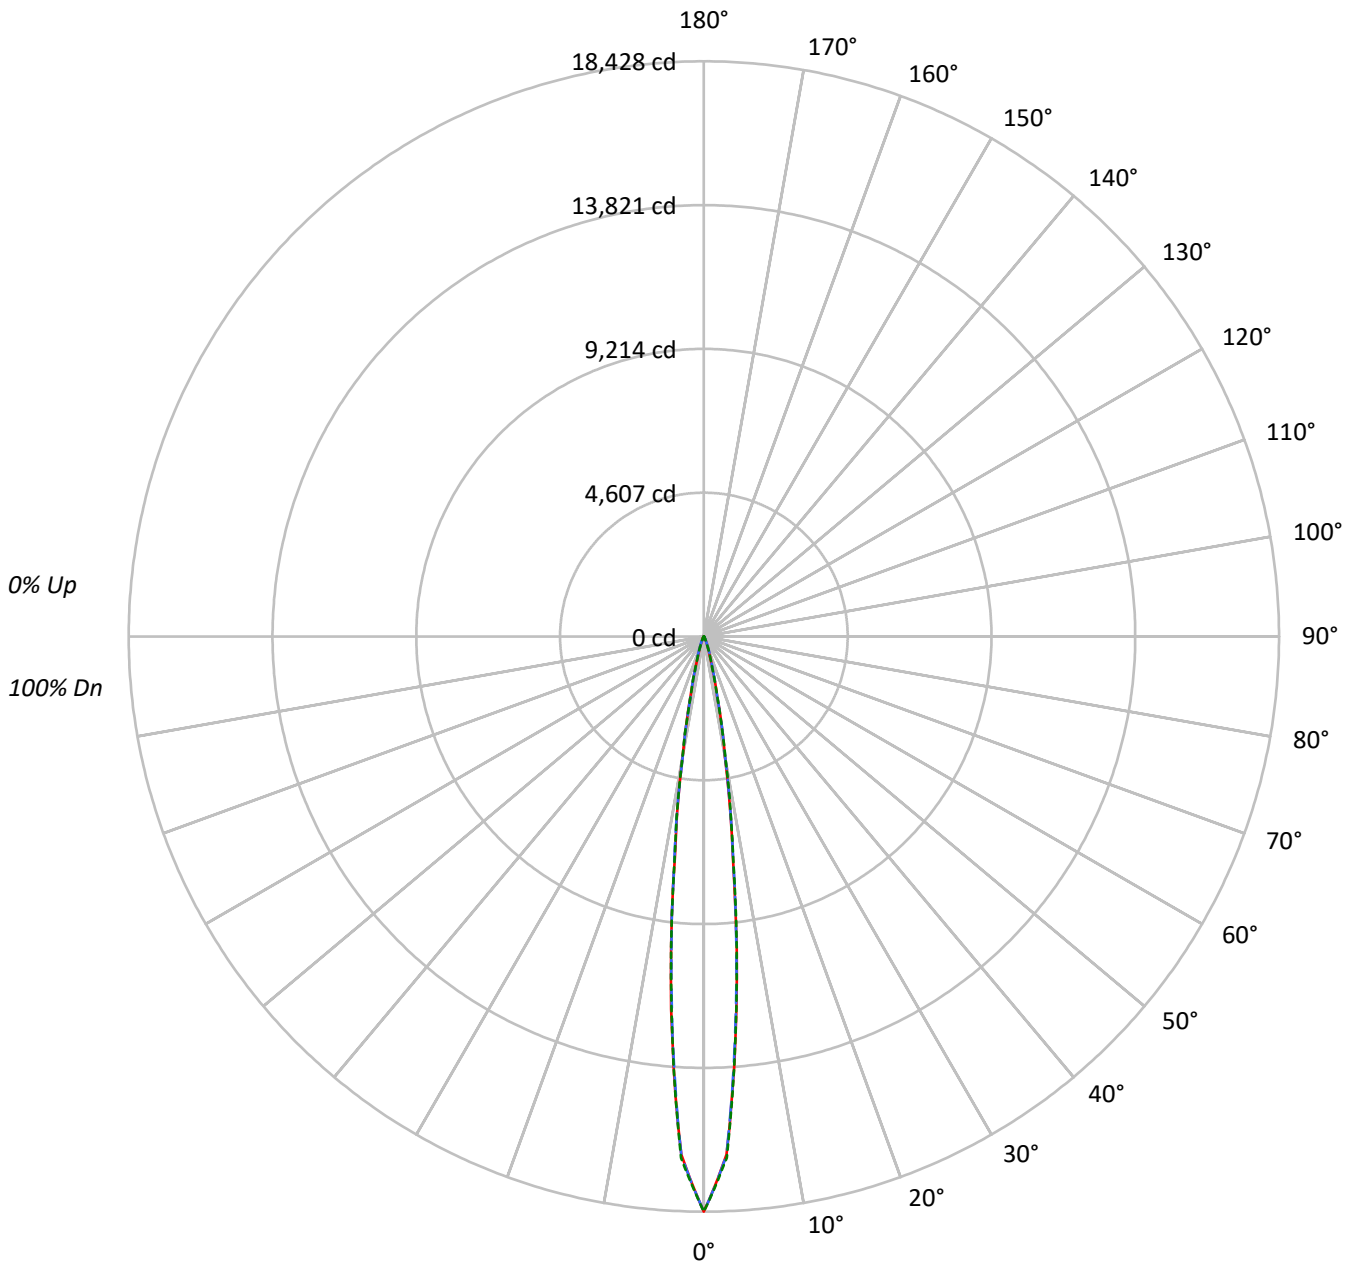



TEST NUMBER: P760988

CATALOG NUMBER: LD6D15D010-EU6DR1515309035-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2073461	2073461	2073461
5°	1218459	1202687	1212199
10°	363657	366204	371803
15°	90453	92216	89376
20°	27067	31338	27640
25°	9543	12153	9660
30°	3504	4613	3564
35°	1757	1983	1699
40°	1108	1221	1108
45°	819	875	819
50°	654	654	654
55°	543	543	543
60°	435	435	435
65°	335	335	335
70°	285	285	285
75°	174	174	234
80°	126	126	126
85°	66	66	66

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 875 cd/sqm



TEST NUMBER: P760988

CATALOG NUMBER: LD6D15D010-EU6DR1515309035-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	877.2	64.9
10°-20°	360.8	26.7
20°-30°	71.7	5.3
30°-40°	17.9	1.3
40°-50°	9.4	0.7
50°-60°	7.0	0.5
60°-70°	4.9	0.4
70°-80°	2.8	0.2
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1309.7	96.8
0°-40°	1327.6	98.2
0°-60°	1343.9	99.4
0°-90°	1352.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1352.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	18428	18428	18428	18428	18428	
5°	11989	11866	11834	11916	11928	876
15°	1041	1061	1062	1043	1029	357
25°	122	139	156	138	124	64
35°	24	26	27	26	23	16
45°	12	12	12	12	12	9
55°	8	8	8	8	8	7
65°	5	5	5	5	5	5
75°	2	2	2	2	3	3
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P760988

CATALOG NUMBER: LD6D15D010-EU6DR1515309035-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	18427.5	18427.5	18427.5	18427.5	18427.5
2.5°	16622.4	16636.4	16641.9	16658.2	16719.1
5°	11989.3	11866.1	11834.1	11916.0	11927.7
7.5°	7102.0	7127.0	7218.3	7238.5	7165.2
10°	3897.4	3929.4	3924.7	3952.8	3984.7
12.5°	1993.2	1968.2	1960.4	1992.4	1947.9
15°	1041.4	1060.9	1061.7	1043.0	1029.0
17.5°	560.1	582.7	620.2	589.8	542.9
20°	330.8	351.0	383.0	358.1	337.8
22.5°	204.4	220.8	243.4	223.9	207.5
25°	122.5	138.9	156.0	138.1	124.0
27.5°	72.5	86.6	97.5	85.8	71.8
30°	46.8	54.6	61.6	53.8	47.6
32.5°	32.8	35.9	39.0	35.9	32.8
35°	24.2	25.7	27.3	25.7	23.4
37.5°	18.7	20.3	21.1	19.5	17.9
40°	15.6	16.4	17.2	16.4	15.6
42.5°	13.3	14.0	14.0	14.0	13.3
45°	11.7	11.7	12.5	11.7	11.7
47.5°	10.1	10.1	10.9	10.1	10.1
50°	9.4	9.4	9.4	9.4	9.4
52.5°	8.6	8.6	8.6	8.6	8.6
55°	7.8	7.8	7.8	7.8	7.8
57.5°	7.0	7.0	7.0	7.0	7.0
60°	6.2	6.2	6.2	6.2	6.2
62.5°	5.5	5.5	5.5	5.5	5.5
65°	4.7	4.7	4.7	4.7	4.7
67.5°	4.7	4.7	4.7	4.7	4.7
70°	3.9	3.9	3.9	3.9	3.9
72.5°	3.1	3.1	3.1	3.1	3.1
75°	2.3	2.3	2.3	2.3	3.1
77.5°	2.3	2.3	2.3	2.3	2.3
80°	1.6	1.6	1.6	1.6	1.6
82.5°	1.6	1.6	1.6	1.6	1.6
85°	0.8	0.8	0.8	0.8	0.8
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)