

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761002

Luminaire Tested: LD6D15D010-EU6DR1515309050-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761002
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR1515309050-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1384.7 lumens
Efficiency: N/A
Efficacy: 87.6 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761002
CATALOG NUMBER: LD6D15D010-EU6DR1515309050-6LBCSSQMB

Luminous Intensity Polar Plot

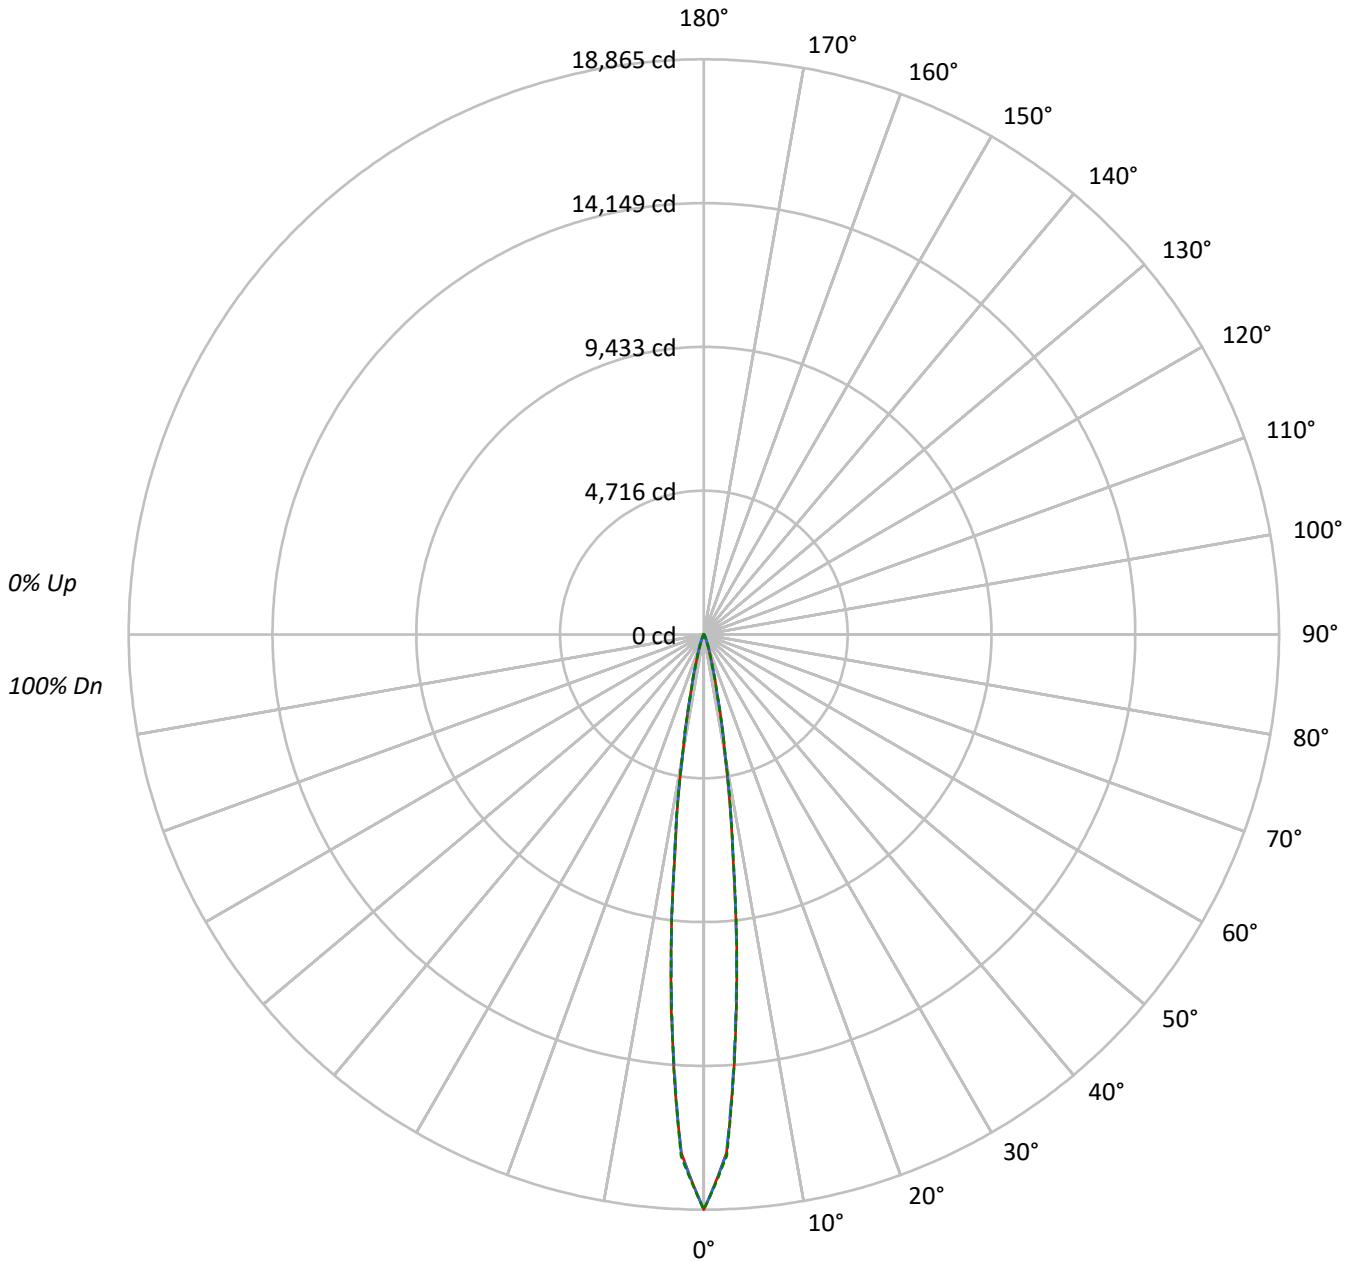



TEST NUMBER: P761002

CATALOG NUMBER: LD6D15D010-EU6DR1515309050-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2122666	2122666	2122666
5°	1247383	1231224	1240970
10°	372288	374891	380630
15°	92598	94405	91495
20°	27705	32083	28294
25°	9769	12441	9893
30°	3587	4725	3647
35°	1801	2033	1743
40°	1136	1250	1136
45°	840	896	840
50°	668	668	668
55°	557	557	557
60°	449	449	449
65°	343	343	343
70°	293	293	293
75°	181	181	242
80°	126	126	126
85°	66	66	66

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 896 cd/sqm



TEST NUMBER: P761002

CATALOG NUMBER: LD6D15D010-EU6DR1515309050-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	898.0	64.9
10°-20°	369.4	26.7
20°-30°	73.4	5.3
30°-40°	18.3	1.3
40°-50°	9.6	0.7
50°-60°	7.1	0.5
60°-70°	5.0	0.4
70°-80°	2.9	0.2
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1340.7	96.8
0°-40°	1359.1	98.2
0°-60°	1375.9	99.4
0°-90°	1384.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1384.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	18865	18865	18865	18865	18865	
5°	12274	12148	12115	12199	12211	896
15°	1066	1086	1087	1068	1053	366
25°	125	142	160	141	127	66
35°	25	26	28	26	24	17
45°	12	12	13	12	12	9
55°	8	8	8	8	8	7
65°	5	5	5	5	5	5
75°	2	2	2	2	3	3
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P761002

CATALOG NUMBER: LD6D15D010-EU6DR1515309050-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	18864.8	18864.8	18864.8	18864.8	18864.8
2.5°	17016.8	17031.2	17036.8	17053.6	17115.8
5°	12273.9	12147.7	12114.9	12198.8	12210.8
7.5°	7270.6	7296.1	7389.6	7410.3	7335.2
10°	3989.9	4022.6	4017.8	4046.6	4079.3
12.5°	2040.5	2014.9	2006.9	2039.7	1994.1
15°	1066.1	1086.1	1086.9	1067.7	1053.4
17.5°	573.4	596.6	634.9	603.8	555.8
20°	338.6	359.4	392.1	366.6	345.8
22.5°	209.2	226.0	249.2	229.2	212.4
25°	125.4	142.2	159.7	141.4	127.0
27.5°	74.3	88.6	99.8	87.8	73.5
30°	47.9	55.9	63.1	55.1	48.7
32.5°	33.5	36.7	39.9	36.7	33.5
35°	24.8	26.4	28.0	26.4	24.0
37.5°	19.2	20.8	21.6	20.0	18.4
40°	16.0	16.8	17.6	16.8	16.0
42.5°	13.6	14.4	14.4	14.4	13.6
45°	12.0	12.0	12.8	12.0	12.0
47.5°	10.4	10.4	11.2	10.4	10.4
50°	9.6	9.6	9.6	9.6	9.6
52.5°	8.8	8.8	8.8	8.8	8.8
55°	8.0	8.0	8.0	8.0	8.0
57.5°	7.2	7.2	7.2	7.2	7.2
60°	6.4	6.4	6.4	6.4	6.4
62.5°	5.6	5.6	5.6	5.6	5.6
65°	4.8	4.8	4.8	4.8	4.8
67.5°	4.8	4.8	4.8	4.8	4.8
70°	4.0	4.0	4.0	4.0	4.0
72.5°	3.2	3.2	3.2	3.2	3.2
75°	2.4	2.4	2.4	2.4	3.2
77.5°	2.4	2.4	2.4	2.4	2.4
80°	1.6	1.6	1.6	1.6	1.6
82.5°	1.6	1.6	1.6	1.6	1.6
85°	0.8	0.8	0.8	0.8	0.8
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)