

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761165

Luminaire Tested: LD6D15D010-EU6DR250215IC9050-6LBSQW1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P761165  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D15D010-EU6DR250215IC9050-6LBSQW1B  
Description: 6 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 25° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1011.1 lumens  
Efficiency: N/A  
Efficacy: 64.0 lumens/watt  
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P761165  
CATALOG NUMBER: LD6D15D010-EU6DR250215IC9050-6LBSQW1B

### Luminous Intensity Polar Plot

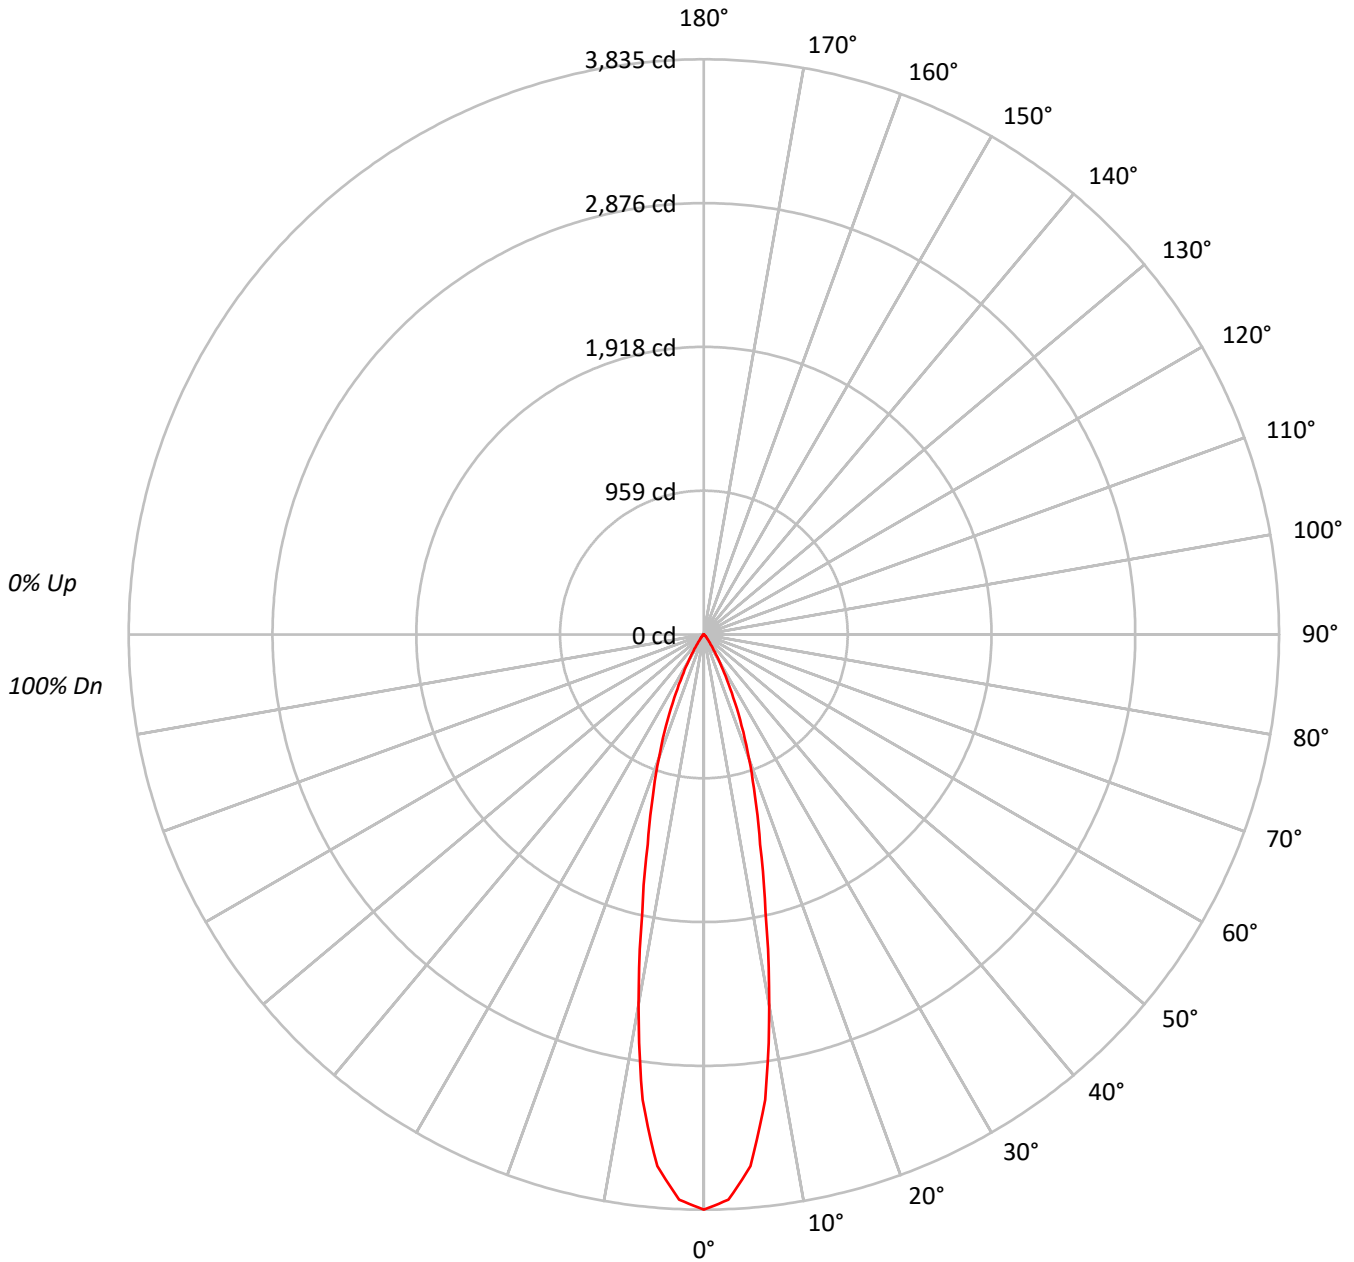



TEST NUMBER: P761165

CATALOG NUMBER: LD6D15D010-EU6DR250215IC9050-6LBSQW1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF  | 20  |     |     |     |     |     |     |     |     | 20  |     |     |     |     |     |     |     |     | 20 |    |   |  |  |  |  |  |  | 20 |  |  |  |  |  |  |  |  |   |
| RC  | 80  |     |     |     |     |     |     |     |     | 50  |     |     |     |     |     |     |     |     | 30 |    |   |  |  |  |  |  |  | 10 |  |  |  |  |  |  |  |  | 0 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0 |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 1   | 115 | 113 | 111 | 109 | 112 | 110 | 109 | 107 | 106 | 105 | 104 | 103 | 102 | 101 | 99  | 99  | 98  | 96  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 2   | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 100 | 102 | 100 | 98  | 99  | 97  | 96  | 97  | 95  | 94  | 92  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 3   | 107 | 102 | 98  | 95  | 105 | 101 | 97  | 94  | 98  | 95  | 93  | 96  | 93  | 91  | 94  | 92  | 90  | 89  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 4   | 103 | 97  | 93  | 90  | 102 | 96  | 93  | 90  | 94  | 91  | 89  | 93  | 90  | 88  | 91  | 89  | 87  | 85  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 5   | 100 | 93  | 89  | 86  | 98  | 93  | 89  | 86  | 91  | 87  | 85  | 89  | 86  | 84  | 88  | 85  | 83  | 82  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 6   | 97  | 90  | 85  | 82  | 95  | 89  | 85  | 82  | 88  | 84  | 81  | 87  | 83  | 81  | 85  | 83  | 80  | 79  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 7   | 93  | 87  | 82  | 79  | 92  | 86  | 82  | 79  | 85  | 81  | 78  | 84  | 80  | 78  | 83  | 80  | 78  | 77  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 8   | 91  | 84  | 79  | 76  | 90  | 83  | 79  | 76  | 82  | 78  | 76  | 81  | 78  | 75  | 80  | 77  | 75  | 74  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 9   | 88  | 81  | 76  | 73  | 87  | 80  | 76  | 73  | 80  | 76  | 73  | 79  | 75  | 73  | 78  | 75  | 73  | 72  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 10  | 85  | 78  | 74  | 71  | 85  | 78  | 74  | 71  | 77  | 73  | 71  | 76  | 73  | 71  | 76  | 73  | 70  | 69  |    |    |   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 419004 |
| 5°  | 390246 |
| 10° | 278375 |
| 15° | 163949 |
| 20° | 102018 |
| 25° | 55986  |
| 30° | 25599  |
| 35° | 9697   |
| 40° | 4393   |
| 45° | 2642   |
| 50° | 1105   |
| 55° | 705    |
| 60° | 481    |
| 65° | 336    |
| 70° | 64     |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2642 cd/sqm



TEST NUMBER: P761165

CATALOG NUMBER: LD6D15D010-EU6DR250215IC9050-6LBSQW1B

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 305.8  | 30.2      |
| 10°-20°   | 414.2  | 41.0      |
| 20°-30°   | 219.2  | 21.7      |
| 30°-40°   | 54.1   | 5.4       |
| 40°-50°   | 13.2   | 1.3       |
| 50°-60°   | 3.5    | 0.3       |
| 60°-70°   | 1.2    | 0.1       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 939.1  | 92.9      |
| 0°-40°    | 993.2  | 98.2      |
| 0°-60°    | 1009.9 | 99.9      |
| 0°-90°    | 1011.1 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1011.1 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 3835 |      |
| 5°  | 3558 | 306  |
| 15° | 1449 | 414  |
| 25° | 464  | 219  |
| 35° | 73   | 54   |
| 45° | 17   | 13   |
| 55° | 4    | 3    |
| 65° | 1    | 1    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P761165

CATALOG NUMBER: LD6D15D010-EU6DR250215IC9050-6LBSQW1B

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 3834.9 |
| 2.5°  | 3771.8 |
| 5°    | 3558.1 |
| 7.5°  | 3128.7 |
| 10°   | 2509.1 |
| 12.5° | 1896.7 |
| 15°   | 1449.4 |
| 17.5° | 1129.6 |
| 20°   | 877.4  |
| 22.5° | 658.0  |
| 25°   | 464.4  |
| 27.5° | 311.4  |
| 30°   | 202.9  |
| 32.5° | 123.5  |
| 35°   | 72.7   |
| 37.5° | 44.5   |
| 40°   | 30.8   |
| 42.5° | 23.5   |
| 45°   | 17.1   |
| 47.5° | 10.3   |
| 50°   | 6.5    |
| 52.5° | 4.7    |
| 55°   | 3.7    |
| 57.5° | 2.9    |
| 60°   | 2.2    |
| 62.5° | 1.8    |
| 65°   | 1.3    |
| 67.5° | 0.5    |
| 70°   | 0.2    |
| 72.5° | 0.0    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)