

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P762038

Luminaire Tested: LD6D20D010-EU6DR2015309030-6LBSQW1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P762038
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D20D010-EU6DR2015309030-6LBSQW1B
Description: 6 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1624.3 lumens
Efficiency: N/A
Efficacy: 70.3 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P762038

CATALOG NUMBER: LD6D20D010-EU6DR2015309030-6LBSQW1B

Luminous Intensity Polar Plot

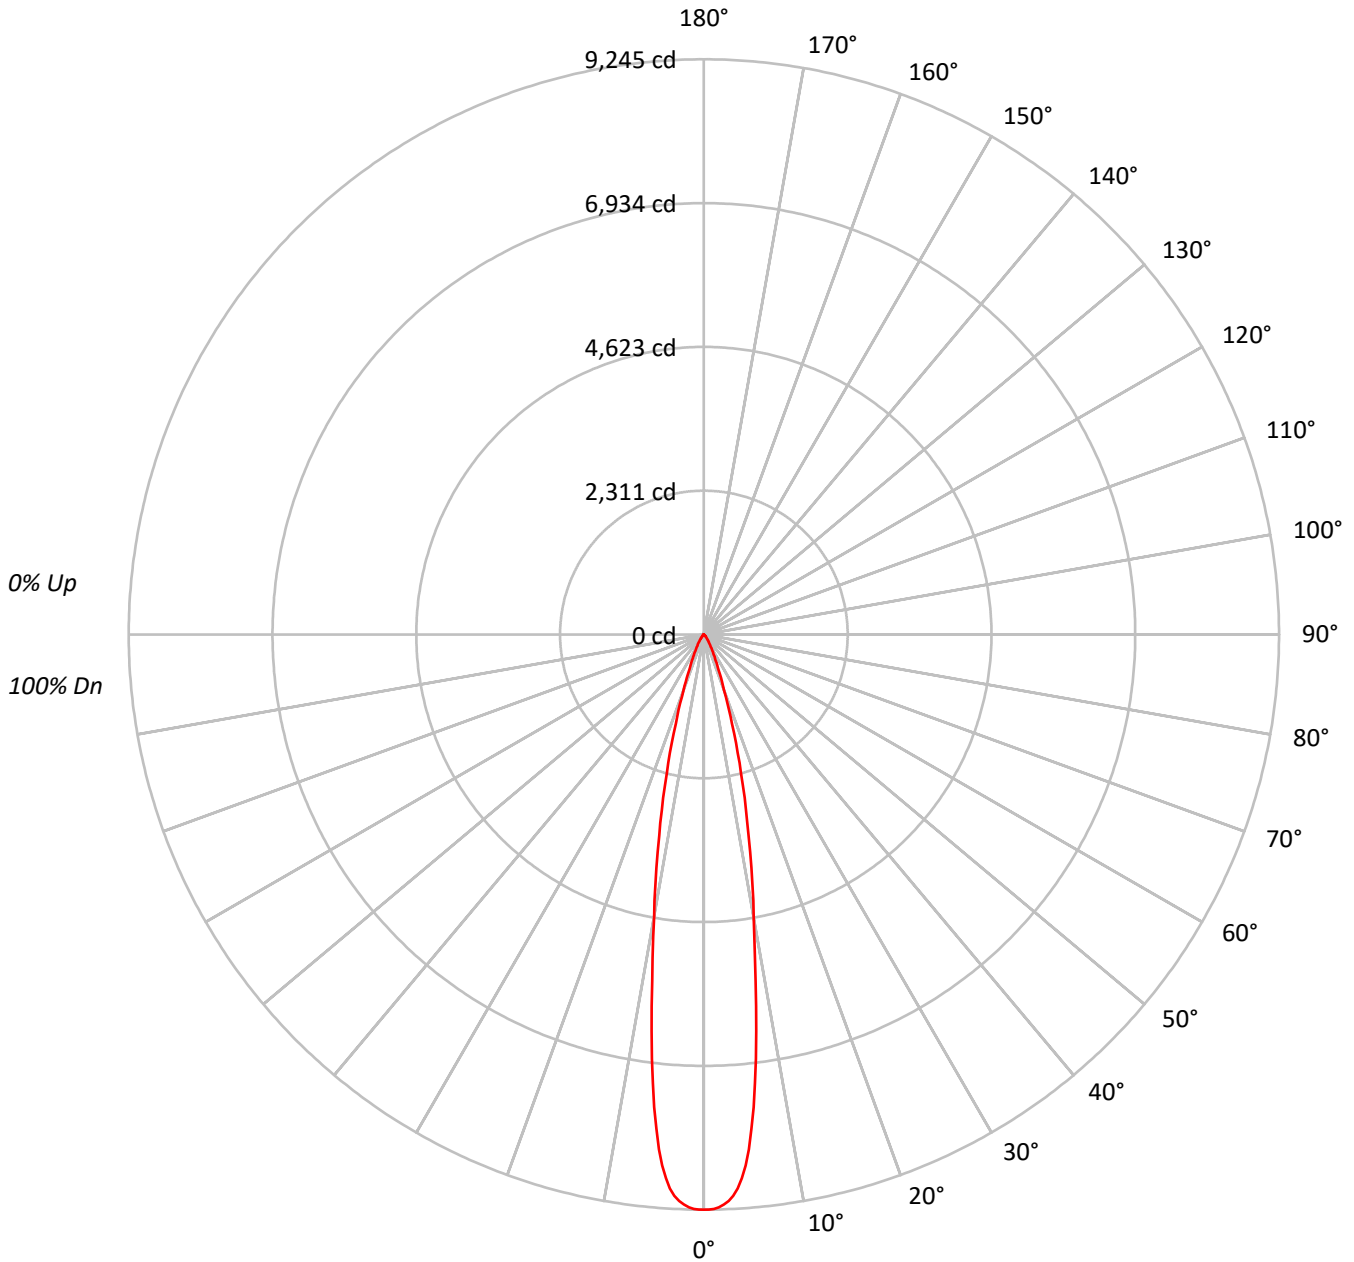



TEST NUMBER: P762038

CATALOG NUMBER: LD6D20D010-EU6DR2015309030-6LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	98	96	95	94															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	98	96	95	94															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	95	93	92	91															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	93	91	89	88															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	91	88	86	85															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	88	86	84	83															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	86	84	82	81															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	84	82	80	79															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	82	80	78	77															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	81	78	76	75															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1010138
5°	911326
10°	511485
15°	259995
20°	110076
25°	50814
30°	26898
35°	14499
40°	7745
45°	4574
50°	2652
55°	1410
60°	896
65°	646
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4574 cd/sqm



TEST NUMBER: P762038

CATALOG NUMBER: LD6D20D010-EU6DR2015309030-6LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	658.2	40.5
10°-20°	648.1	39.9
20°-30°	211.7	13.0
30°-40°	72.1	4.4
40°-50°	24.2	1.5
50°-60°	7.3	0.4
60°-70°	2.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1518.1	93.5
0°-40°	1590.2	97.9
0°-60°	1621.7	99.8
0°-90°	1624.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1624.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9245	
5°	8309	658
15°	2298	648
25°	422	212
35°	109	72
45°	30	24
55°	7	7
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P762038

CATALOG NUMBER: LD6D20D010-EU6DR2015309030-6LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	9245.2
0.5°	9245.2
1°	9233.6
1.5°	9210.6
2°	9168.6
2.5°	9112.6
3°	9033.6
3.5°	8923.3
4°	8759.4
4.5°	8560.2
5°	8309.1
5.5°	7979.0
6°	7640.6
6.5°	7252.9
7°	6873.4
7.5°	6428.8
8°	6032.0
8.5°	5632.7
9°	5263.9
9.5°	4925.5
10°	4610.2
12.5°	3310.3
15°	2298.5
17.5°	1501.6
20°	946.7
22.5°	613.3
25°	421.5
27.5°	296.4
30°	213.2
32.5°	153.1
35°	108.7
37.5°	75.7
40°	54.3
42.5°	39.5
45°	29.6
47.5°	23.1
50°	15.6
52.5°	9.9
55°	7.4
57.5°	5.8
60°	4.1
62.5°	3.3
65°	2.5



TEST NUMBER: P762038

CATALOG NUMBER: LD6D20D010-EU6DR2015309030-6LBSQW1B

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



67.5°		1.6
70°		0.8

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)