

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756926

Luminaire Tested: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P756926
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 363.9 lumens
Efficiency: N/A
Efficacy: 71.4 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P756926

CATALOG NUMBER: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW

Luminous Intensity Polar Plot

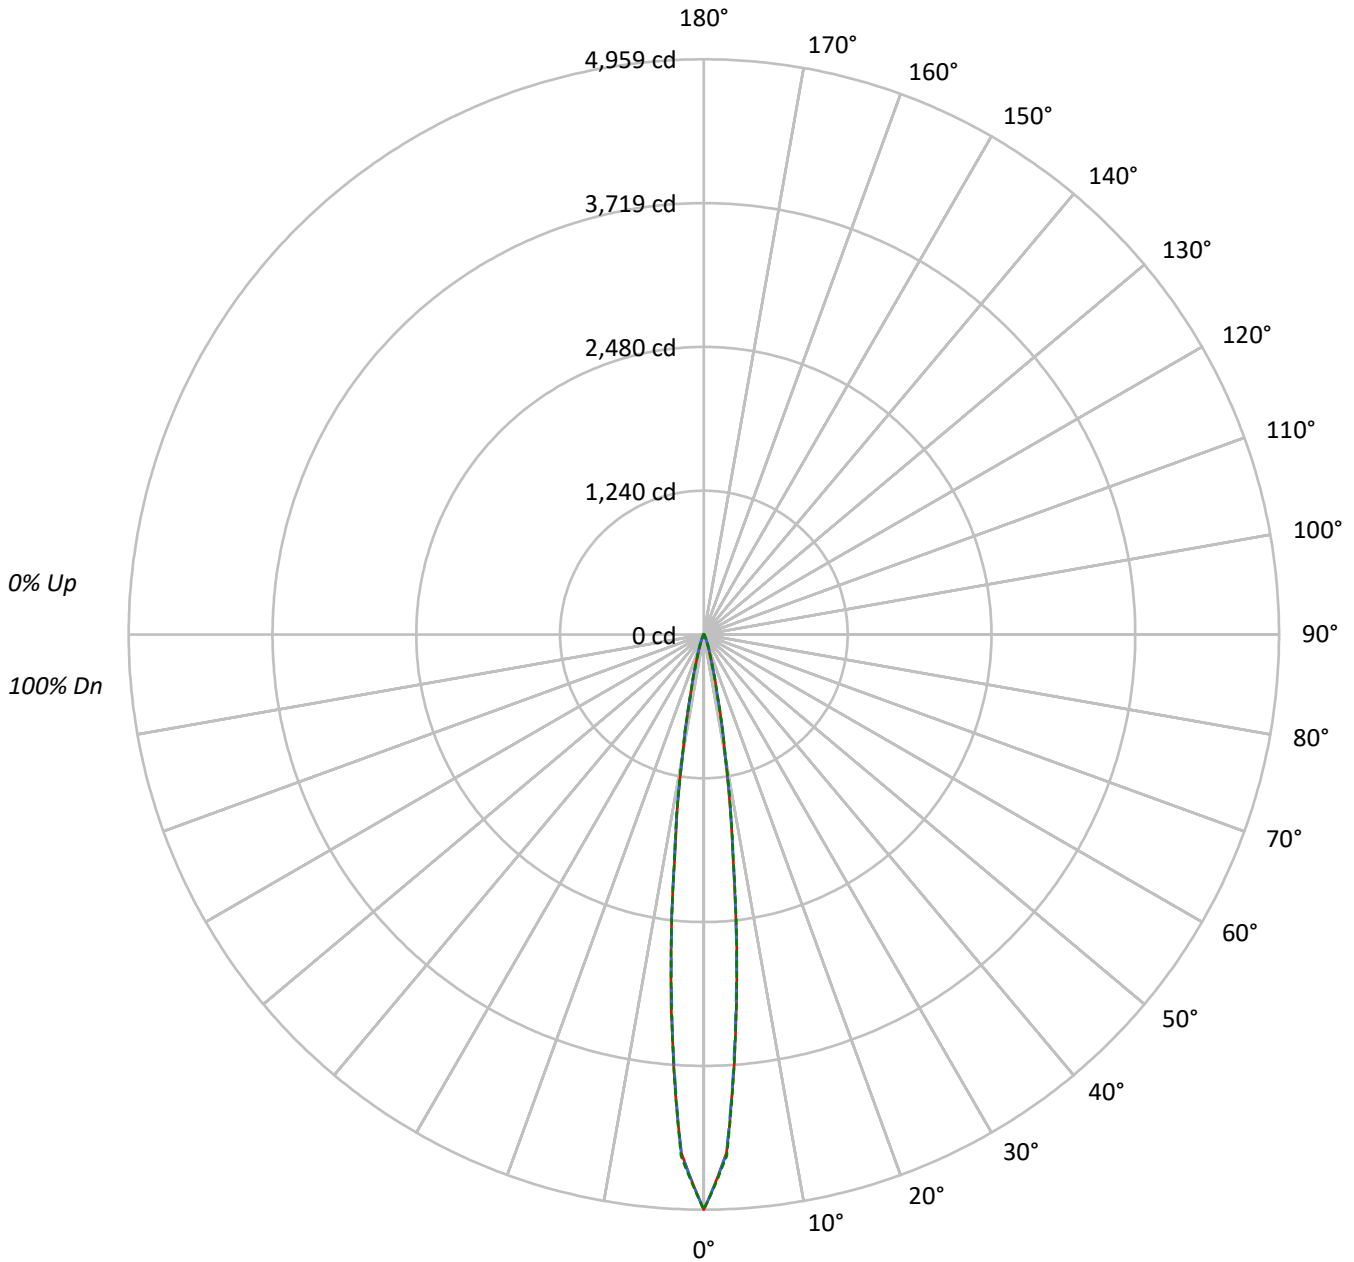



TEST NUMBER: P756926

CATALOG NUMBER: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	99	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	557986	557986	557986
5°	327895	323658	326208
10°	97861	98551	100054
15°	24346	24815	24051
20°	7282	8436	7438
25°	2571	3272	2602
30°	944	1243	958
35°	472	530	458
40°	298	327	298
45°	217	238	217
50°	174	174	174
55°	146	146	146
60°	119	119	119
65°	93	93	93
70°	73	73	73
75°	45	45	60
80°	32	32	32
85°	17	17	17

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 238 cd/sqm



TEST NUMBER: P756926

CATALOG NUMBER: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	236.1	64.9
10°-20°	97.1	26.7
20°-30°	19.3	5.3
30°-40°	4.8	1.3
40°-50°	2.5	0.7
50°-60°	1.9	0.5
60°-70°	1.3	0.4
70°-80°	0.7	0.2
80°-90°	0.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
<hr/>		
0°-30°	352.4	96.8
0°-40°	357.3	98.2
0°-60°	361.7	99.4
0°-90°	363.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	363.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4959	4959	4959	4959	4959	
5°	3226	3193	3185	3207	3210	236
15°	280	286	286	281	277	96
25°	33	37	42	37	33	17
35°	6	7	7	7	6	4
45°	3	3	3	3	3	2
55°	2	2	2	2	2	2
65°	1	1	1	1	1	1
75°	1	1	1	1	1	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P756926

CATALOG NUMBER: LD6D02D010-EU6DR150210IC9035-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4959.0	4959.0	4959.0	4959.0	4959.0
2.5°	4473.2	4477.0	4478.5	4482.9	4499.2
5°	3226.4	3193.3	3184.7	3206.7	3209.8
7.5°	1911.2	1917.9	1942.5	1947.9	1928.2
10°	1048.8	1057.4	1056.2	1063.7	1072.3
12.5°	536.4	529.7	527.6	536.2	524.2
15°	280.3	285.5	285.7	280.7	276.9
17.5°	150.7	156.8	166.9	158.7	146.1
20°	89.0	94.5	103.1	96.4	90.9
22.5°	55.0	59.4	65.5	60.3	55.8
25°	33.0	37.4	42.0	37.2	33.4
27.5°	19.5	23.3	26.2	23.1	19.3
30°	12.6	14.7	16.6	14.5	12.8
32.5°	8.8	9.7	10.5	9.7	8.8
35°	6.5	6.9	7.3	6.9	6.3
37.5°	5.0	5.5	5.7	5.2	4.8
40°	4.2	4.4	4.6	4.4	4.2
42.5°	3.6	3.8	3.8	3.8	3.6
45°	3.1	3.1	3.4	3.1	3.1
47.5°	2.7	2.7	2.9	2.7	2.7
50°	2.5	2.5	2.5	2.5	2.5
52.5°	2.3	2.3	2.3	2.3	2.3
55°	2.1	2.1	2.1	2.1	2.1
57.5°	1.9	1.9	1.9	1.9	1.9
60°	1.7	1.7	1.7	1.7	1.7
62.5°	1.5	1.5	1.5	1.5	1.5
65°	1.3	1.3	1.3	1.3	1.3
67.5°	1.3	1.3	1.3	1.3	1.3
70°	1.0	1.0	1.0	1.0	1.0
72.5°	0.8	0.8	0.8	0.8	0.8
75°	0.6	0.6	0.6	0.6	0.8
77.5°	0.6	0.6	0.6	0.6	0.6
80°	0.4	0.4	0.4	0.4	0.4
82.5°	0.4	0.4	0.4	0.4	0.4
85°	0.2	0.2	0.2	0.2	0.2
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)