

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757160

Luminaire Tested: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P757160
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 341.3 lumens
Efficiency: N/A
Efficacy: 66.9 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757160

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW

Luminous Intensity Polar Plot

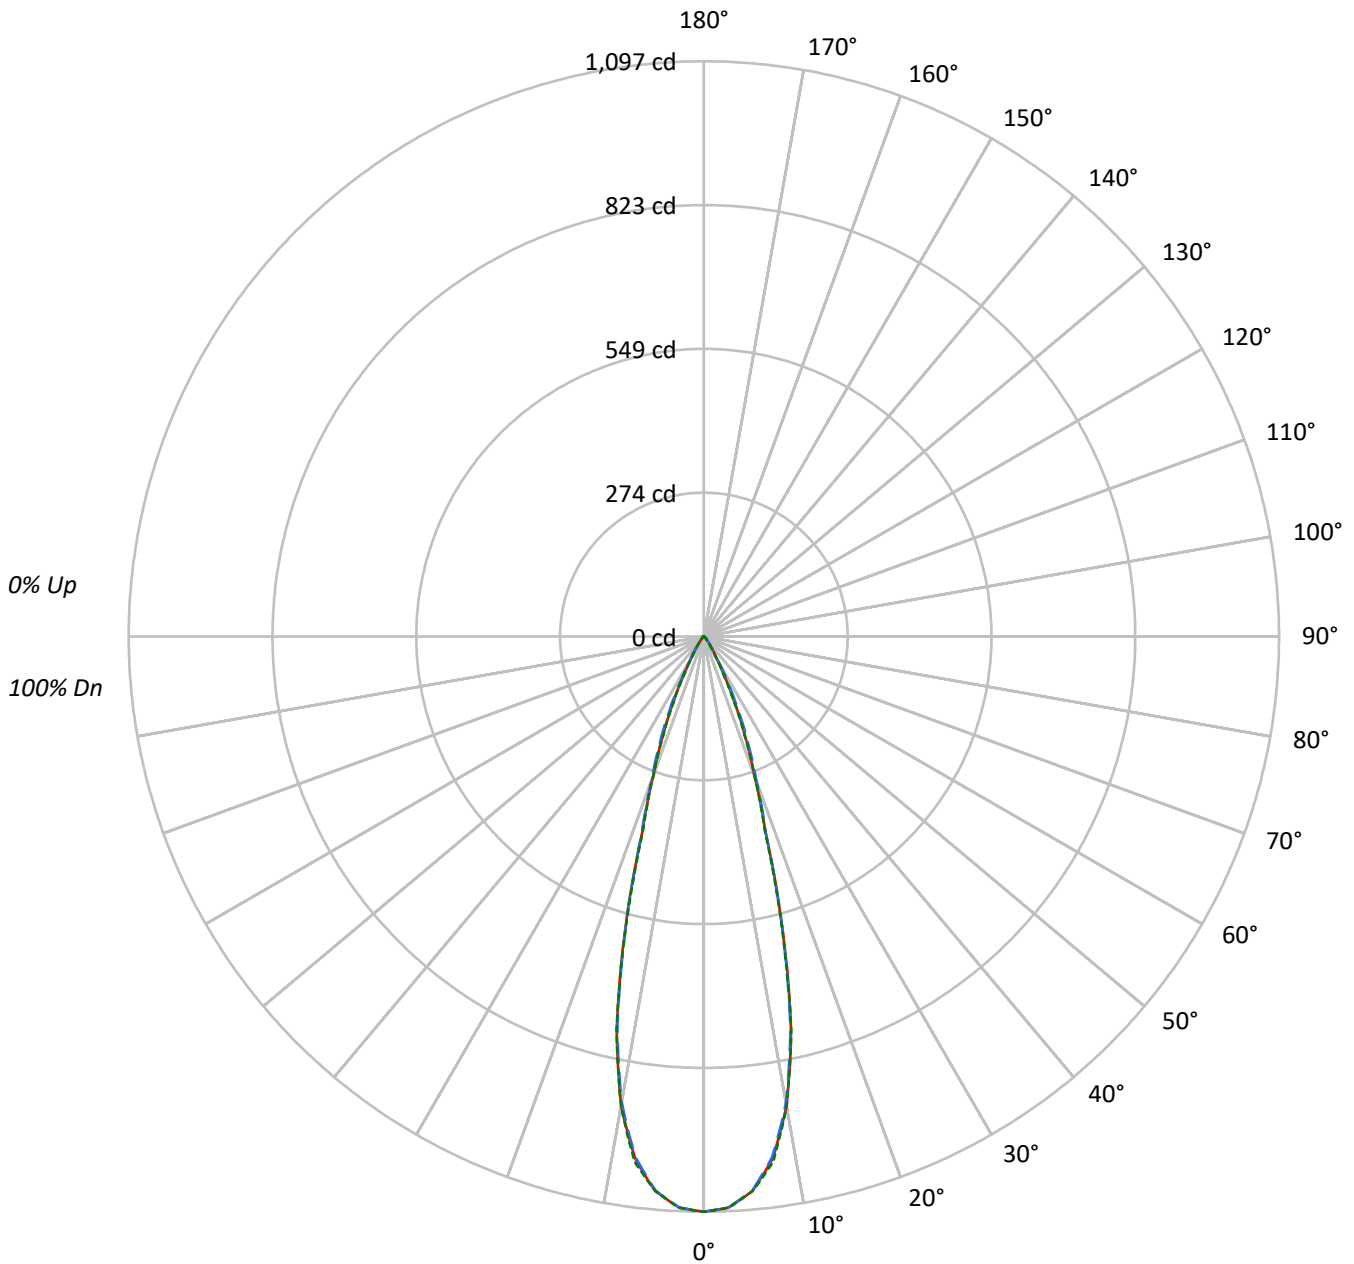



TEST NUMBER: P757160

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	83991	83991	83991
5°	81584	81484	81584
10°	70667	70162	70644
15°	46104	45858	45628
20°	22922	23785	22897
25°	11554	13023	11317
30°	4623	5038	4030
35°	2149	2056	1719
40°	929	1029	869
45°	649	812	660
50°	226	595	238
55°	133	240	133
60°	92	107	92
65°	54	54	54
70°	45	22	45
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 812 cd/sqm



TEST NUMBER: P757160

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	96.5	28.3
10°-20°	155.4	45.5
20°-30°	67.2	19.7
30°-40°	15.3	4.5
40°-50°	5.3	1.5
50°-60°	1.3	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	319.1	93.5
0°-40°	334.4	98.0
0°-60°	340.9	99.9
0°-90°	341.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	341.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1097	1097	1097	1097	1097	
5°	1062	1061	1060	1063	1062	97
15°	582	575	579	577	576	156
25°	137	142	154	138	134	65
35°	23	23	22	22	18	16
45°	6	8	8	8	6	4
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P757160

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9035-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1097.3	1097.3	1097.3	1097.3	1097.3
2.5°	1090.1	1089.3	1089.8	1090.3	1090.5
5°	1061.8	1060.8	1060.5	1062.8	1061.8
7.5°	1004.7	1003.3	1001.1	1006.1	1010.7
10°	909.2	907.6	902.7	905.1	908.9
12.5°	768.0	762.8	762.7	770.3	769.2
15°	581.8	574.8	578.7	576.8	575.8
17.5°	391.3	388.6	393.7	392.2	385.4
20°	281.4	282.1	292.0	287.0	281.1
22.5°	205.4	207.9	219.6	206.8	202.1
25°	136.8	141.9	154.2	138.3	134.0
27.5°	84.1	86.5	98.9	83.0	80.7
30°	52.3	51.1	57.0	48.9	45.6
32.5°	34.3	32.8	34.7	31.2	28.4
35°	23.0	23.4	22.0	21.8	18.4
37.5°	14.3	16.5	14.6	15.5	11.9
40°	9.3	12.0	10.3	11.3	8.7
42.5°	7.6	9.2	8.5	9.0	7.7
45°	6.0	7.5	7.5	7.5	6.1
47.5°	3.3	5.0	6.4	5.1	3.6
50°	1.9	2.5	5.0	2.6	2.0
52.5°	1.3	1.4	3.4	1.5	1.4
55°	1.0	1.0	1.8	1.1	1.0
57.5°	0.7	0.8	1.0	0.8	0.7
60°	0.6	0.6	0.7	0.6	0.6
62.5°	0.5	0.5	0.5	0.5	0.5
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.2	0.2	0.2	0.2	0.2
70°	0.2	0.1	0.1	0.1	0.2
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)