

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757628

Luminaire Tested: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P757628
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 376.4 lumens
Efficiency: N/A
Efficacy: 73.8 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757628

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW

Luminous Intensity Polar Plot

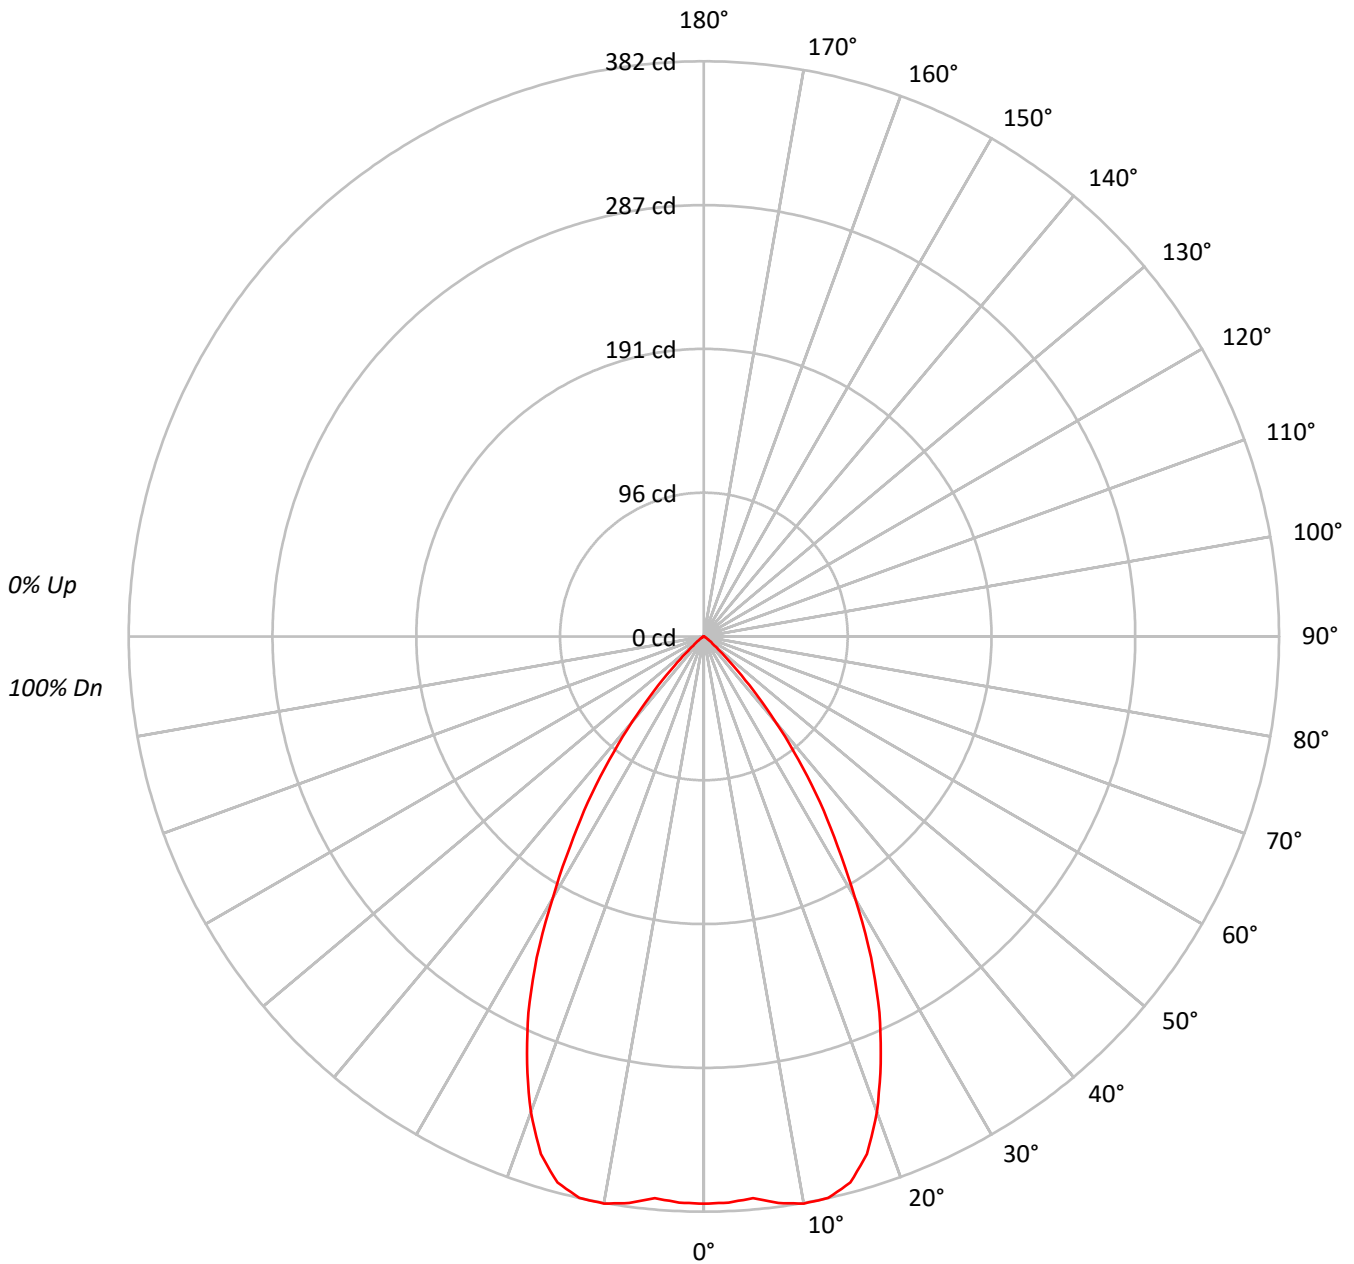



TEST NUMBER: P757628

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78	74	71	70
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74	70	67	65
7	83	74	68	63	82	73	67	63	72	67	63		71	66	63		69	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66	61	58	57
9	75	65	59	55	74	65	59	55	64	59	55		63	58	55		62	58	55	53
10	72	62	56	52	71	61	56	52	61	55	52		60	55	52		59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	41159
5°	41063
10°	42426
15°	42475
20°	39079
25°	33237
30°	25321
35°	17900
40°	10512
45°	4234
50°	1411
55°	686
60°	284
65°	52
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4234 cd/sqm



TEST NUMBER: P757628

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	36.1	9.6
10°-20°	104.0	27.6
20°-30°	124.5	33.1
30°-40°	83.2	22.1
40°-50°	24.7	6.5
50°-60°	3.6	0.9
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	264.6	70.3
0°-40°	347.9	92.4
0°-60°	376.1	99.9
0°-90°	376.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	376.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	377	
5°	374	36
15°	376	104
25°	276	124
35°	134	83
45°	27	25
55°	4	4
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P757628

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9035-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	376.7
2.5°	376.3
5°	374.4
7.5°	379.5
10°	382.4
12.5°	381.9
15°	375.5
17.5°	360.3
20°	336.1
22.5°	306.9
25°	275.7
27.5°	240.5
30°	200.7
32.5°	165.2
35°	134.2
37.5°	103.2
40°	73.7
42.5°	48.6
45°	27.4
47.5°	14.0
50°	8.3
52.5°	5.4
55°	3.6
57.5°	2.3
60°	1.3
62.5°	0.5
65°	0.2
67.5°	0.1
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)