

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757183

Luminaire Tested: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P757183  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW  
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 30° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 322.9 lumens  
Efficiency: N/A  
Efficacy: 63.3 lumens/watt  
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49  
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P757183  
CATALOG NUMBER: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW

### Luminous Intensity Polar Plot

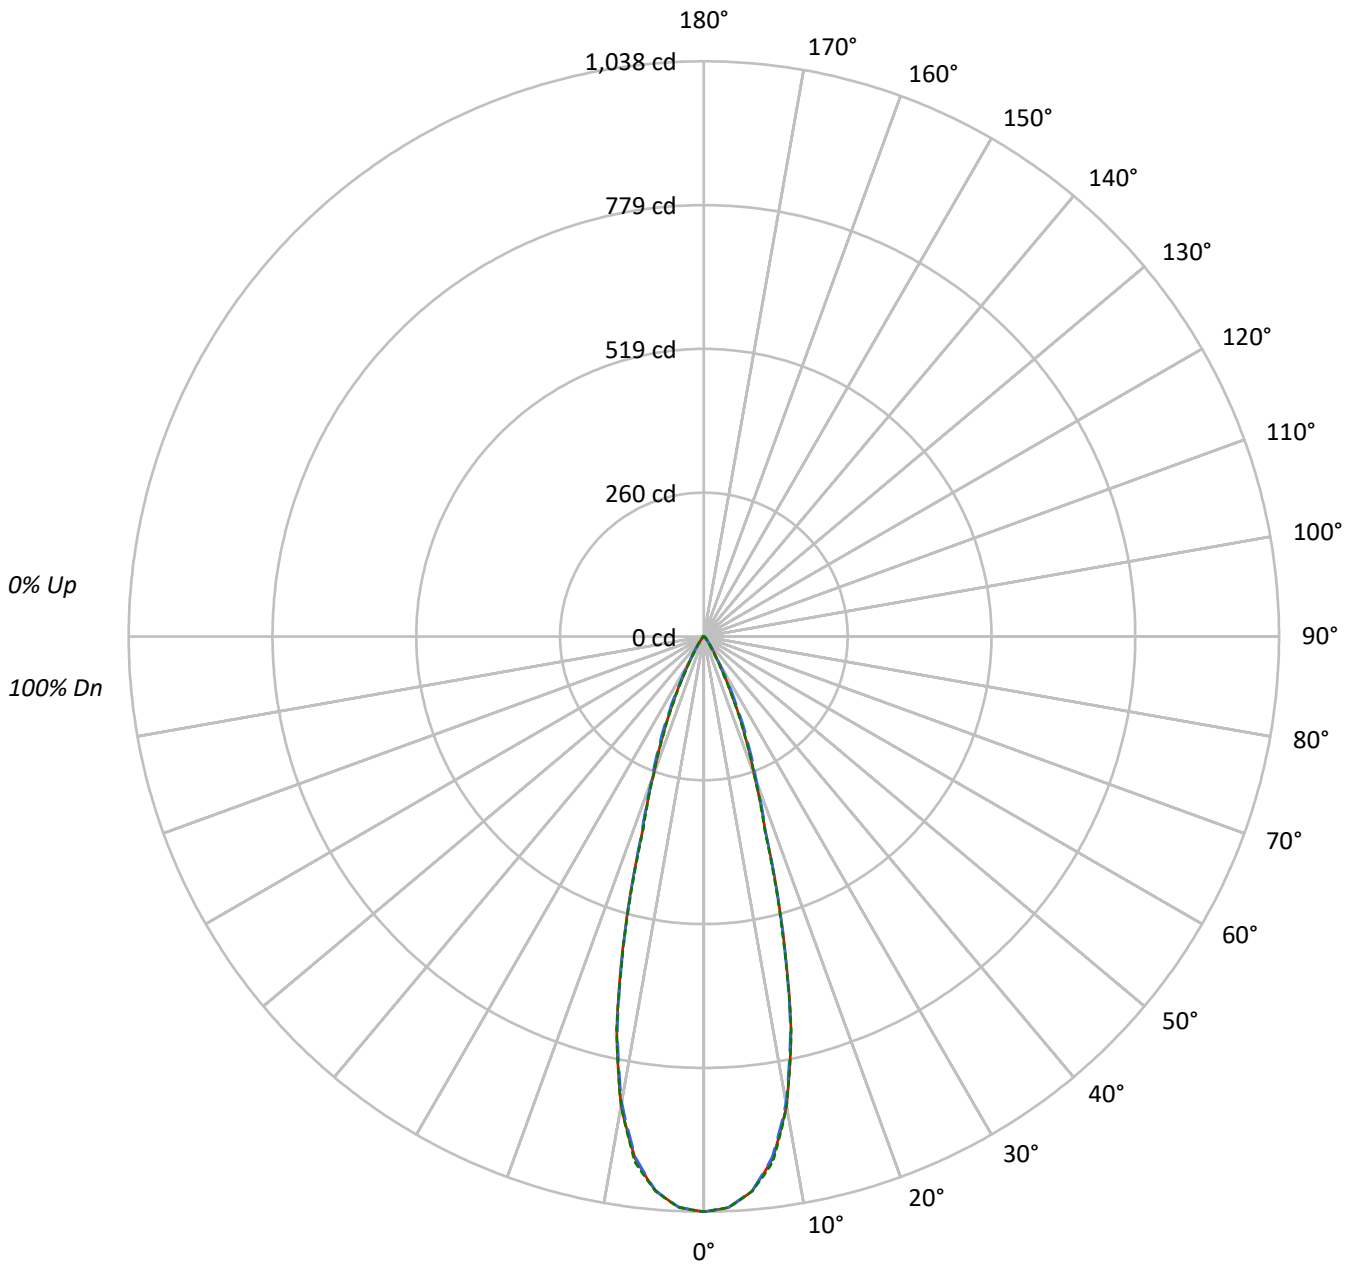



TEST NUMBER: P757183

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	79460	79460	79460
5°	77174	77082	77182
10°	66851	66376	66827
15°	43616	43378	43156
20°	21692	22498	21659
25°	10929	12322	10701
30°	4375	4764	3809
35°	2028	1944	1626
40°	879	969	829
45°	617	769	628
50°	214	560	226
55°	120	227	133
60°	92	107	92
65°	54	54	54
70°	45	22	45
75°	0	30	0
80°	0	0	0
85°	0	0	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 22.5°

Vertical Angle: 45°

Luminance: 769 cd/sqm



TEST NUMBER: P757183

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	91.3	28.3
10°-20°	147.0	45.5
20°-30°	63.5	19.7
30°-40°	14.5	4.5
40°-50°	5.0	1.5
50°-60°	1.2	0.4
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	301.8	93.5
0°-40°	316.3	98.0
0°-60°	322.5	99.9
0°-90°	322.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	322.9	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1038	1038	1038	1038	1038	
5°	1004	1004	1003	1005	1004	91
15°	550	544	547	546	545	147
25°	129	134	146	131	127	62
35°	22	22	21	21	17	15
45°	6	7	7	7	6	4
55°	1	1	2	1	1	1
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P757183

CATALOG NUMBER: LD6D02D010-EU6DR300210IC9040-6LBSQW1MW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	1038.1	1038.1	1038.1	1038.1	1038.1
2.5°	1031.2	1030.5	1030.9	1031.4	1031.6
5°	1004.4	1003.5	1003.2	1005.4	1004.5
7.5°	950.5	949.1	947.0	951.7	956.1
10°	860.1	858.5	854.0	856.2	859.8
12.5°	726.6	721.6	721.5	728.6	727.7
15°	550.4	543.7	547.4	545.6	544.6
17.5°	370.1	367.5	372.5	371.0	364.6
20°	266.3	266.9	276.2	271.5	265.9
22.5°	194.3	196.7	207.8	195.7	191.2
25°	129.4	134.2	145.9	130.8	126.7
27.5°	79.6	81.8	93.6	78.6	76.3
30°	49.5	48.4	53.9	46.3	43.1
32.5°	32.5	31.1	32.8	29.4	26.9
35°	21.7	22.2	20.8	20.6	17.4
37.5°	13.6	15.6	13.8	14.7	11.2
40°	8.8	11.3	9.7	10.8	8.3
42.5°	7.2	8.7	8.0	8.5	7.3
45°	5.7	7.1	7.1	7.1	5.8
47.5°	3.2	4.8	6.1	4.9	3.4
50°	1.8	2.4	4.7	2.5	1.9
52.5°	1.2	1.4	3.2	1.4	1.3
55°	0.9	1.0	1.7	1.0	1.0
57.5°	0.7	0.7	0.9	0.7	0.7
60°	0.6	0.6	0.7	0.6	0.6
62.5°	0.4	0.4	0.5	0.4	0.4
65°	0.3	0.3	0.3	0.3	0.3
67.5°	0.2	0.2	0.2	0.2	0.2
70°	0.2	0.1	0.1	0.1	0.2
72.5°	0.1	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)