

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757651

Luminaire Tested: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P757651
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 354.5 lumens
Efficiency: N/A
Efficacy: 69.5 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.84
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757651

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW

Luminous Intensity Polar Plot

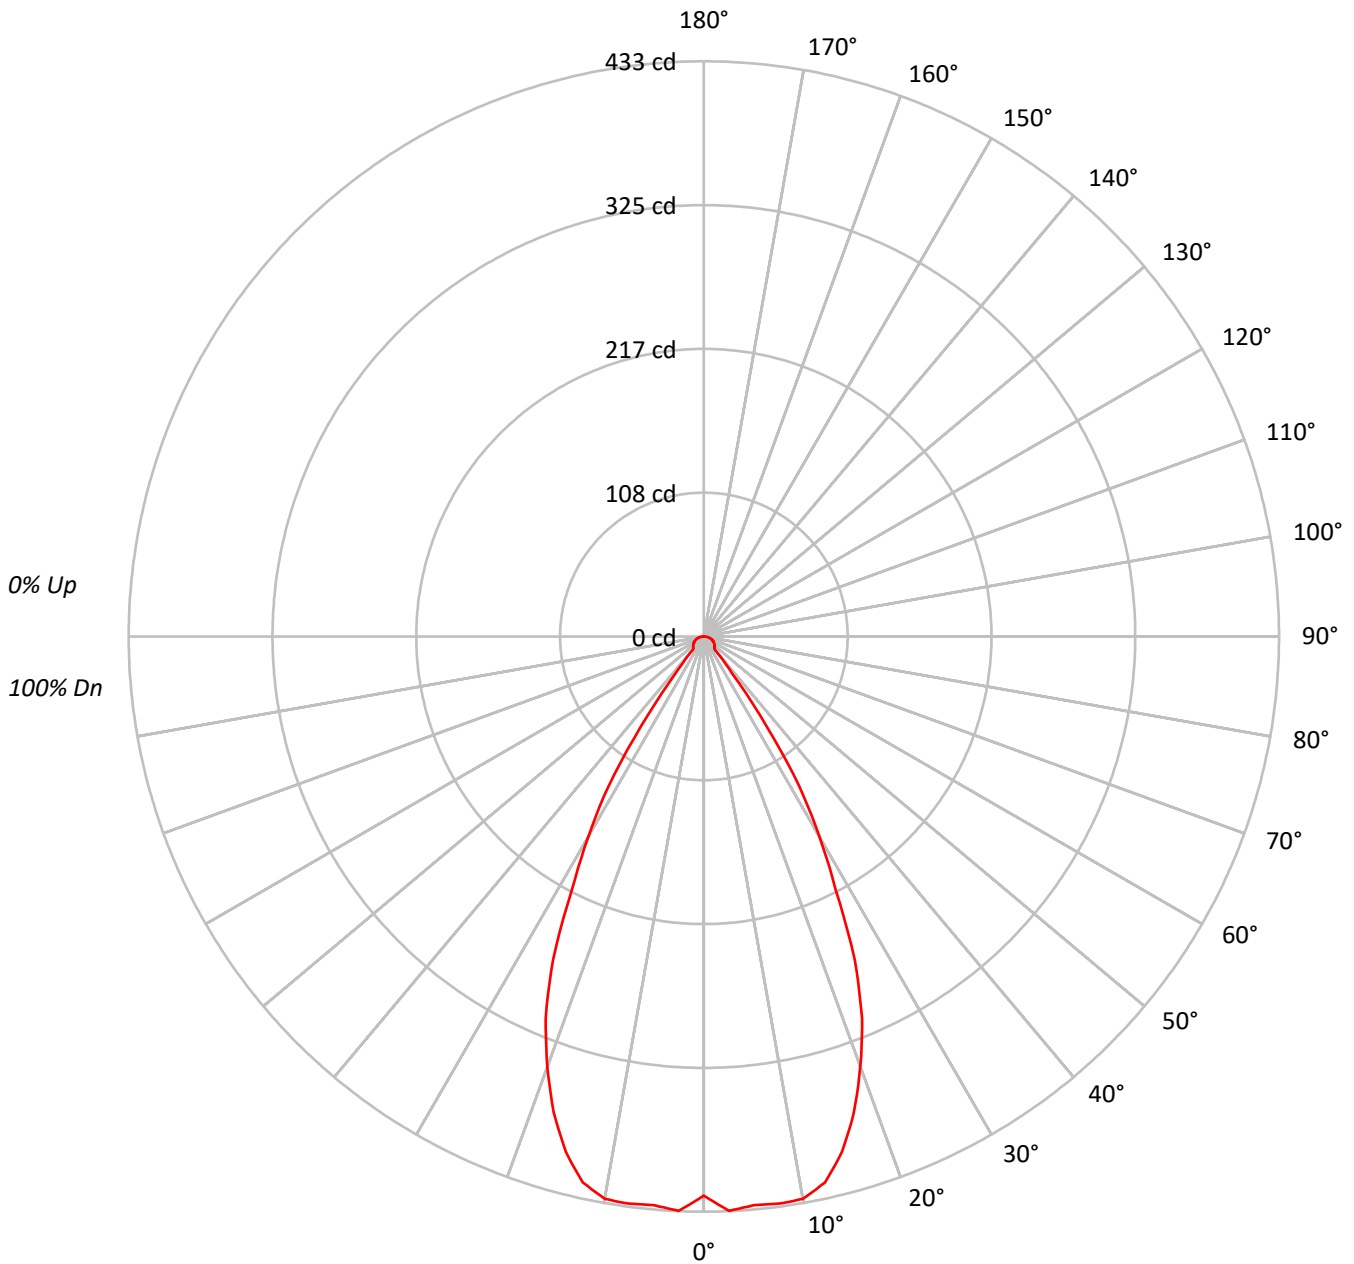



TEST NUMBER: P757651

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75	75	75	75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70	70	70	70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66	66	66	66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62	62	62	62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53	53	53	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	45988
5°	47129
10°	47696
15°	45438
20°	40056
25°	32405
30°	21915
35°	10977
40°	1783
45°	1746
50°	1785
55°	1810
60°	1857
65°	1887
70°	1949
75°	1942
80°	1888
85°	1630

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 72.5°
 Luminance: 1962 cd/sqm



TEST NUMBER: P757651

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	41.1	11.6
10°-20°	111.1	31.3
20°-30°	119.5	33.7
30°-40°	52.0	14.7
40°-50°	8.7	2.5
50°-60°	8.5	2.4
60°-70°	7.3	2.1
70°-80°	4.8	1.4
80°-90°	1.5	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	271.7	76.6
0°-40°	323.7	91.3
0°-60°	340.9	96.2
0°-90°	354.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	354.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	421	
5°	430	41
15°	402	111
25°	269	120
35°	82	52
45°	11	9
55°	10	9
65°	7	7
75°	5	5
85°	1	1
90°	0	



TEST NUMBER: P757651

CATALOG NUMBER: LD6D02D010-EU6DR600210IC9040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	420.9
2.5°	432.8
5°	429.7
7.5°	430.7
10°	429.9
12.5°	421.0
15°	401.7
17.5°	375.7
20°	344.5
22.5°	311.2
25°	268.8
27.5°	215.0
30°	173.7
32.5°	133.9
35°	82.3
37.5°	35.2
40°	12.5
42.5°	11.5
45°	11.3
47.5°	10.9
50°	10.5
52.5°	10.0
55°	9.5
57.5°	9.0
60°	8.5
62.5°	8.0
65°	7.3
67.5°	6.8
70°	6.1
72.5°	5.4
75°	4.6
77.5°	3.8
80°	3.0
82.5°	2.1
85°	1.3
87.5°	0.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)