

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757717

Luminaire Tested: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P757717
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 346.0 lumens
Efficiency: N/A
Efficacy: 67.8 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757717

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB

Luminous Intensity Polar Plot

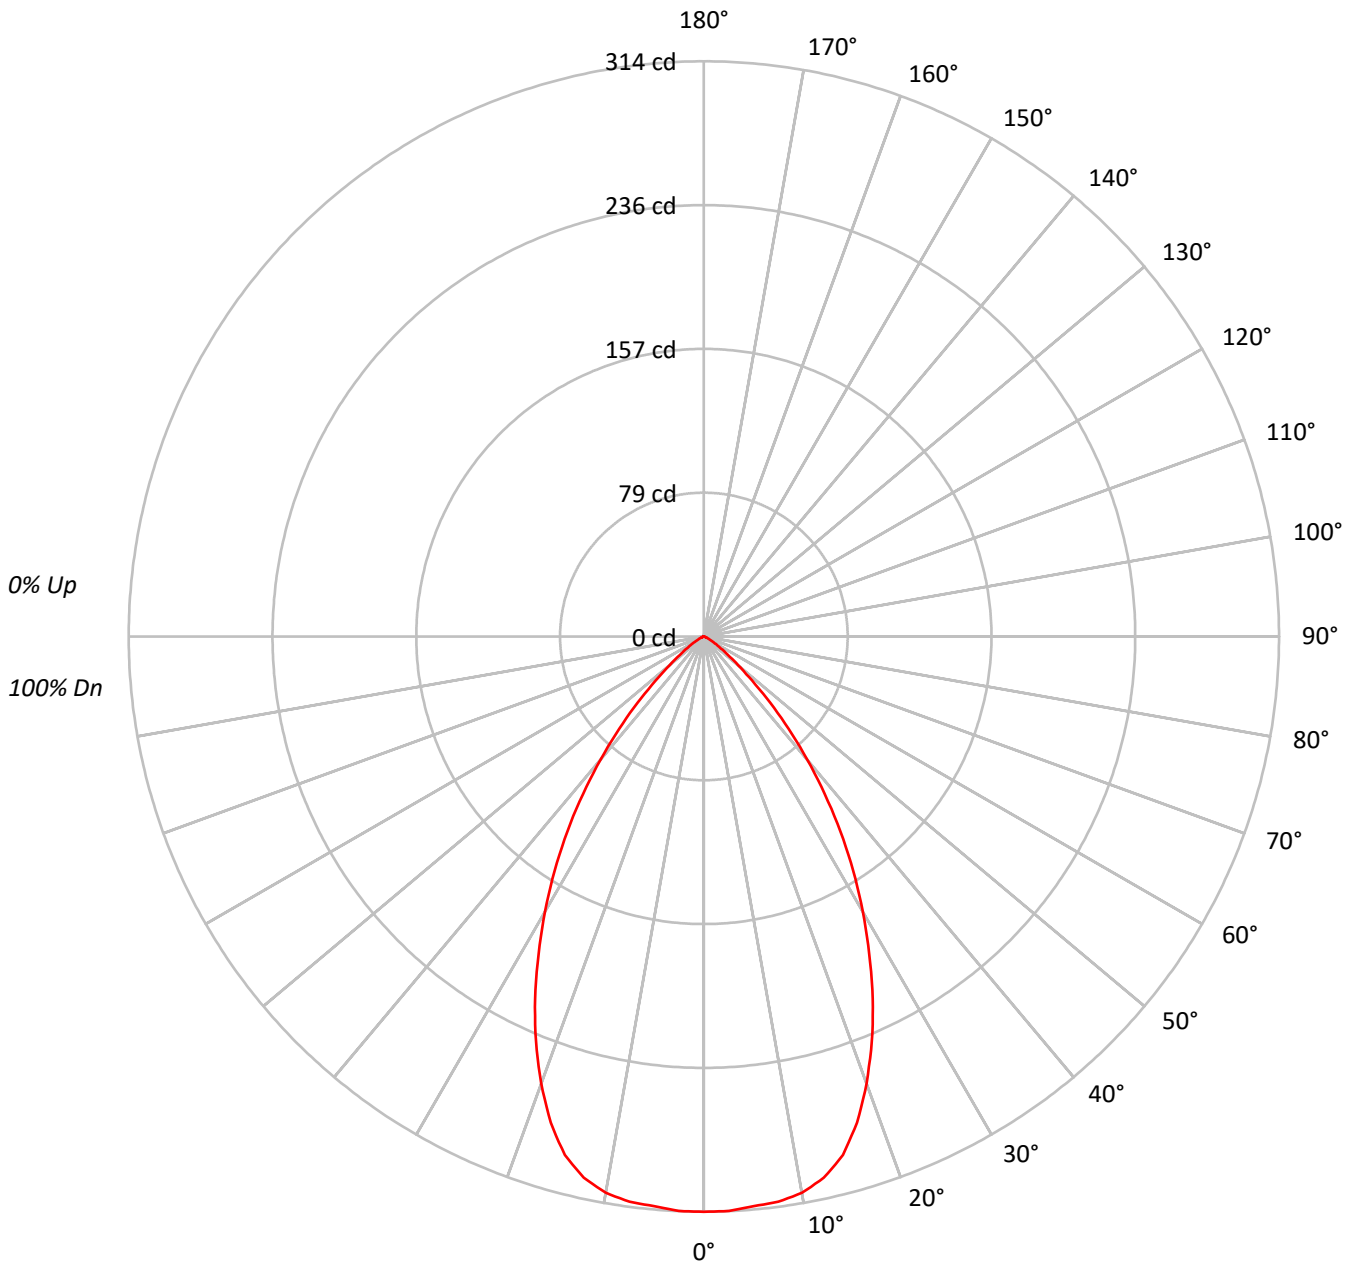



TEST NUMBER: P757717

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	67	66			66
6	85	75	69	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	18345
5°	18303
10°	18290
15°	17722
20°	16135
25°	14061
30°	11694
35°	9262
40°	6686
45°	4229
50°	2199
55°	1171
60°	619
65°	345
70°	154
75°	158
80°	101
85°	67

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4229 cd/sqm



TEST NUMBER: P757717

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	29.7	8.6
10°-20°	81.4	23.5
20°-30°	99.4	28.7
30°-40°	80.7	23.3
40°-50°	40.2	11.6
50°-60°	11.2	3.2
60°-70°	2.6	0.8
70°-80°	0.7	0.2
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	210.5	60.8
0°-40°	291.2	84.2
0°-60°	342.6	99.0
0°-90°	346.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	346.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	314	
5°	312	30
15°	293	81
25°	218	99
35°	130	81
45°	51	40
55°	12	11
65°	2	3
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P757717

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	314.1
2.5°	313.9
5°	312.2
7.5°	311.2
10°	308.4
12.5°	302.6
15°	293.1
17.5°	278.2
20°	259.6
22.5°	239.5
25°	218.2
27.5°	195.4
30°	173.4
32.5°	151.7
35°	129.9
37.5°	108.3
40°	87.7
42.5°	68.4
45°	51.2
47.5°	35.6
50°	24.2
52.5°	16.7
55°	11.5
57.5°	7.7
60°	5.3
62.5°	3.7
65°	2.5
67.5°	1.3
70°	0.9
72.5°	0.8
75°	0.7
77.5°	0.5
80°	0.3
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)