

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757729

Luminaire Tested: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P757729
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 310.0 lumens
Efficiency: N/A
Efficacy: 60.8 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757729

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW

Luminous Intensity Polar Plot

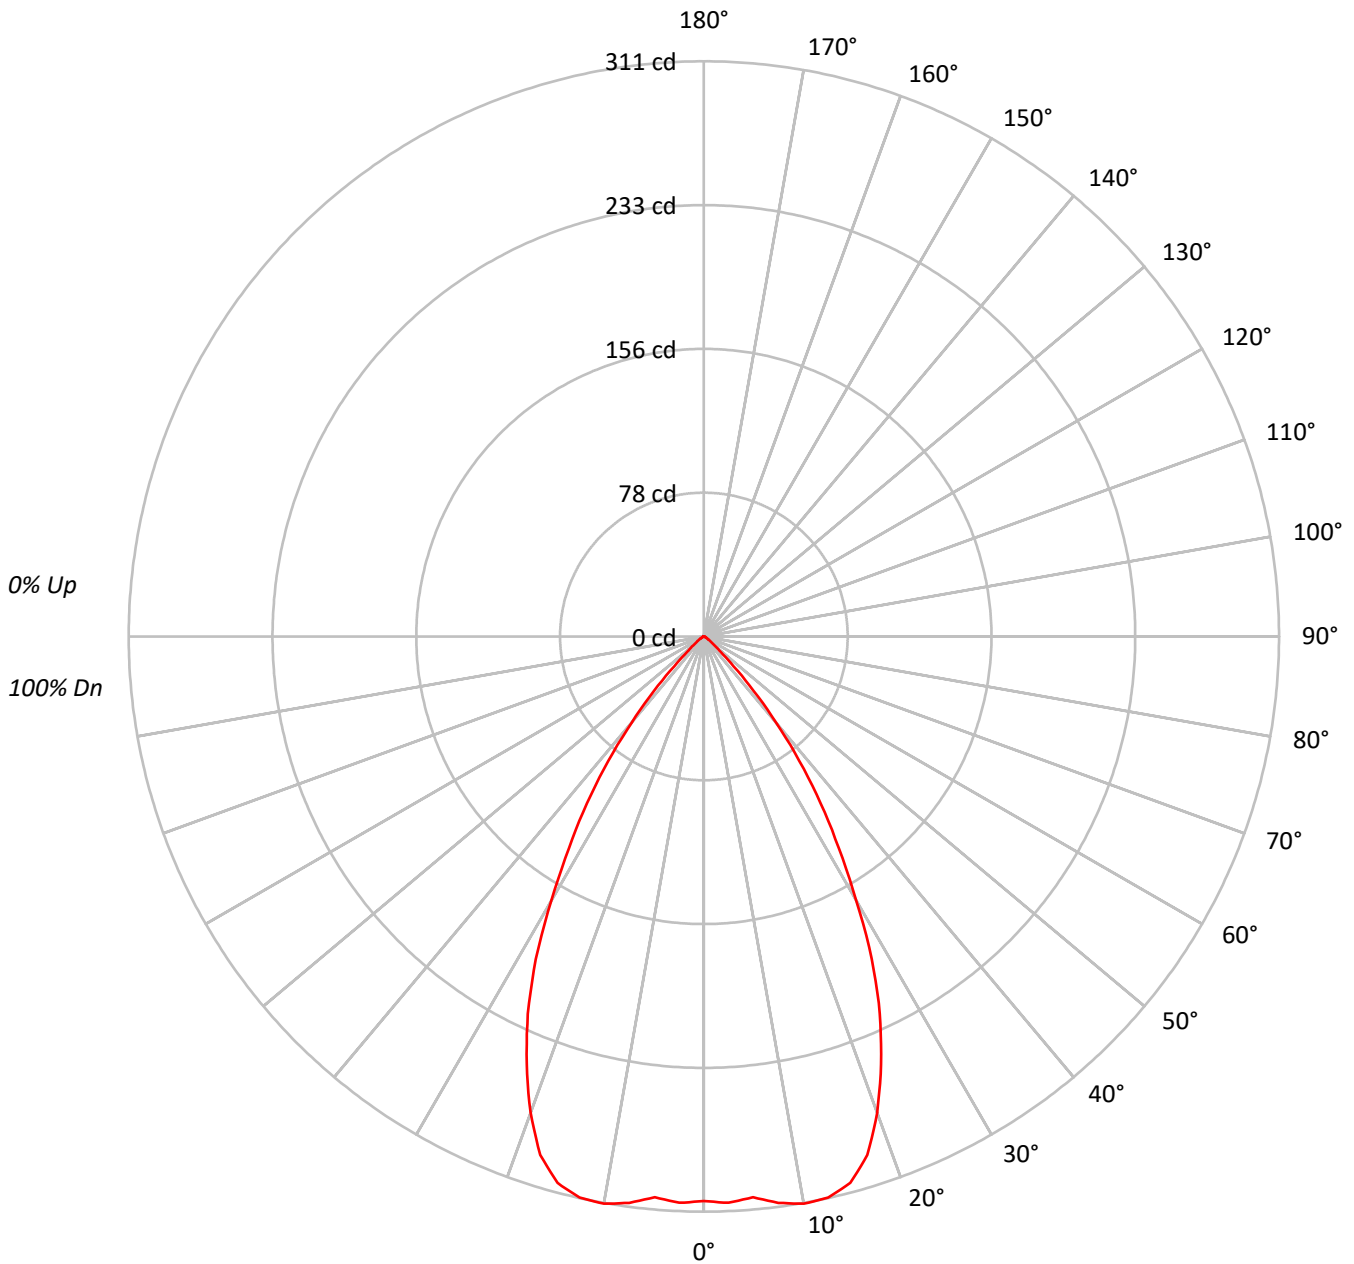



TEST NUMBER: P757729

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	33346
5°	33375
10°	34549
15°	34602
20°	31859
25°	27149
30°	20779
35°	14685
40°	8658
45°	3508
50°	1275
55°	705
60°	415
65°	233
70°	224
75°	211
80°	189
85°	125

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3508 cd/sqm



TEST NUMBER: P757729

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	29.4	9.5
10°-20°	84.8	27.3
20°-30°	101.7	32.8
30°-40°	68.3	22.0
40°-50°	20.4	6.6
50°-60°	3.6	1.2
60°-70°	1.0	0.3
70°-80°	0.5	0.2
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	215.9	69.6
0°-40°	284.2	91.7
0°-60°	308.2	99.4
0°-90°	310.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	310.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	305	
5°	304	29
15°	306	85
25°	225	102
35°	110	68
45°	23	20
55°	4	4
65°	1	1
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P757729

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	305.2
2.5°	306.5
5°	304.3
7.5°	308.9
10°	311.4
12.5°	310.8
15°	305.9
17.5°	294.0
20°	274.0
22.5°	250.4
25°	225.2
27.5°	196.7
30°	164.7
32.5°	135.7
35°	110.1
37.5°	84.7
40°	60.7
42.5°	39.7
45°	22.7
47.5°	12.0
50°	7.5
52.5°	5.2
55°	3.7
57.5°	2.7
60°	1.9
62.5°	1.2
65°	0.9
67.5°	0.8
70°	0.7
72.5°	0.6
75°	0.5
77.5°	0.4
80°	0.3
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)