

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P763095

Luminaire Tested: LD6D25D010-EU6DR3020359024-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P763095
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D25D010-EU6DR3020359024-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2206.3 lumens
Efficiency: N/A
Efficacy: 87.9 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P763095

CATALOG NUMBER: LD6D25D010-EU6DR3020359024-6LBCSSQMW

Luminous Intensity Polar Plot

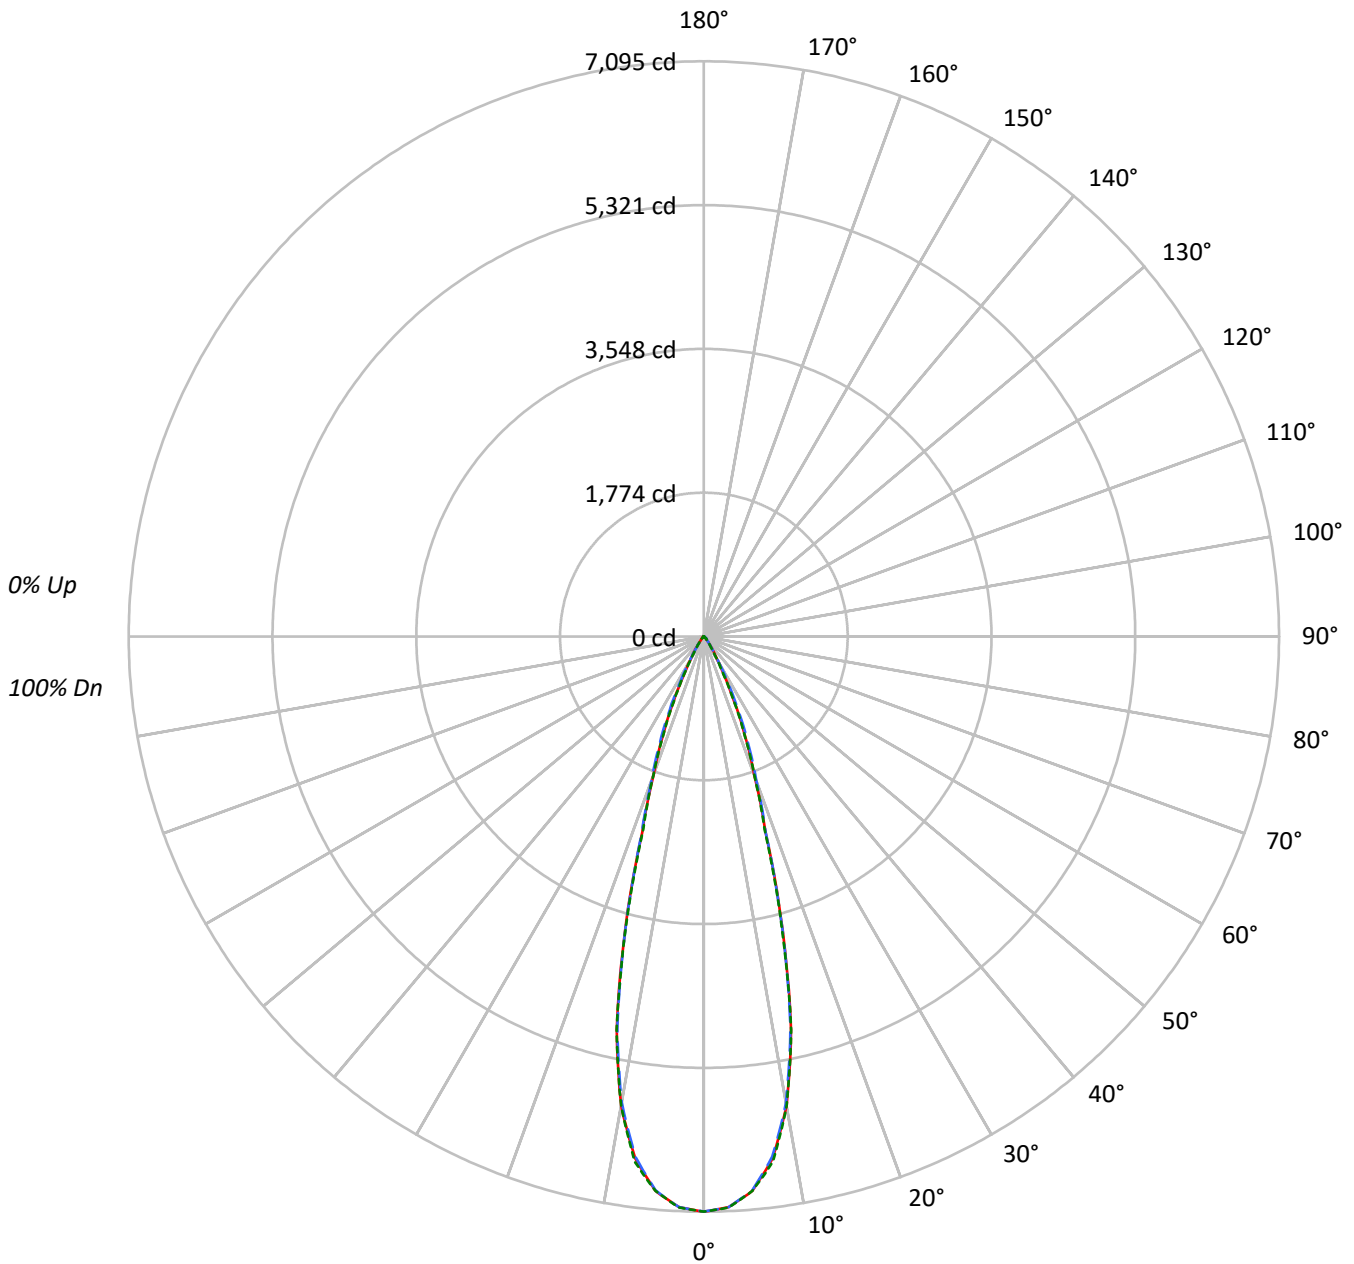



TEST NUMBER: P763095

CATALOG NUMBER: LD6D25D010-EU6DR3020359024-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	543045	543045	543045
5°	527455	526840	527478
10°	456855	453637	456746
15°	298075	296474	294984
20°	148217	153780	148021
25°	74668	84194	73131
30°	29892	32570	26047
35°	13867	13278	11129
40°	5985	6645	5636
45°	4222	5239	4265
50°	1453	3811	1536
55°	827	1588	881
60°	582	689	582
65°	380	380	380
70°	224	157	224
75°	0	89	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 5239 cd/sqm



TEST NUMBER: P763095
 CATALOG NUMBER: LD6D25D010-EU6DR3020359024-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	623.9	28.3
10°-20°	1004.7	45.5
20°-30°	434.2	19.7
30°-40°	98.9	4.5
40°-50°	34.0	1.5
50°-60°	8.3	0.4
60°-70°	2.2	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2062.8	93.5
0°-40°	2161.7	98.0
0°-60°	2204.0	99.9
0°-90°	2206.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2206.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	7095	7095	7095	7095	7095	
5°	6865	6858	6857	6871	6865	624
15°	3762	3716	3741	3729	3722	1007
25°	884	918	997	894	866	423
35°	148	152	142	141	119	101
45°	39	48	48	48	39	28
55°	6	7	12	7	7	6
65°	2	2	2	2	2	2
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P763095

CATALOG NUMBER: LD6D25D010-EU6DR3020359024-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	7094.6	7094.6	7094.6	7094.6	7094.6
2.5°	7047.6	7042.7	7045.5	7049.0	7050.3
5°	6864.7	6858.0	6856.7	6870.9	6865.0
7.5°	6495.8	6486.4	6472.1	6504.5	6534.8
10°	5877.9	5867.5	5836.5	5851.8	5876.5
12.5°	4965.7	4931.8	4931.2	4979.9	4973.3
15°	3761.5	3716.2	3741.3	3729.1	3722.5
17.5°	2529.5	2512.1	2545.5	2535.4	2491.9
20°	1819.6	1824.2	1887.9	1855.8	1817.2
22.5°	1327.8	1344.1	1419.8	1337.2	1306.9
25°	884.1	917.5	996.9	894.1	865.9
27.5°	543.7	559.0	639.5	536.7	521.4
30°	338.2	330.5	368.5	316.3	294.7
32.5°	221.9	212.1	224.3	201.3	183.9
35°	148.4	151.5	142.1	141.1	119.1
37.5°	92.6	106.6	94.0	100.3	76.6
40°	59.9	77.3	66.5	73.5	56.4
42.5°	49.1	59.6	54.7	58.2	50.1
45°	39.0	48.4	48.4	48.4	39.4
47.5°	21.6	32.4	41.4	33.1	23.0
50°	12.2	16.4	32.0	17.1	12.9
52.5°	8.4	9.4	21.9	9.7	8.7
55°	6.2	6.6	11.9	7.0	6.6
57.5°	4.9	5.2	6.2	5.2	4.9
60°	3.8	3.8	4.5	4.2	3.8
62.5°	2.8	2.8	3.2	2.8	2.8
65°	2.1	2.1	2.1	2.1	2.1
67.5°	1.0	1.4	1.4	1.4	1.4
70°	1.0	0.7	0.7	0.7	1.0
72.5°	0.7	0.3	0.3	0.3	0.3
75°	0.0	0.0	0.3	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)