

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P763339

Luminaire Tested: LD6D25D010-EU6DR4520359024-6LBSQW1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P763339  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D25D010-EU6DR4520359024-6LBSQW1MW  
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2329.6 lumens  
Efficiency: N/A  
Efficacy: 92.8 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P763339

CATALOG NUMBER: LD6D25D010-EU6DR4520359024-6LBSQW1MW

### Luminous Intensity Polar Plot

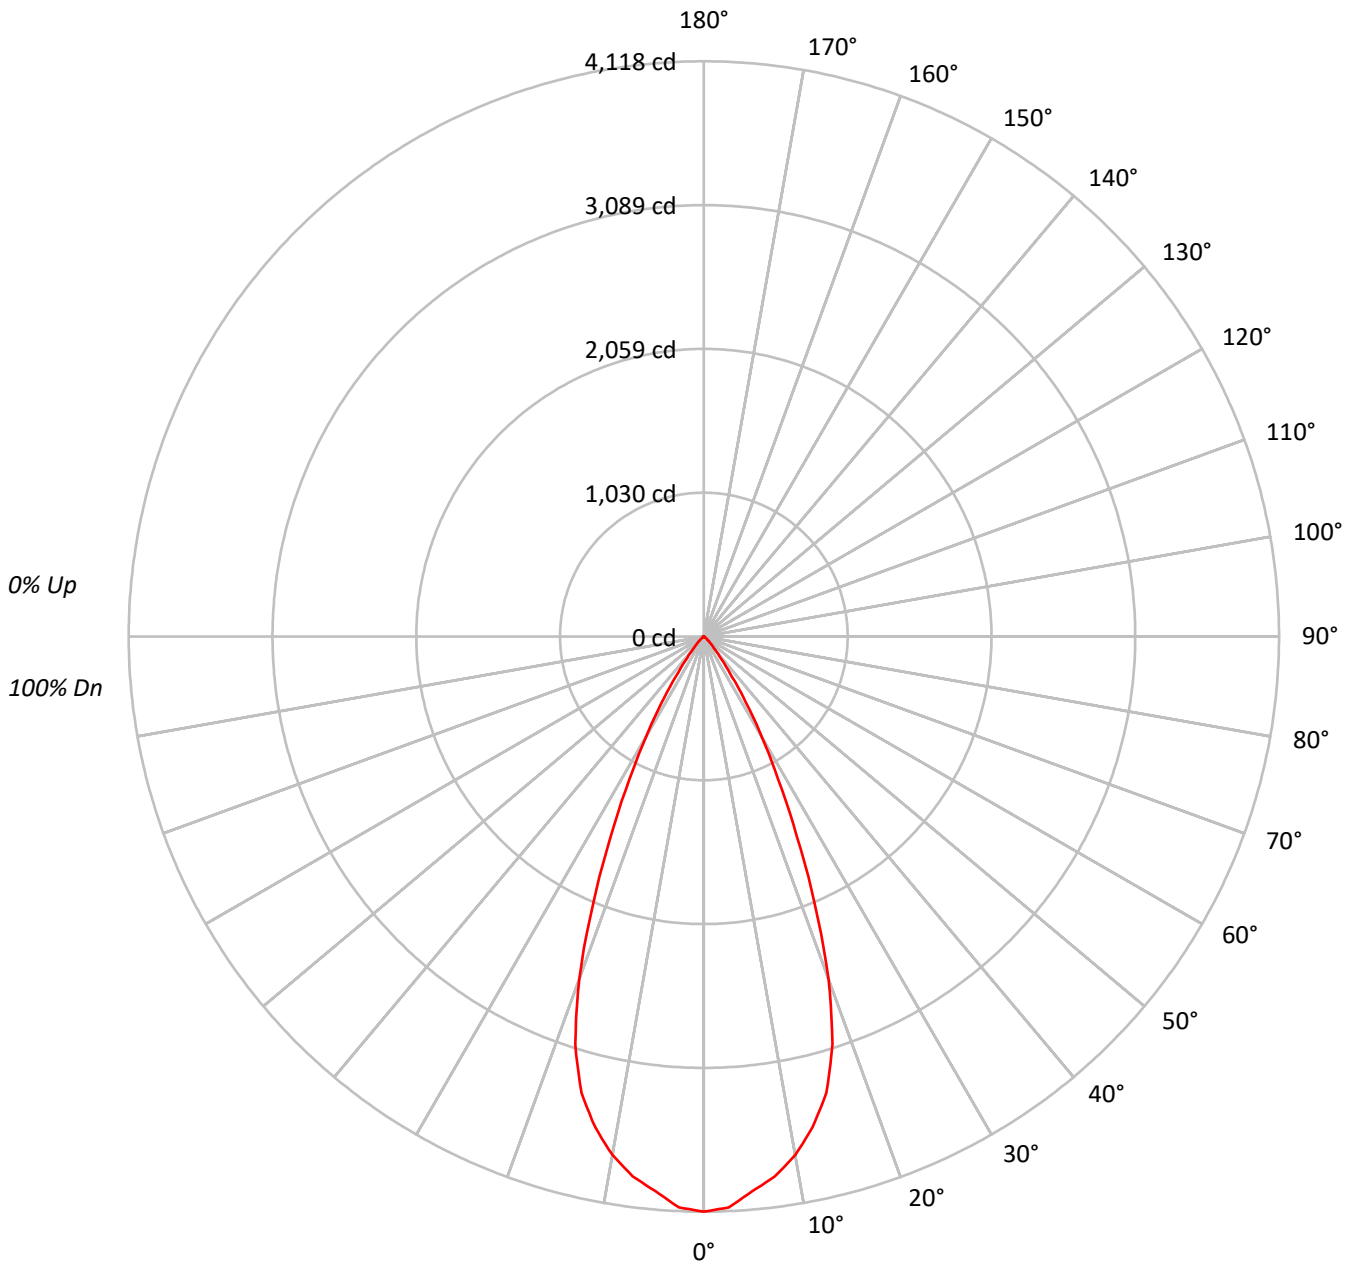



TEST NUMBER: P763339

CATALOG NUMBER: LD6D25D010-EU6DR4520359024-6LBSQW1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	449903
5°	437100
10°	418179
15°	382725
20°	303635
25°	189562
30°	104476
35°	46911
40°	18471
45°	8715
50°	4131
55°	2153
60°	1071
65°	259
70°	96
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 8715 cd/sqm



TEST NUMBER: P763339

CATALOG NUMBER: LD6D25D010-EU6DR4520359024-6LBSQW1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	374.5	16.1
10°-20°	921.6	39.6
20°-30°	729.8	31.3
30°-40°	243.0	10.4
40°-50°	48.2	2.1
50°-60°	10.9	0.5
60°-70°	1.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2025.8	87.0
0°-40°	2268.8	97.4
0°-60°	2328.0	99.9
0°-90°	2329.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2329.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4118	
5°	3985	374
15°	3384	922
25°	1572	730
35°	352	243
45°	56	48
55°	11	11
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P763339

CATALOG NUMBER: LD6D25D010-EU6DR4520359024-6LBSQW1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4117.7
2.5°	4090.8
5°	3985.3
7.5°	3898.1
10°	3769.2
12.5°	3597.6
15°	3383.5
17.5°	3061.6
20°	2611.4
22.5°	2075.1
25°	1572.4
27.5°	1151.3
30°	828.1
32.5°	563.2
35°	351.7
37.5°	208.6
40°	129.5
42.5°	85.2
45°	56.4
47.5°	36.3
50°	24.3
52.5°	16.2
55°	11.3
57.5°	7.4
60°	4.9
62.5°	2.6
65°	1.0
67.5°	0.3
70°	0.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)