

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P763366

Luminaire Tested: LD6D25D010-EU6DR4520359035-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P763366
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D25D010-EU6DR4520359035-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2940.0 lumens
Efficiency: N/A
Efficacy: 117.1 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P763366
CATALOG NUMBER: LD6D25D010-EU6DR4520359035-6LBCSSQMB

Luminous Intensity Polar Plot

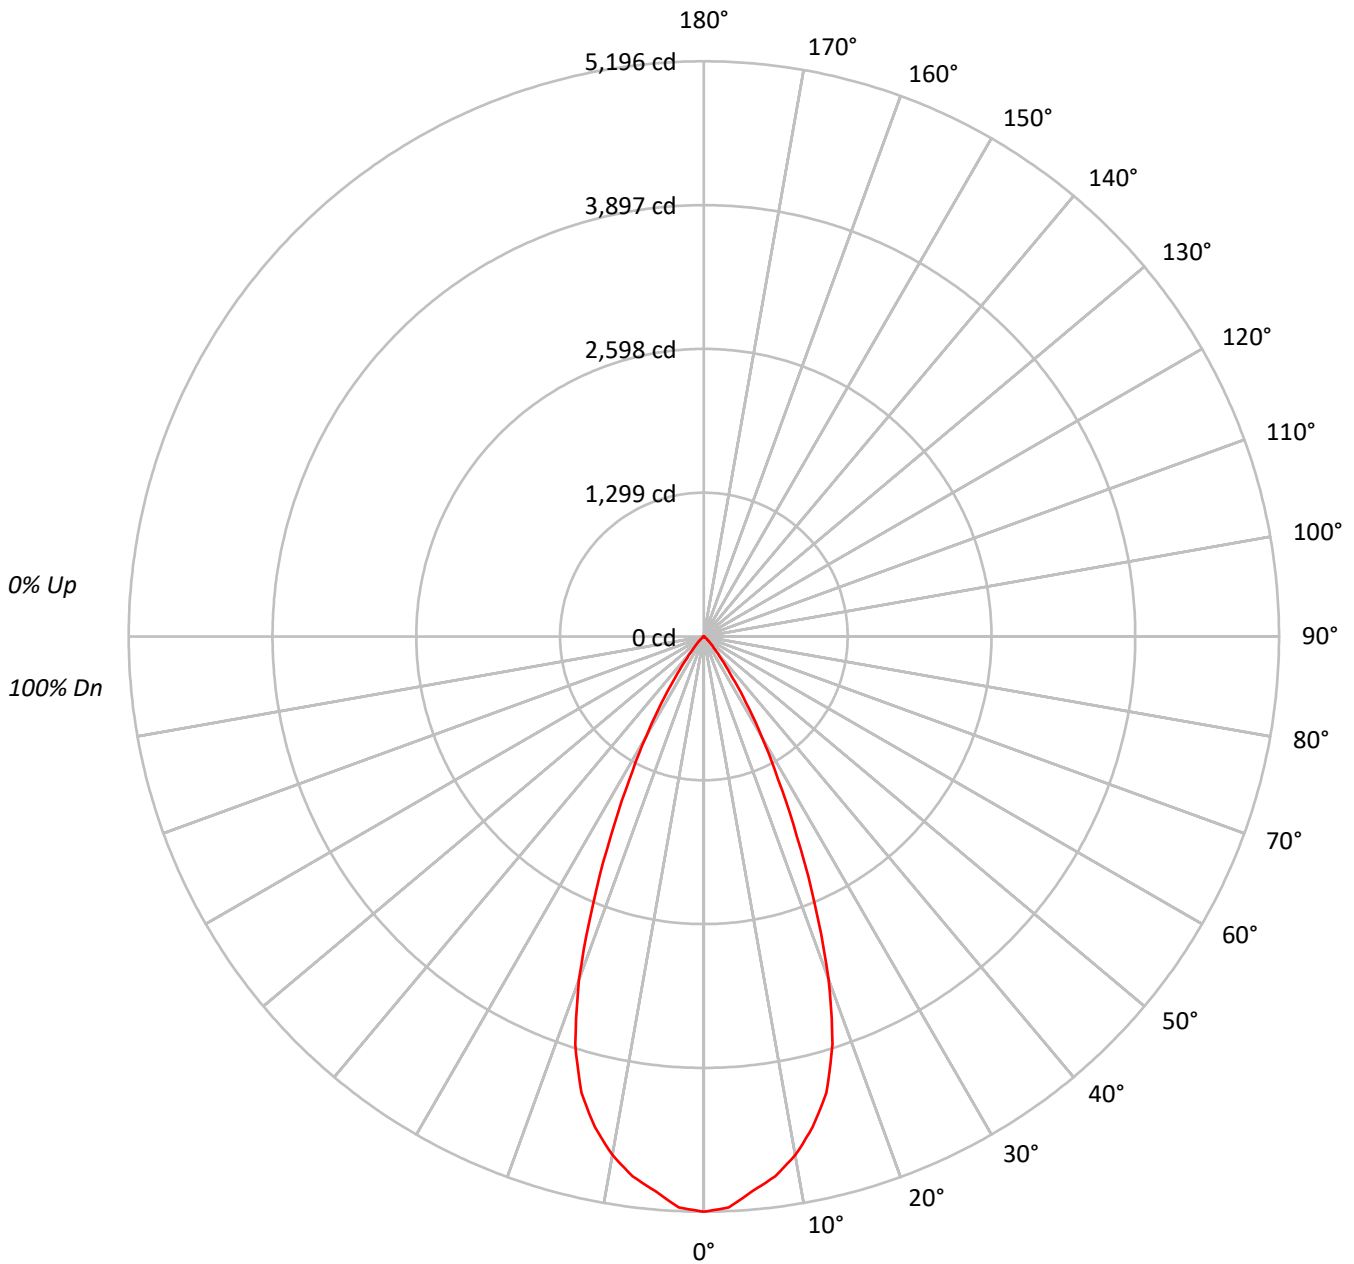



TEST NUMBER: P763366

CATALOG NUMBER: LD6D25D010-EU6DR4520359035-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20		
RC	80				70				50				30				10		0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	0
RCR																			
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	567774
5°	551604
10°	527738
15°	482990
20°	383177
25°	239231
30°	131853
35°	59209
40°	23320
45°	10986
50°	5218
55°	2724
60°	1333
65°	310
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 10986 cd/sqm



TEST NUMBER: P763366

CATALOG NUMBER: LD6D25D010-EU6DR4520359035-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	472.6	16.1
10°-20°	1163.0	39.6
20°-30°	921.0	31.3
30°-40°	306.7	10.4
40°-50°	60.9	2.1
50°-60°	13.8	0.5
60°-70°	2.0	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2556.6	87.0
0°-40°	2863.2	97.4
0°-60°	2938.0	99.9
0°-90°	2940.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2940.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5196	
5°	5029	473
15°	4270	1163
25°	1984	921
35°	444	307
45°	71	61
55°	14	14
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P763366

CATALOG NUMBER: LD6D25D010-EU6DR4520359035-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	5196.5
2.5°	5162.6
5°	5029.3
7.5°	4919.4
10°	4756.7
12.5°	4540.1
15°	4269.9
17.5°	3863.6
20°	3295.5
22.5°	2618.7
25°	1984.4
27.5°	1453.0
30°	1045.1
32.5°	710.7
35°	443.9
37.5°	263.2
40°	163.5
42.5°	107.5
45°	71.1
47.5°	45.8
50°	30.7
52.5°	20.5
55°	14.3
57.5°	9.4
60°	6.1
62.5°	3.3
65°	1.2
67.5°	0.4
70°	0.4
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)