

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P763782

Luminaire Tested: LD6D25D010-EU6DR7020359050-6LBCSSQMB

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P763782  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D25D010-EU6DR7020359050-6LBCSSQMB  
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3018.1 lumens  
Efficiency: N/A  
Efficacy: 120.2 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P763782  
CATALOG NUMBER: LD6D25D010-EU6DR7020359050-6LBCSSQMB

### Luminous Intensity Polar Plot

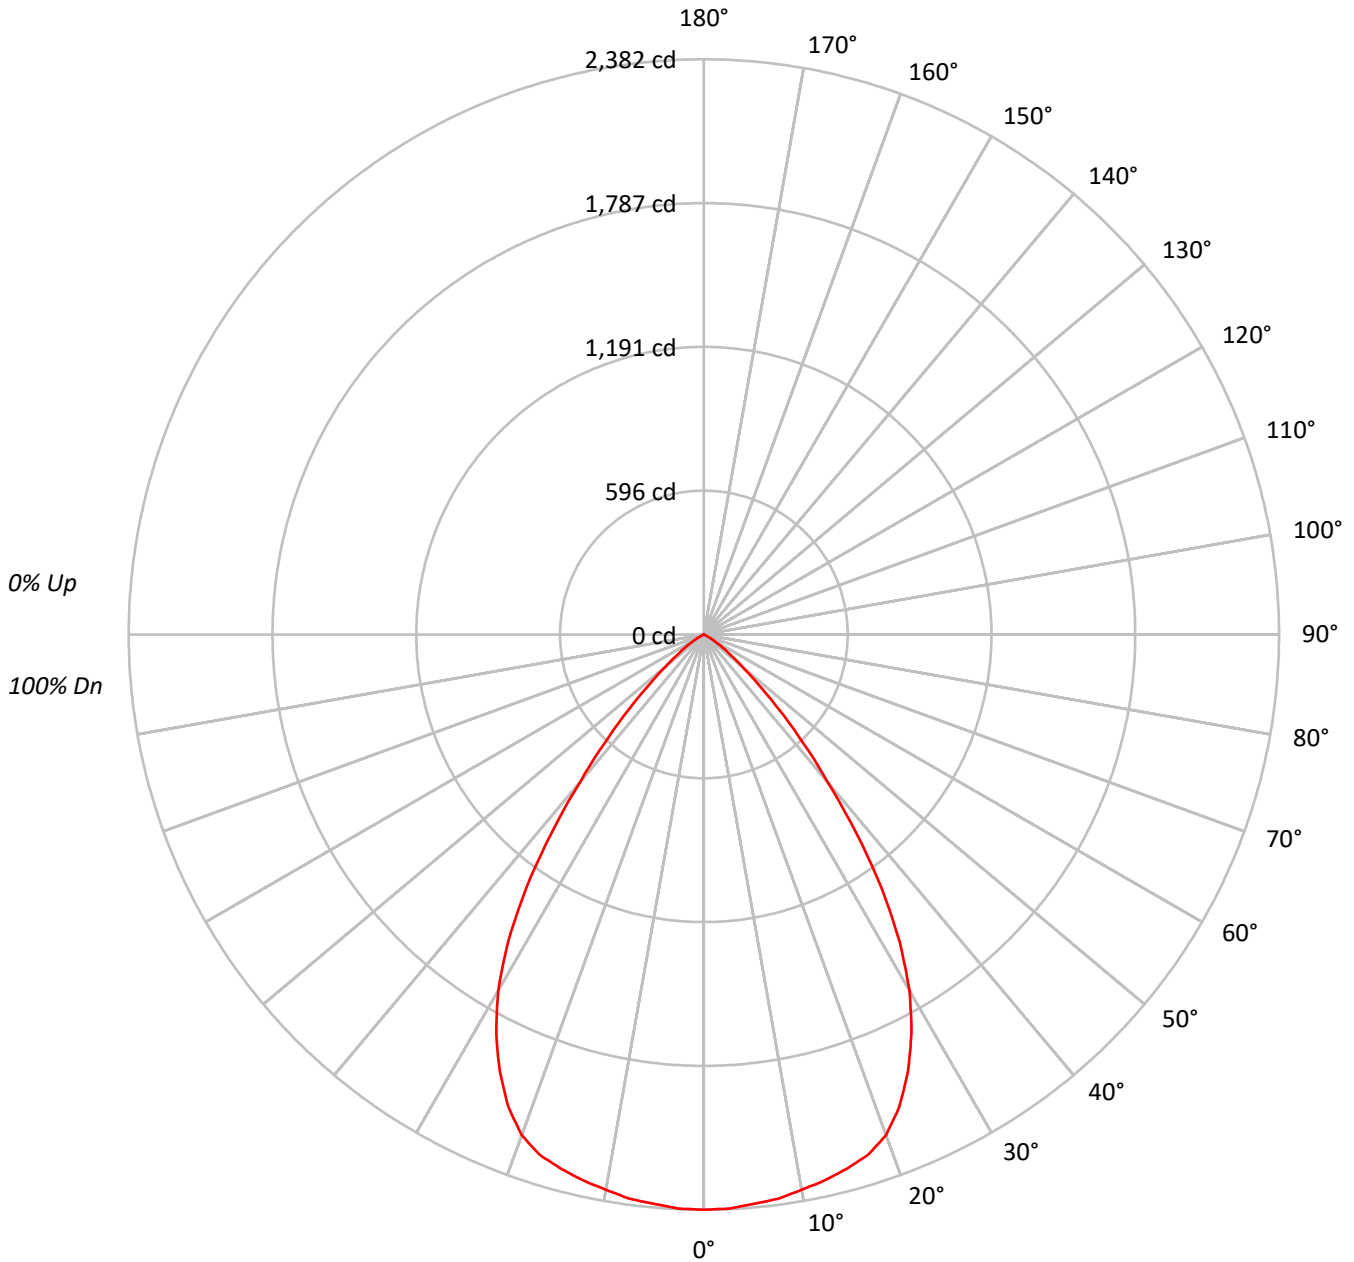



TEST NUMBER: P763782

CATALOG NUMBER: LD6D25D010-EU6DR7020359050-6LBCSSQMB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78																			
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71																			
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65																			
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60																			
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56																			
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51																			
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48																			
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	260270
5°	259619
10°	259060
15°	258988
20°	256451
25°	240907
30°	214768
35°	171237
40°	113704
45°	67972
50°	35254
55°	18516
60°	6556
65°	103
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 67972 cd/sqm



TEST NUMBER: P763782

CATALOG NUMBER: LD6D25D010-EU6DR7020359050-6LBCSSQMB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	225.1	7.5
10°-20°	645.6	21.4
20°-30°	910.8	30.2
30°-40°	786.2	26.1
40°-50°	352.1	11.7
50°-60°	92.2	3.1
60°-70°	6.0	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1781.5	59.0
0°-40°	2567.8	85.1
0°-60°	3012.1	99.8
0°-90°	3018.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3018.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2382	
5°	2367	225
15°	2290	646
25°	1998	911
35°	1284	786
45°	440	352
55°	97	92
65°	0	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P763782  
CATALOG NUMBER: LD6D25D010-EU6DR7020359050-6LBCSSQMB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2382.1
2.5°	2379.6
5°	2367.1
7.5°	2356.8
10°	2335.0
12.5°	2315.3
15°	2289.6
17.5°	2260.1
20°	2205.6
22.5°	2116.1
25°	1998.3
27.5°	1861.7
30°	1702.3
32.5°	1507.4
35°	1283.8
37.5°	1037.0
40°	797.2
42.5°	605.7
45°	439.9
47.5°	303.3
50°	207.4
52.5°	143.1
55°	97.2
57.5°	58.7
60°	30.0
62.5°	9.4
65°	0.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)