

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766865

Luminaire Tested: LD6D45BD010-EU6DR6040509030-6LBCSSQMW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P766865  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D45BD010-EU6DR6040509030-6LBCSSQMW  
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4824.5 lumens  
Efficiency: N/A  
Efficacy: 124.7 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P766865

CATALOG NUMBER: LD6D45BD010-EU6DR6040509030-6LBCSSQMW

### Luminous Intensity Polar Plot

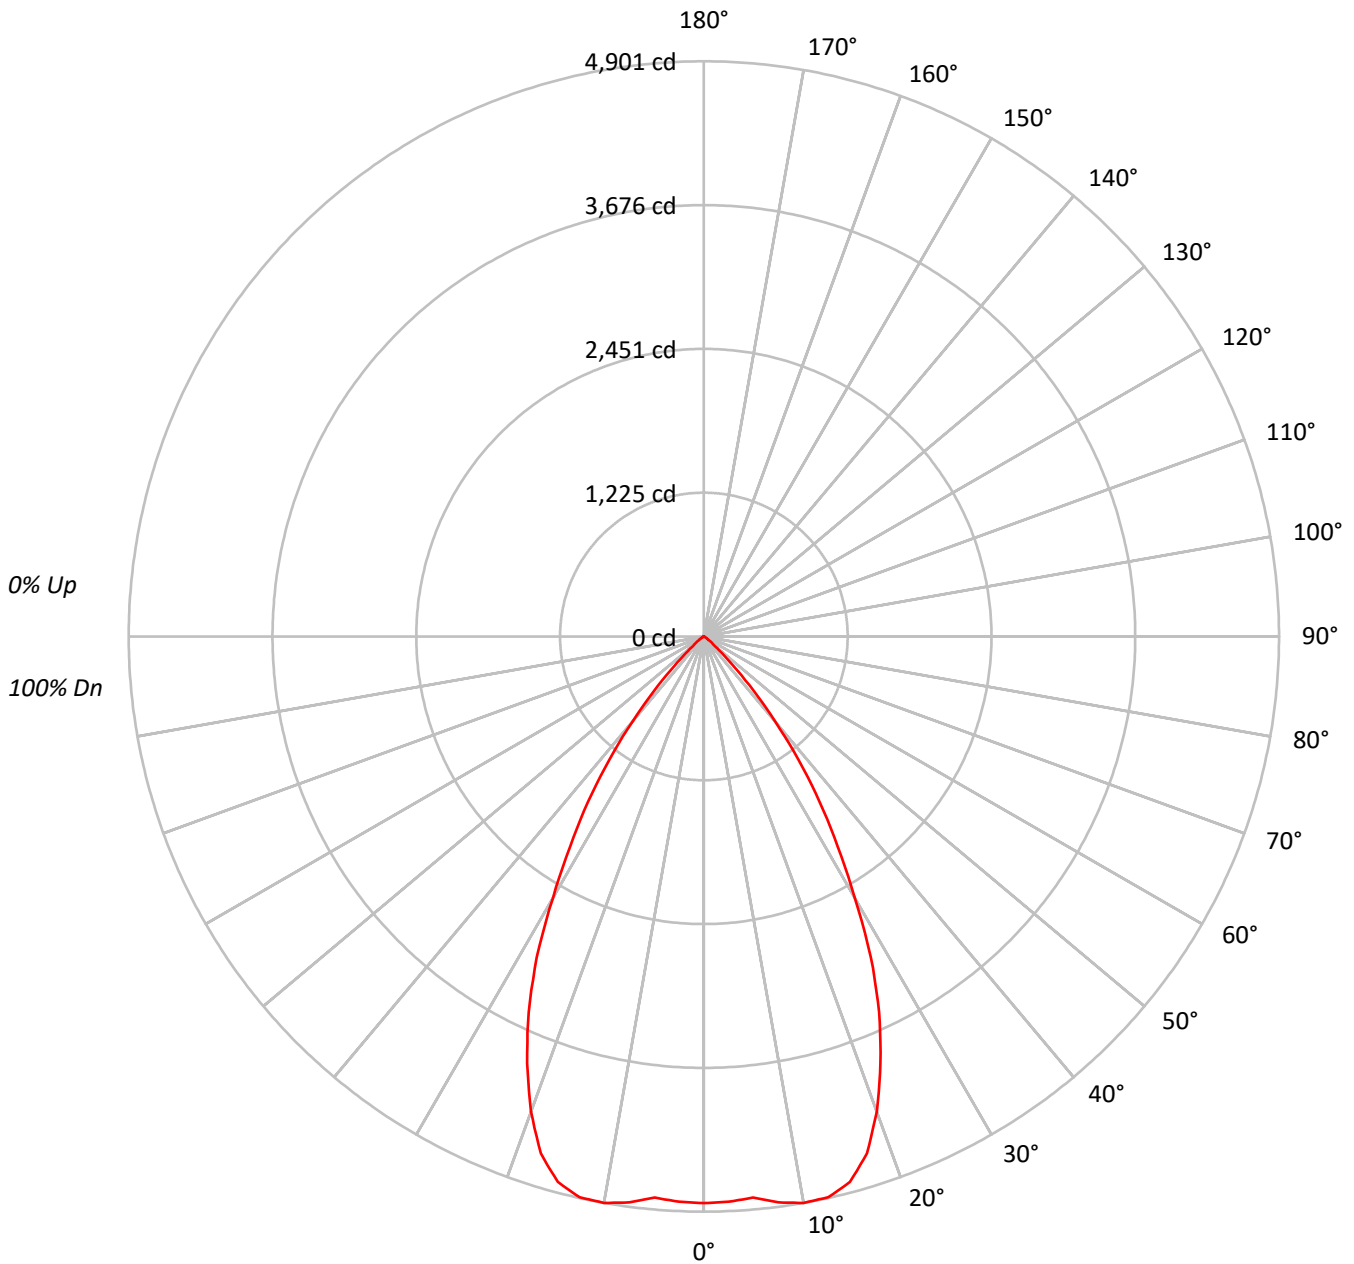



TEST NUMBER: P766865

CATALOG NUMBER: LD6D45BD010-EU6DR6040509030-6LBCSSQMW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75		
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70		
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65		
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61		
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57		
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53		
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50		

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	527511
5°	526225
10°	543703
15°	544264
20°	500776
25°	425948
30°	324555
35°	229512
40°	134771
45°	54390
50°	18154
55°	8744
60°	3584
65°	543
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 54390 cd/sqm



TEST NUMBER: P766865

CATALOG NUMBER: LD6D45BD010-EU6DR6040509030-6LBCSSQMW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	462.8	9.6
10°-20°	1333.0	27.6
20°-30°	1595.4	33.1
30°-40°	1067.1	22.1
40°-50°	316.4	6.6
50°-60°	45.5	0.9
60°-70°	4.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3391.2	70.3
0°-40°	4458.3	92.4
0°-60°	4820.2	99.9
0°-90°	4824.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4824.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4828	
5°	4798	463
15°	4812	1333
25°	3533	1595
35°	1721	1067
45°	352	316
55°	46	45
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P766865

CATALOG NUMBER: LD6D45BD010-EU6DR6040509030-6LBCSSQMW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4828.0
2.5°	4821.9
5°	4797.9
7.5°	4862.9
10°	4900.6
12.5°	4893.8
15°	4811.6
17.5°	4617.8
20°	4306.9
22.5°	3933.8
25°	3533.2
27.5°	3082.0
30°	2572.5
32.5°	2117.9
35°	1720.7
37.5°	1322.9
40°	944.9
42.5°	623.1
45°	352.0
47.5°	180.1
50°	106.8
52.5°	69.2
55°	45.9
57.5°	29.4
60°	16.4
62.5°	6.8
65°	2.1
67.5°	0.7
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)