

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766644

Luminaire Tested: LD6D45BD010-EU6DR4540509035-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P766644
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D45BD010-EU6DR4540509035-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4902.4 lumens
Efficiency: N/A
Efficacy: 126.7 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P766644

CATALOG NUMBER: LD6D45BD010-EU6DR4540509035-6LBCSSQMW

Luminous Intensity Polar Plot

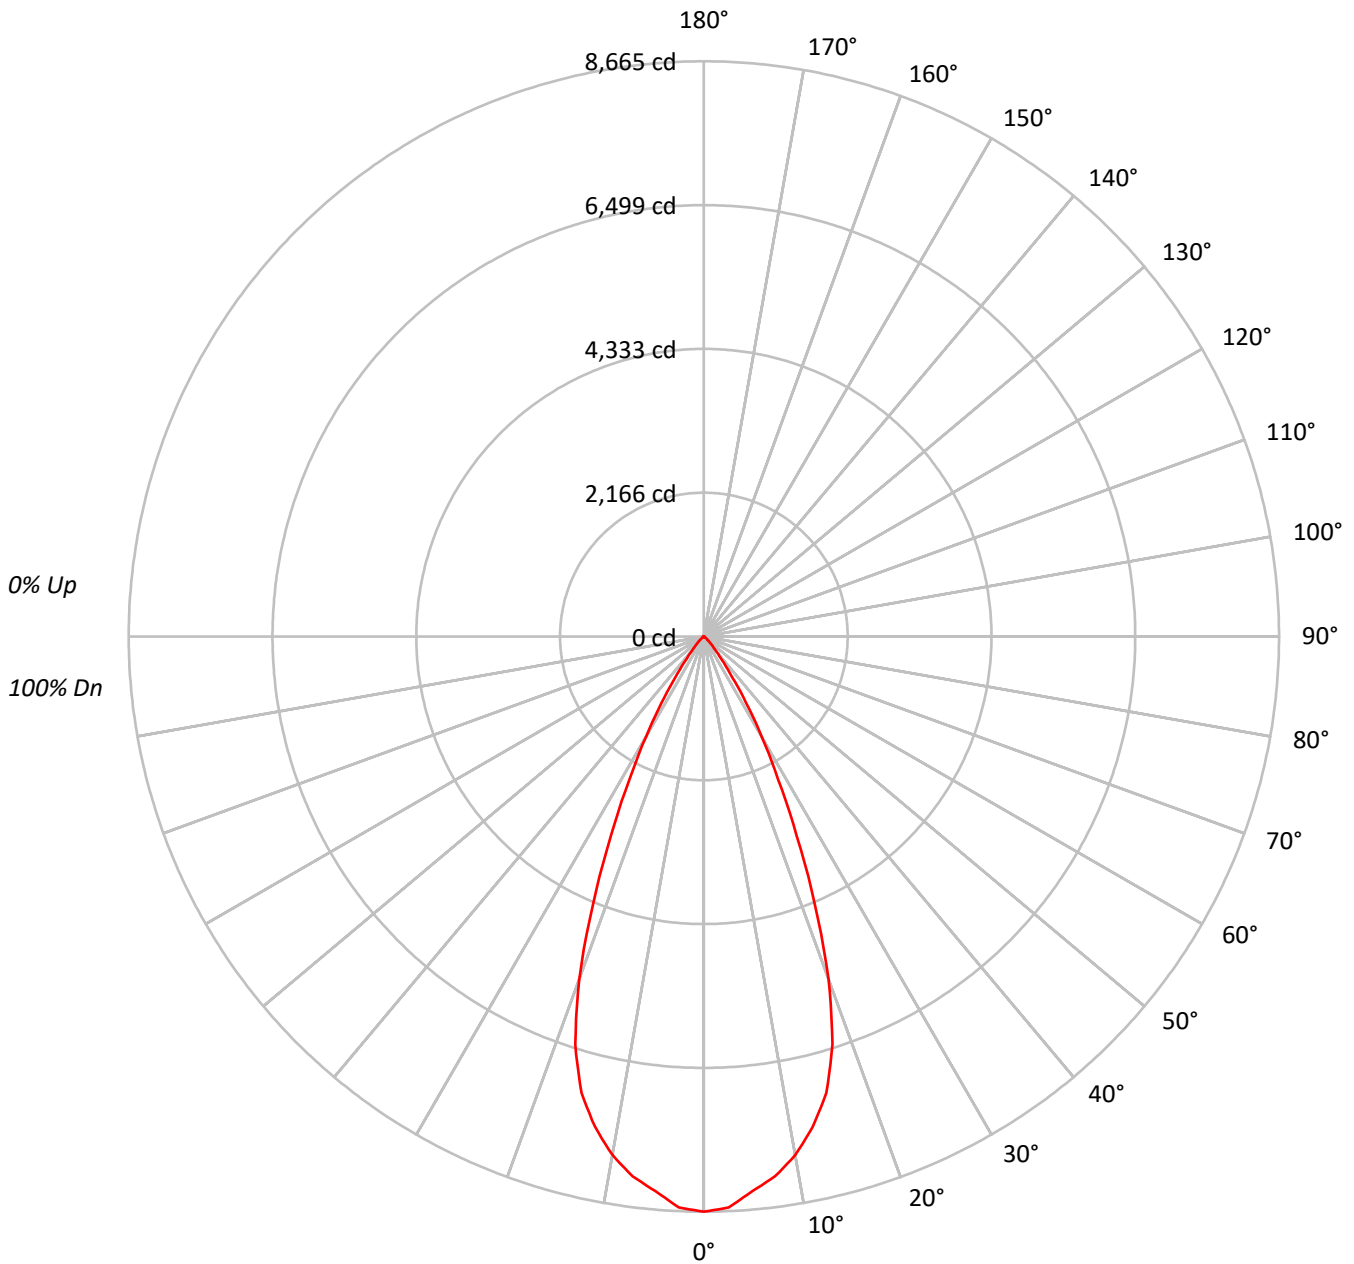



TEST NUMBER: P766644

CATALOG NUMBER: LD6D45BD010-EU6DR4540509035-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	946755
5°	919805
10°	880004
15°	805391
20°	638954
25°	398907
30°	219865
35°	98730
40°	38881
45°	18326
50°	8686
55°	4553
60°	2229
65°	517
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18326 cd/sqm



TEST NUMBER: P766644

CATALOG NUMBER: LD6D45BD010-EU6DR4540509035-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	788.0	16.1
10°-20°	1939.3	39.6
20°-30°	1535.7	31.3
30°-40°	511.4	10.4
40°-50°	101.5	2.1
50°-60°	23.1	0.5
60°-70°	3.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4263.0	87.0
0°-40°	4774.5	97.4
0°-60°	4899.0	99.9
0°-90°	4902.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4902.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8665	
5°	8386	788
15°	7120	1939
25°	3309	1536
35°	740	511
45°	119	101
55°	24	23
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P766644

CATALOG NUMBER: LD6D45BD010-EU6DR4540509035-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

0°	
0°	8665.1
2.5°	8608.6
5°	8386.4
7.5°	8203.0
10°	7931.8
12.5°	7570.6
15°	7120.1
17.5°	6442.6
20°	5495.3
22.5°	4366.6
25°	3308.9
27.5°	2422.9
30°	1742.7
32.5°	1185.2
35°	740.2
37.5°	438.9
40°	272.6
42.5°	179.2
45°	118.6
47.5°	76.3
50°	51.1
52.5°	34.1
55°	23.9
57.5°	15.7
60°	10.2
62.5°	5.5
65°	2.0
67.5°	0.7
70°	0.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)