

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P767460

Luminaire Tested: LD6D50D010-EU6DR4540509050-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P767460
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D50D010-EU6DR4540509050-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5777.7 lumens
Efficiency: N/A
Efficacy: 122.9 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P767460

CATALOG NUMBER: LD6D50D010-EU6DR4540509050-6LBSQW1MW

Luminous Intensity Polar Plot

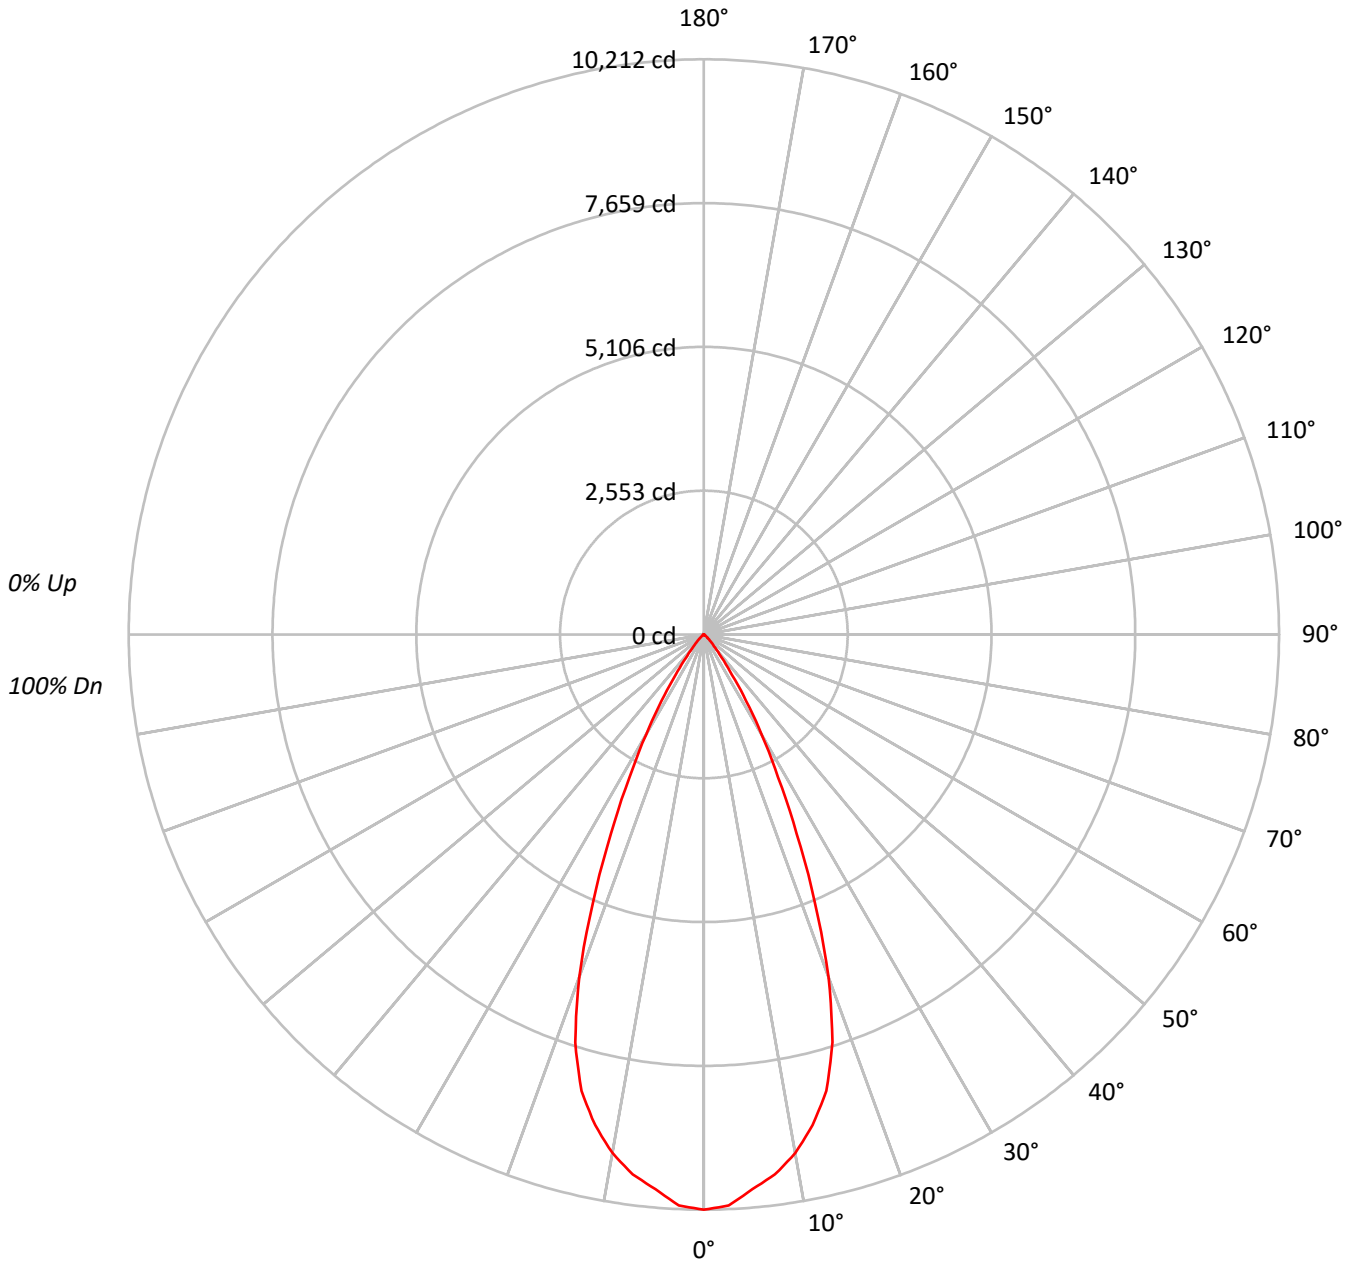



TEST NUMBER: P767460

CATALOG NUMBER: LD6D50D010-EU6DR4540509050-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90	90	90	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73	73	73	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66	66	66	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63	63	63	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60	60	60	60

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1115793
5°	1084026
10°	1037126
15°	949182
20°	753030
25°	470132
30°	259127
35°	116350
40°	45827
45°	21602
50°	10233
55°	5353
60°	2622
65°	620
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21602 cd/sqm



TEST NUMBER: P767460

CATALOG NUMBER: LD6D50D010-EU6DR4540509050-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	928.7	16.1
10°-20°	2285.6	39.6
20°-30°	1810.0	31.3
30°-40°	602.7	10.4
40°-50°	119.6	2.1
50°-60°	27.2	0.5
60°-70°	3.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5024.2	87.0
0°-40°	5626.9	97.4
0°-60°	5773.7	99.9
0°-90°	5777.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5777.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10212	
5°	9884	929
15°	8391	2286
25°	3900	1810
35°	872	603
45°	140	120
55°	28	27
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P767460

CATALOG NUMBER: LD6D50D010-EU6DR4540509050-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	10212.2
2.5°	10145.6
5°	9883.7
7.5°	9667.6
10°	9348.0
12.5°	8922.2
15°	8391.3
17.5°	7592.9
20°	6476.4
22.5°	5146.3
25°	3899.7
27.5°	2855.5
30°	2053.9
32.5°	1396.8
35°	872.3
37.5°	517.3
40°	321.3
42.5°	211.2
45°	139.8
47.5°	90.0
50°	60.2
52.5°	40.2
55°	28.1
57.5°	18.5
60°	12.0
62.5°	6.4
65°	2.4
67.5°	0.8
70°	0.8
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)