

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P769293

Luminaire Tested: LD6D60D010-EU6DR6555659030-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P769293
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D60D010-EU6DR6555659030-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5644.2 lumens
Efficiency: N/A
Efficacy: 87.6 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P769293

CATALOG NUMBER: LD6D60D010-EU6DR6555659030-6LBSQW1MW

Luminous Intensity Polar Plot

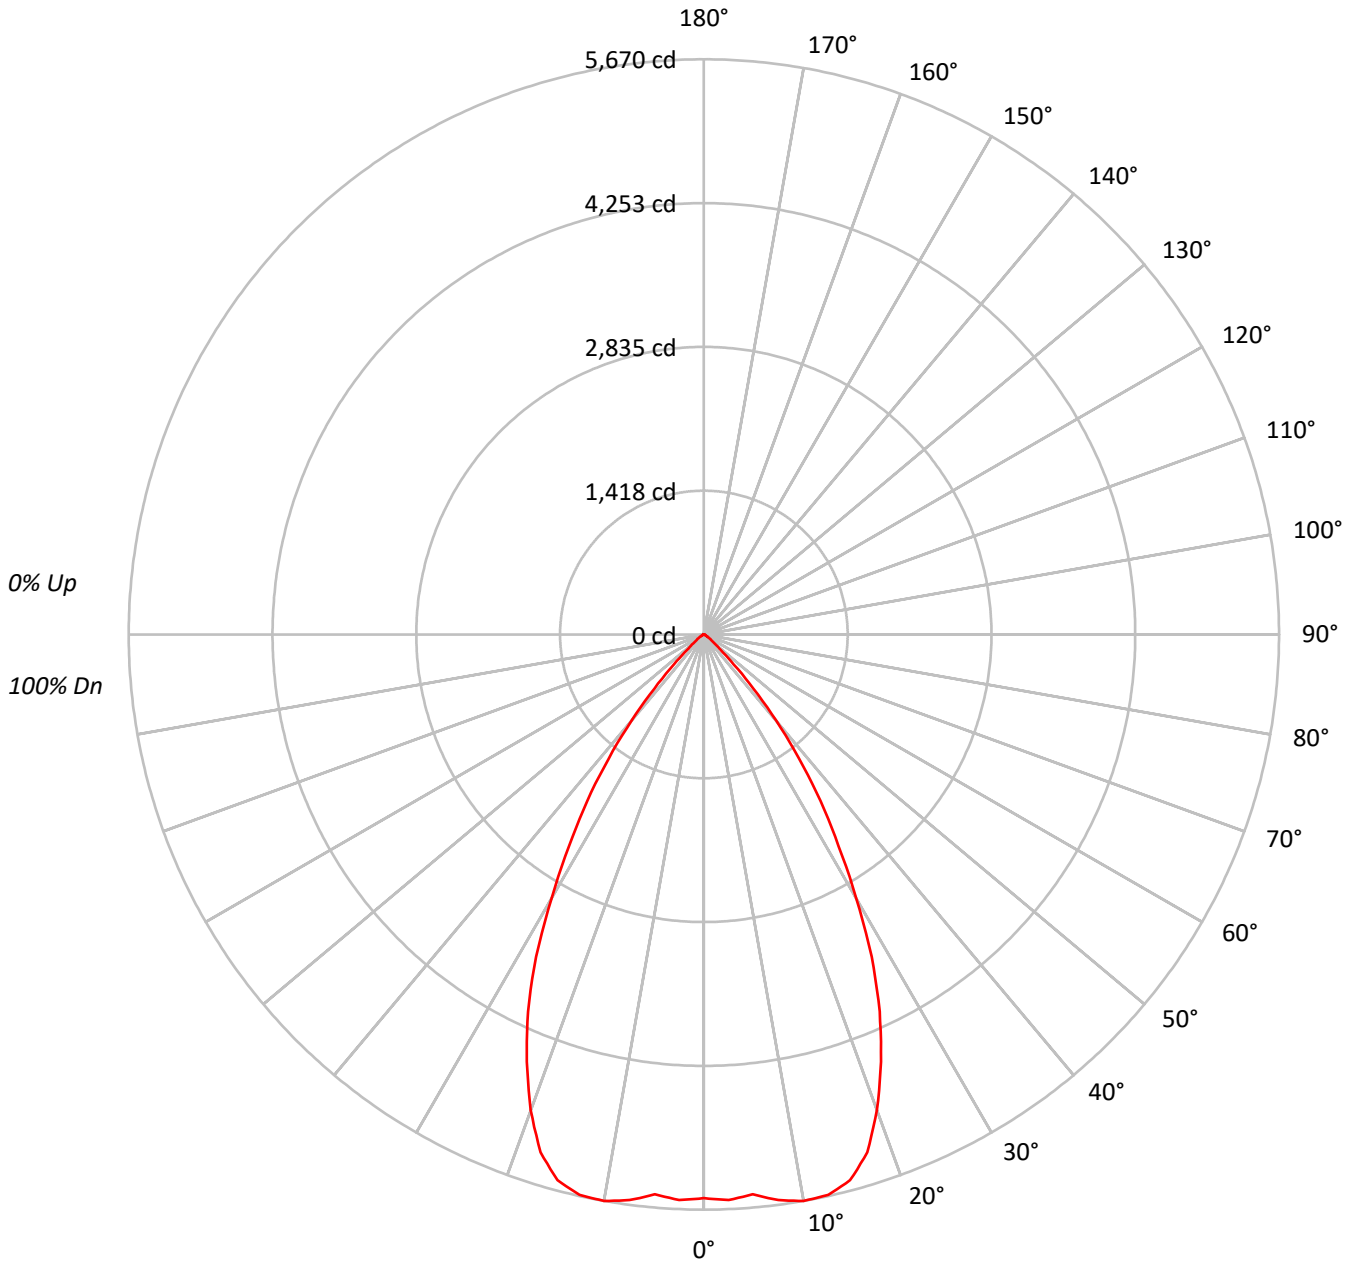



TEST NUMBER: P769293

CATALOG NUMBER: LD6D60D010-EU6DR6555659030-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	607173
5°	607672
10°	629065
15°	630107
20°	580120
25°	494291
30°	378402
35°	267326
40°	157806
45°	64063
50°	23219
55°	12934
60°	7430
65°	4085
70°	4281
75°	3335
80°	3461
85°	3009

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 64063 cd/sqm



TEST NUMBER: P769293

CATALOG NUMBER: LD6D60D010-EU6DR6555659030-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	535.1	9.5
10°-20°	1543.5	27.3
20°-30°	1851.9	32.8
30°-40°	1244.5	22.1
40°-50°	372.6	6.6
50°-60°	65.8	1.2
60°-70°	18.7	0.3
70°-80°	9.2	0.2
80°-90°	2.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3930.6	69.6
0°-40°	5175.1	91.7
0°-60°	5613.4	99.5
0°-90°	5644.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5644.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5557	
5°	5540	535
15°	5570	1544
25°	4100	1852
35°	2004	1245
45°	415	373
55°	68	66
65°	16	19
75°	8	9
85°	2	3
90°	0	



TEST NUMBER: P769293

CATALOG NUMBER: LD6D60D010-EU6DR6555659030-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	5557.1
2.5°	5580.8
5°	5540.5
7.5°	5624.2
10°	5670.0
12.5°	5658.9
15°	5570.5
17.5°	5354.1
20°	4989.3
22.5°	4559.7
25°	4100.1
27.5°	3581.3
30°	2999.3
32.5°	2471.7
35°	2004.2
37.5°	1542.3
40°	1106.4
42.5°	722.6
45°	414.6
47.5°	219.5
50°	136.6
52.5°	94.8
55°	67.9
57.5°	49.0
60°	34.0
62.5°	22.1
65°	15.8
67.5°	14.2
70°	13.4
72.5°	10.3
75°	7.9
77.5°	7.1
80°	5.5
82.5°	3.9
85°	2.4
87.5°	1.6
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)