

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P769320

Luminaire Tested: LD6D60D010-EU6DR6555659050-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P769320
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D60D010-EU6DR6555659050-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6712.1 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P769320
CATALOG NUMBER: LD6D60D010-EU6DR6555659050-6LBCSSQMB

Luminous Intensity Polar Plot

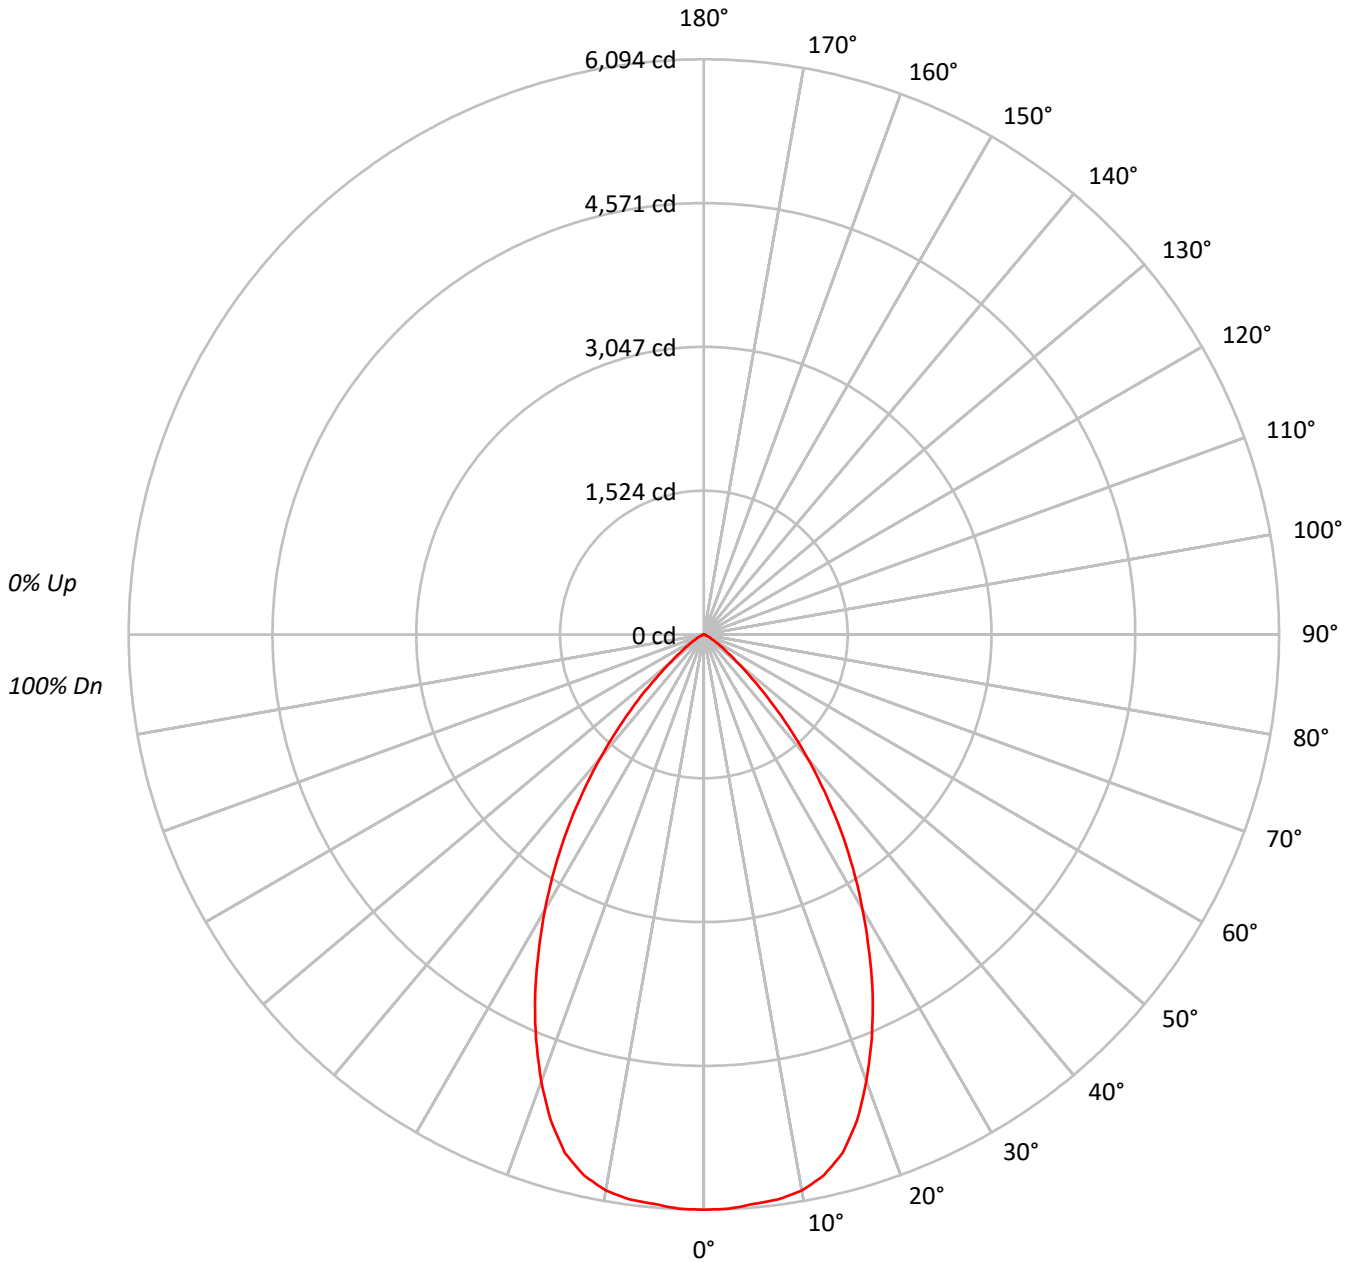



TEST NUMBER: P769320
 CATALOG NUMBER: LD6D60D010-EU6DR6555659050-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93		
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85		
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78		
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72		
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66		
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61		
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56		
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52		
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49		
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	355937
5°	355039
10°	354732
15°	343799
20°	312986
25°	272749
30°	226851
35°	179742
40°	129731
45°	81960
50°	42723
55°	22707
60°	11926
65°	6564
70°	2749
75°	3024
80°	2119
85°	1809

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 81960 cd/sqm



TEST NUMBER: P769320

CATALOG NUMBER: LD6D60D010-EU6DR6555659050-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	576.3	8.6
10°-20°	1578.2	23.5
20°-30°	1929.1	28.7
30°-40°	1565.2	23.3
40°-50°	780.0	11.6
50°-60°	217.6	3.2
60°-70°	49.5	0.7
70°-80°	12.9	0.2
80°-90°	3.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4083.7	60.8
0°-40°	5648.9	84.2
0°-60°	6646.5	99.0
0°-90°	6712.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6712.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6094	
5°	6056	576
15°	5686	1578
25°	4232	1929
35°	2521	1565
45°	992	780
55°	223	218
65°	48	49
75°	13	13
85°	3	3
90°	0	



TEST NUMBER: P769320
CATALOG NUMBER: LD6D60D010-EU6DR6555659050-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	6094.4
2.5°	6089.9
5°	6055.9
7.5°	6036.2
10°	5981.5
12.5°	5870.5
15°	5686.0
17.5°	5397.6
20°	5035.8
22.5°	4645.3
25°	4232.5
27.5°	3791.0
30°	3363.8
32.5°	2942.0
35°	2521.0
37.5°	2101.0
40°	1701.6
42.5°	1327.2
45°	992.3
47.5°	691.4
50°	470.2
52.5°	324.2
55°	223.0
57.5°	150.5
60°	102.1
62.5°	70.8
65°	47.5
67.5°	24.2
70°	16.1
72.5°	15.2
75°	13.4
77.5°	9.0
80°	6.3
82.5°	4.5
85°	2.7
87.5°	1.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)