

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770436

Luminaire Tested: LD6D70BD010-EU6DR4070959024-6LBSQW1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770436
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR4070959024-6LBSQW1B
Description: 6 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6168.8 lumens
Efficiency: N/A
Efficacy: 92.6 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P770436
CATALOG NUMBER: LD6D70BD010-EU6DR4070959024-6LBSQW1B

Luminous Intensity Polar Plot

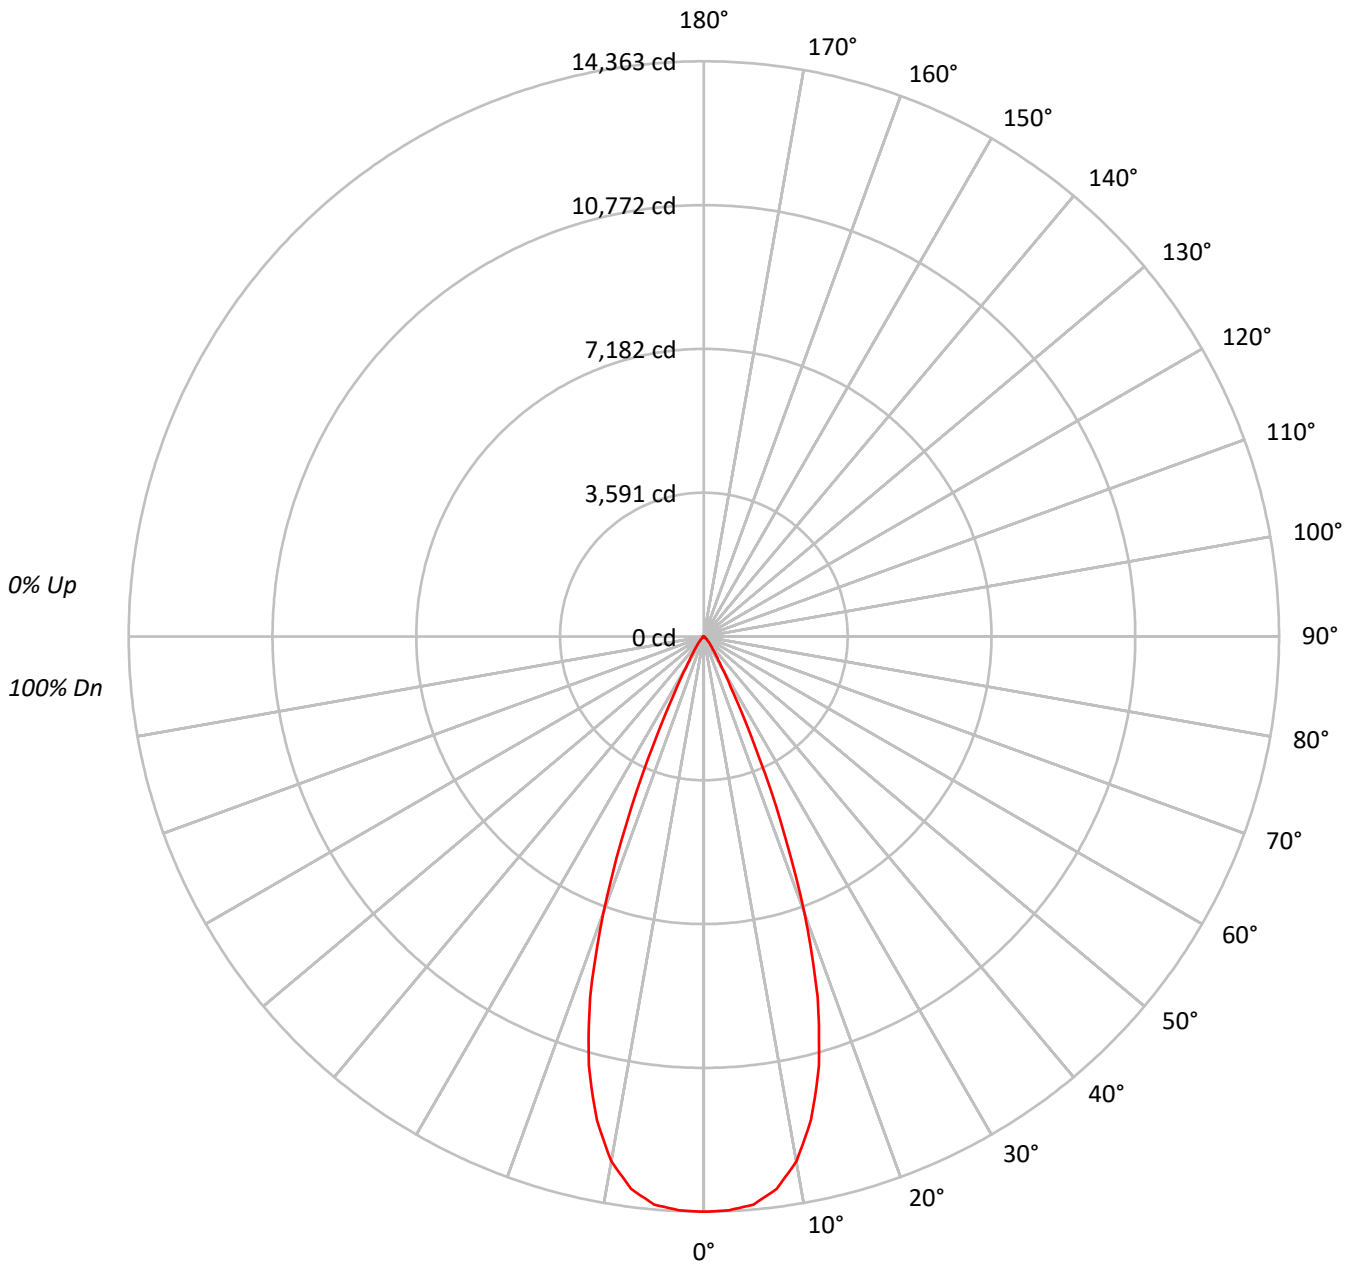



TEST NUMBER: P770436
 CATALOG NUMBER: LD6D70BD010-EU6DR4070959024-6LBSQW1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96	96	96	96
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92	92	92	92
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88	88	88	88
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84	84	84	84
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81	81	81	81
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77	77	77	77
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74	74	74	74
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72	72	72	72
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69	69	69	69
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67	67	67	67

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1569279
5°	1561652
10°	1476107
15°	1254876
20°	855292
25°	356858
30°	112210
35°	52153
40°	28840
45°	13227
50°	6425
55°	3524
60°	1836
65°	646
70°	256
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 13227 cd/sqm



TEST NUMBER: P770436

CATALOG NUMBER: LD6D70BD010-EU6DR4070959024-6LBSQW1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1329.5	21.6
10°-20°	2978.5	48.3
20°-30°	1490.9	24.2
30°-40°	273.3	4.4
40°-50°	75.4	1.2
50°-60°	17.7	0.3
60°-70°	3.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5798.9	94.0
0°-40°	6072.2	98.4
0°-60°	6165.3	99.9
0°-90°	6168.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6168.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14363	
5°	14238	###
15°	11094	2978
25°	2960	1491
35°	391	273
45°	86	75
55°	18	18
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P770436

CATALOG NUMBER: LD6D70BD010-EU6DR4070959024-6LBSQW1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	14362.7
2.5°	14341.7
5°	14238.5
7.5°	13909.6
10°	13304.7
12.5°	12361.6
15°	11093.8
17.5°	9445.1
20°	7355.9
22.5°	5014.9
25°	2960.1
27.5°	1564.8
30°	889.4
32.5°	574.7
35°	391.0
37.5°	279.4
40°	202.2
42.5°	138.4
45°	85.6
47.5°	54.5
50°	37.8
52.5°	26.8
55°	18.5
57.5°	11.7
60°	8.4
62.5°	5.0
65°	2.5
67.5°	1.7
70°	0.8
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)