

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770581

Luminaire Tested: LD6D70BD010-EU6DR5070959024-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770581
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR5070959024-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6928.1 lumens
Efficiency: N/A
Efficacy: 104.0 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P770581

CATALOG NUMBER: LD6D70BD010-EU6DR5070959024-6LBCSSQMB

Luminous Intensity Polar Plot

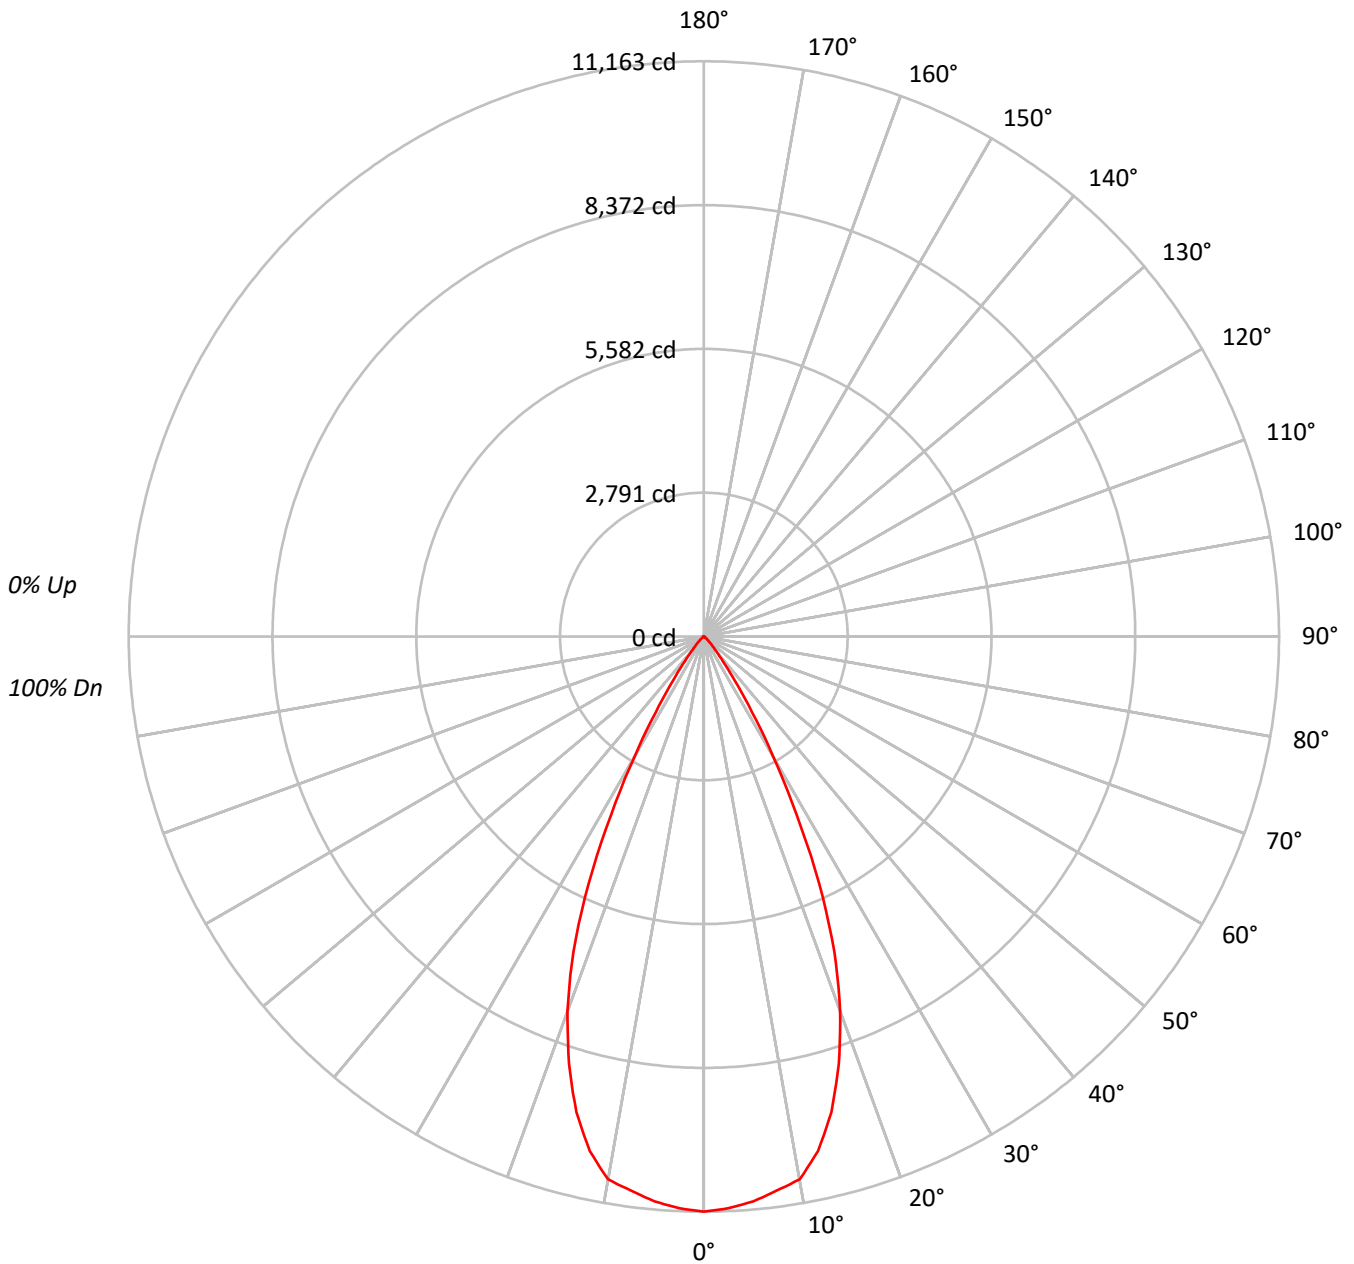



TEST NUMBER: P770581

CATALOG NUMBER: LD6D70BD010-EU6DR5070959024-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1219656
5°	1206876
10°	1187003
15°	1080860
20°	899394
25°	638440
30°	337929
35°	137704
40°	51147
45°	23409
50°	9604
55°	5029
60°	2469
65°	724
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 23409 cd/sqm



TEST NUMBER: P770581

CATALOG NUMBER: LD6D70BD010-EU6DR5070959024-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1040.1	15.0
10°-20°	2628.5	37.9
20°-30°	2361.1	34.1
30°-40°	739.2	10.7
40°-50°	129.4	1.9
50°-60°	25.8	0.4
60°-70°	3.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6029.7	87.0
0°-40°	6768.9	97.7
0°-60°	6924.2	99.9
0°-90°	6928.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6928.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11163	
5°	11004	###
15°	9555	2629
25°	5296	2361
35°	1032	739
45°	152	129
55°	26	26
65°	3	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P770581

CATALOG NUMBER: LD6D70BD010-EU6DR5070959024-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	11162.8
2.5°	11107.3
5°	11003.8
7.5°	10845.7
10°	10698.9
12.5°	10228.3
15°	9555.4
17.5°	8700.8
20°	7735.2
22.5°	6618.1
25°	5295.8
27.5°	3893.5
30°	2678.5
32.5°	1743.9
35°	1032.4
37.5°	592.9
40°	358.6
42.5°	233.4
45°	151.5
47.5°	92.2
50°	56.5
52.5°	38.6
55°	26.4
57.5°	17.9
60°	11.3
62.5°	6.6
65°	2.8
67.5°	0.9
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)