

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770775

Luminaire Tested: LD6D70BD010-EU6DR6070959030-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P770775
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR6070959030-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7276.2 lumens
Efficiency: N/A
Efficacy: 109.3 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P770775
CATALOG NUMBER: LD6D70BD010-EU6DR6070959030-6LBSQW1MW

Luminous Intensity Polar Plot

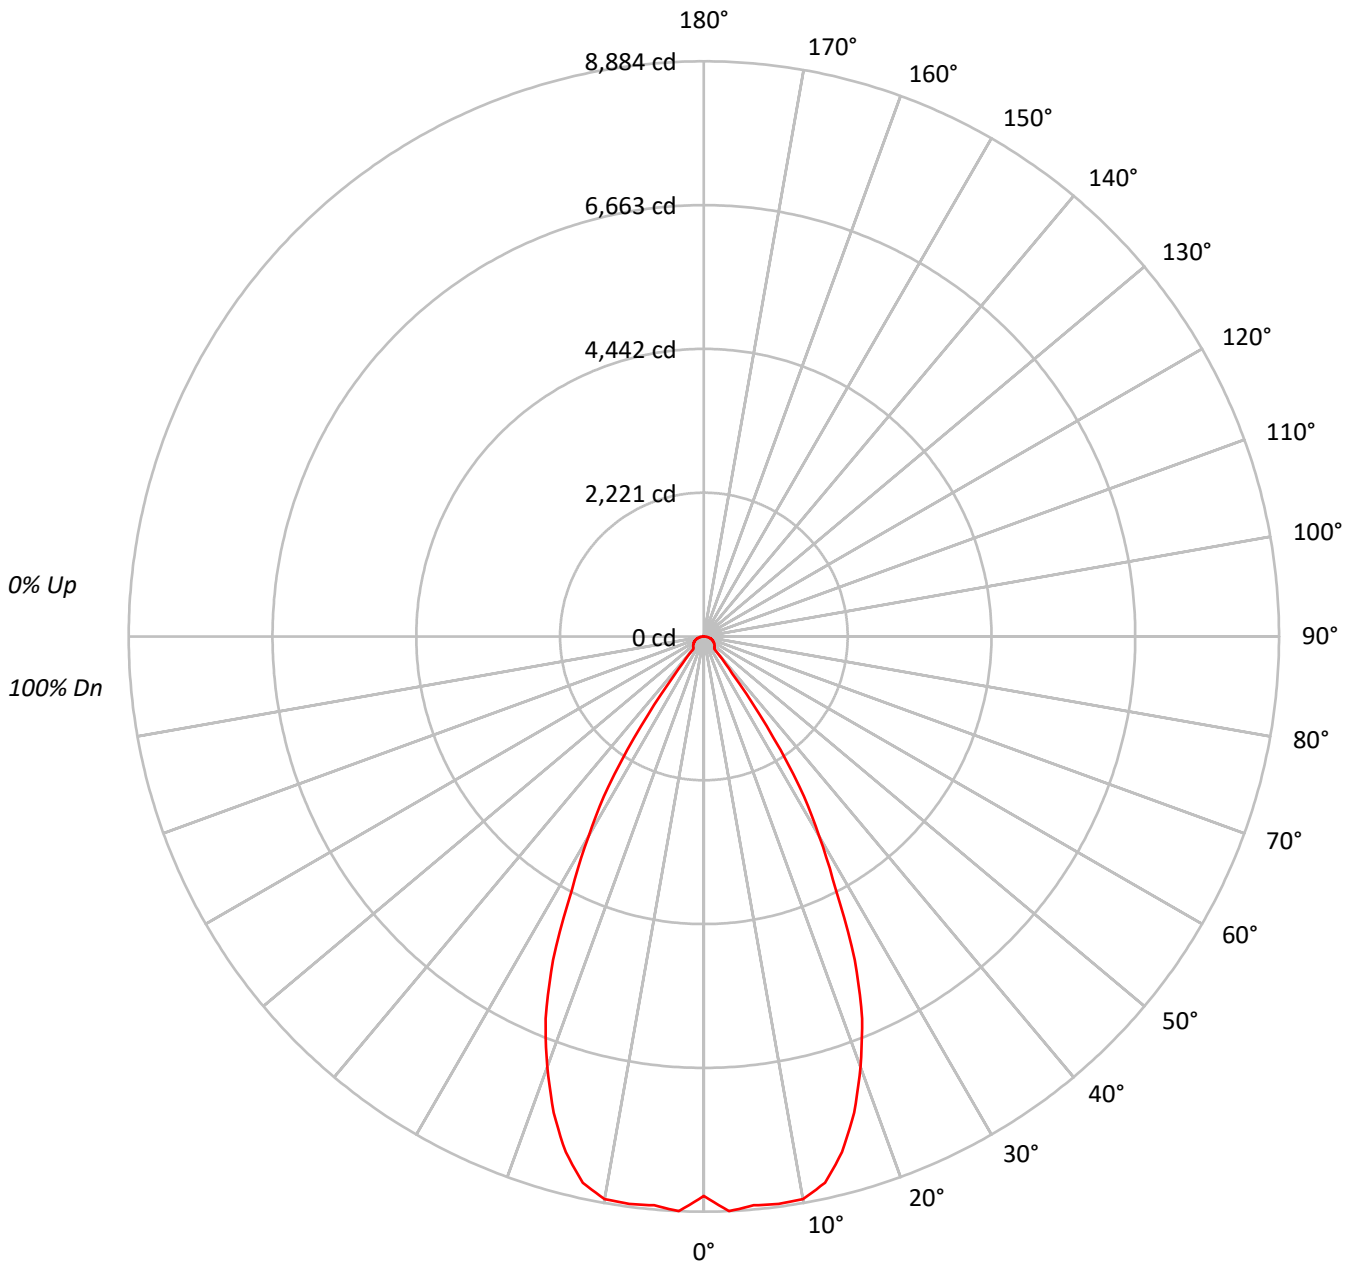



TEST NUMBER: P770775

CATALOG NUMBER: LD6D70BD010-EU6DR6070959030-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	944166
5°	967383
10°	979068
15°	932690
20°	822351
25°	665131
30°	449911
35°	225457
40°	36570
45°	35802
50°	36512
55°	37069
60°	38088
65°	38961
70°	39868
75°	40358
80°	38948
85°	32469

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 40358 cd/sqm



TEST NUMBER: P770775

CATALOG NUMBER: LD6D70BD010-EU6DR6070959030-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	843.0	11.6
10°-20°	2280.8	31.3
20°-30°	2453.9	33.7
30°-40°	1066.7	14.7
40°-50°	179.2	2.5
50°-60°	174.2	2.4
60°-70°	149.0	2.0
70°-80°	99.7	1.4
80°-90°	29.9	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5577.7	76.7
0°-40°	6644.3	91.3
0°-60°	6997.7	96.2
0°-90°	7276.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7276.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8641	
5°	8820	843
15°	8246	2281
25°	5517	2454
35°	1690	1067
45°	232	179
55°	195	174
65°	151	149
75°	96	100
85°	26	30
90°	0	



TEST NUMBER: P770775

CATALOG NUMBER: LD6D70BD010-EU6DR6070959030-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	8641.4
2.5°	8884.3
5°	8820.2
7.5°	8840.4
10°	8824.7
12.5°	8642.5
15°	8245.5
17.5°	7712.5
20°	7072.6
22.5°	6387.7
25°	5517.2
27.5°	4412.9
30°	3566.1
32.5°	2748.5
35°	1690.3
37.5°	723.1
40°	256.4
42.5°	236.2
45°	231.7
47.5°	223.8
50°	214.8
52.5°	204.7
55°	194.6
57.5°	184.4
60°	174.3
62.5°	163.1
65°	150.7
67.5°	138.3
70°	124.8
72.5°	110.2
75°	95.6
77.5°	78.7
80°	61.9
82.5°	43.9
85°	25.9
87.5°	9.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)