

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770242

Luminaire Tested: LD6D70BD010-EU6DR2570959035-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770242
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR2570959035-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6194.1 lumens
Efficiency: N/A
Efficacy: 93.0 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P770242
CATALOG NUMBER: LD6D70BD010-EU6DR2570959035-6LBSQW1MW

Luminous Intensity Polar Plot

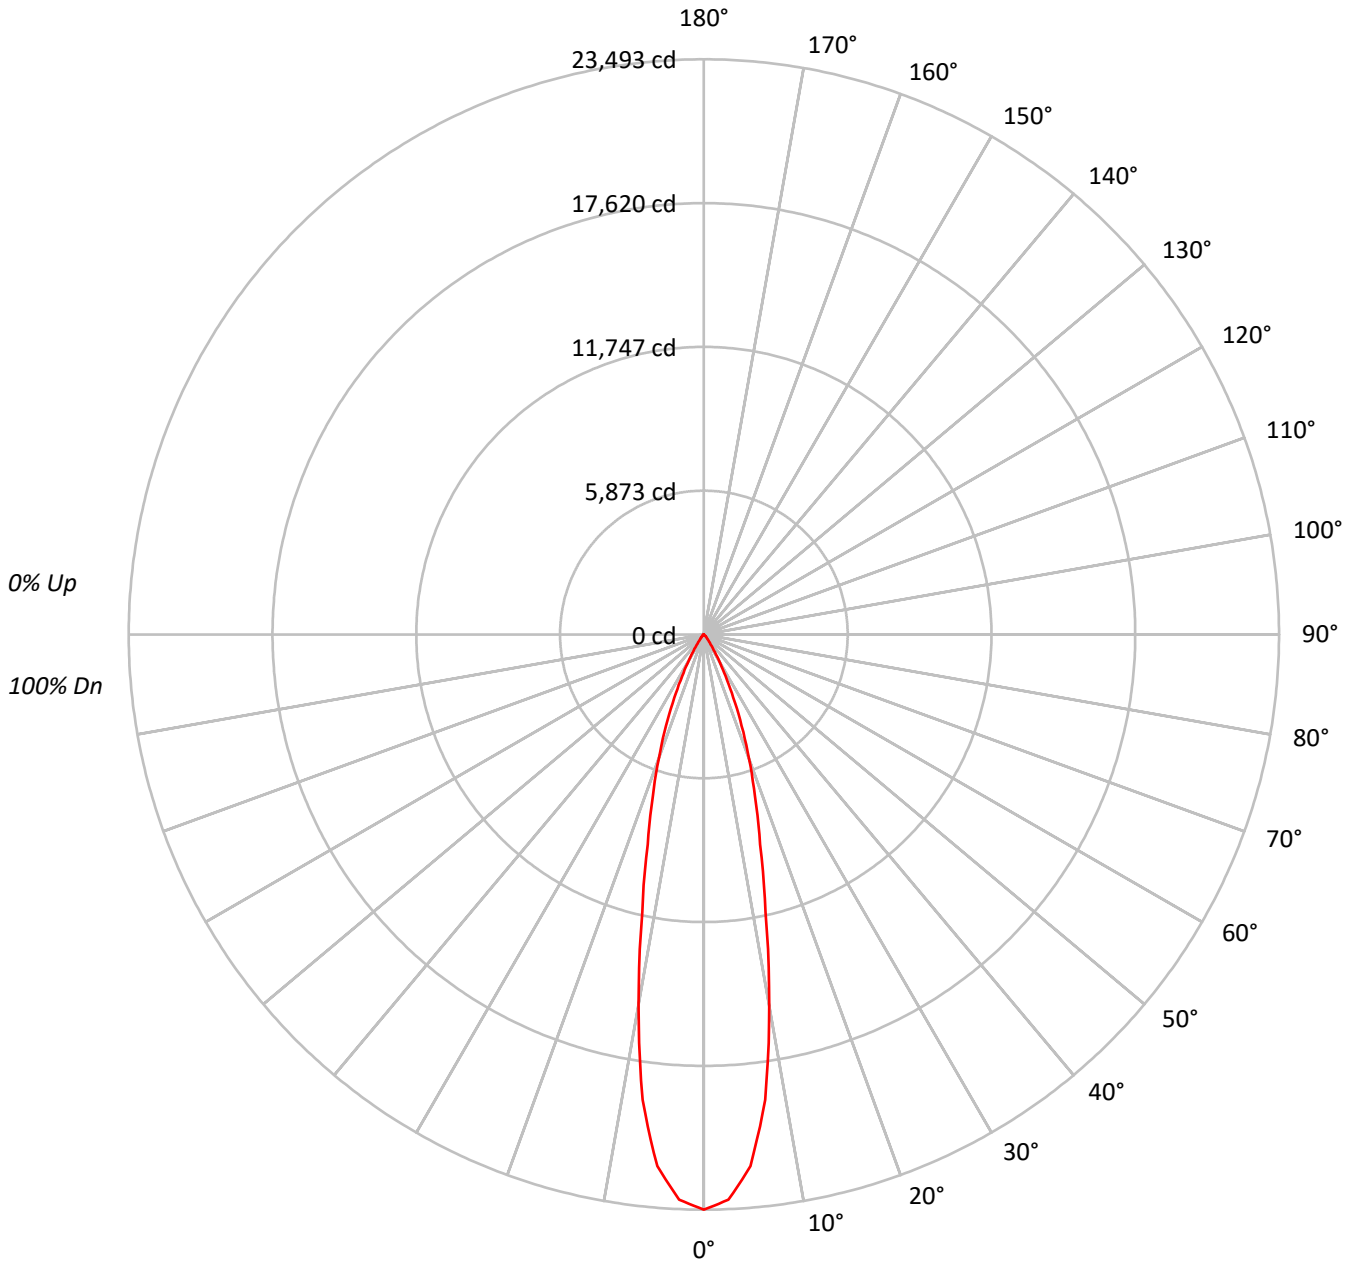



TEST NUMBER: P770242

CATALOG NUMBER: LD6D70BD010-EU6DR2570959035-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89			
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85			
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79			
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2566852
5°	2390709
10°	1705355
15°	1004383
20°	624943
25°	342969
30°	156846
35°	59395
40°	26900
45°	16178
50°	6714
55°	4324
60°	3016
65°	2042
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16178 cd/sqm



TEST NUMBER: P770242

CATALOG NUMBER: LD6D70BD010-EU6DR2570959035-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1873.3	30.2
10°-20°	2537.3	41.0
20°-30°	1342.7	21.7
30°-40°	331.4	5.4
40°-50°	80.9	1.3
50°-60°	21.3	0.3
60°-70°	7.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5753.3	92.9
0°-40°	6084.7	98.2
0°-60°	6186.8	99.9
0°-90°	6194.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6194.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	23493	
5°	21798	###
15°	8879	2537
25°	2845	1343
35°	445	331
45°	105	81
55°	23	21
65°	8	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P770242

CATALOG NUMBER: LD6D70BD010-EU6DR2570959035-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	23492.9
2.5°	23106.8
5°	21797.5
7.5°	19166.8
10°	15371.0
12.5°	11619.6
15°	8879.3
17.5°	6920.2
20°	5374.8
22.5°	4030.9
25°	2844.9
27.5°	1907.8
30°	1243.2
32.5°	756.4
35°	445.3
37.5°	272.5
40°	188.6
42.5°	144.2
45°	104.7
47.5°	63.2
50°	39.5
52.5°	28.6
55°	22.7
57.5°	17.8
60°	13.8
62.5°	10.9
65°	7.9
67.5°	3.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)