

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770946

Luminaire Tested: LD6D70BD010-EU6DR7070959040-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770946
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR7070959040-6LBCSSQMMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8476.7 lumens
Efficiency: N/A
Efficacy: 127.3 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P770946

CATALOG NUMBER: LD6D70BD010-EU6DR7070959040-6LBCSSQMMS

Luminous Intensity Polar Plot

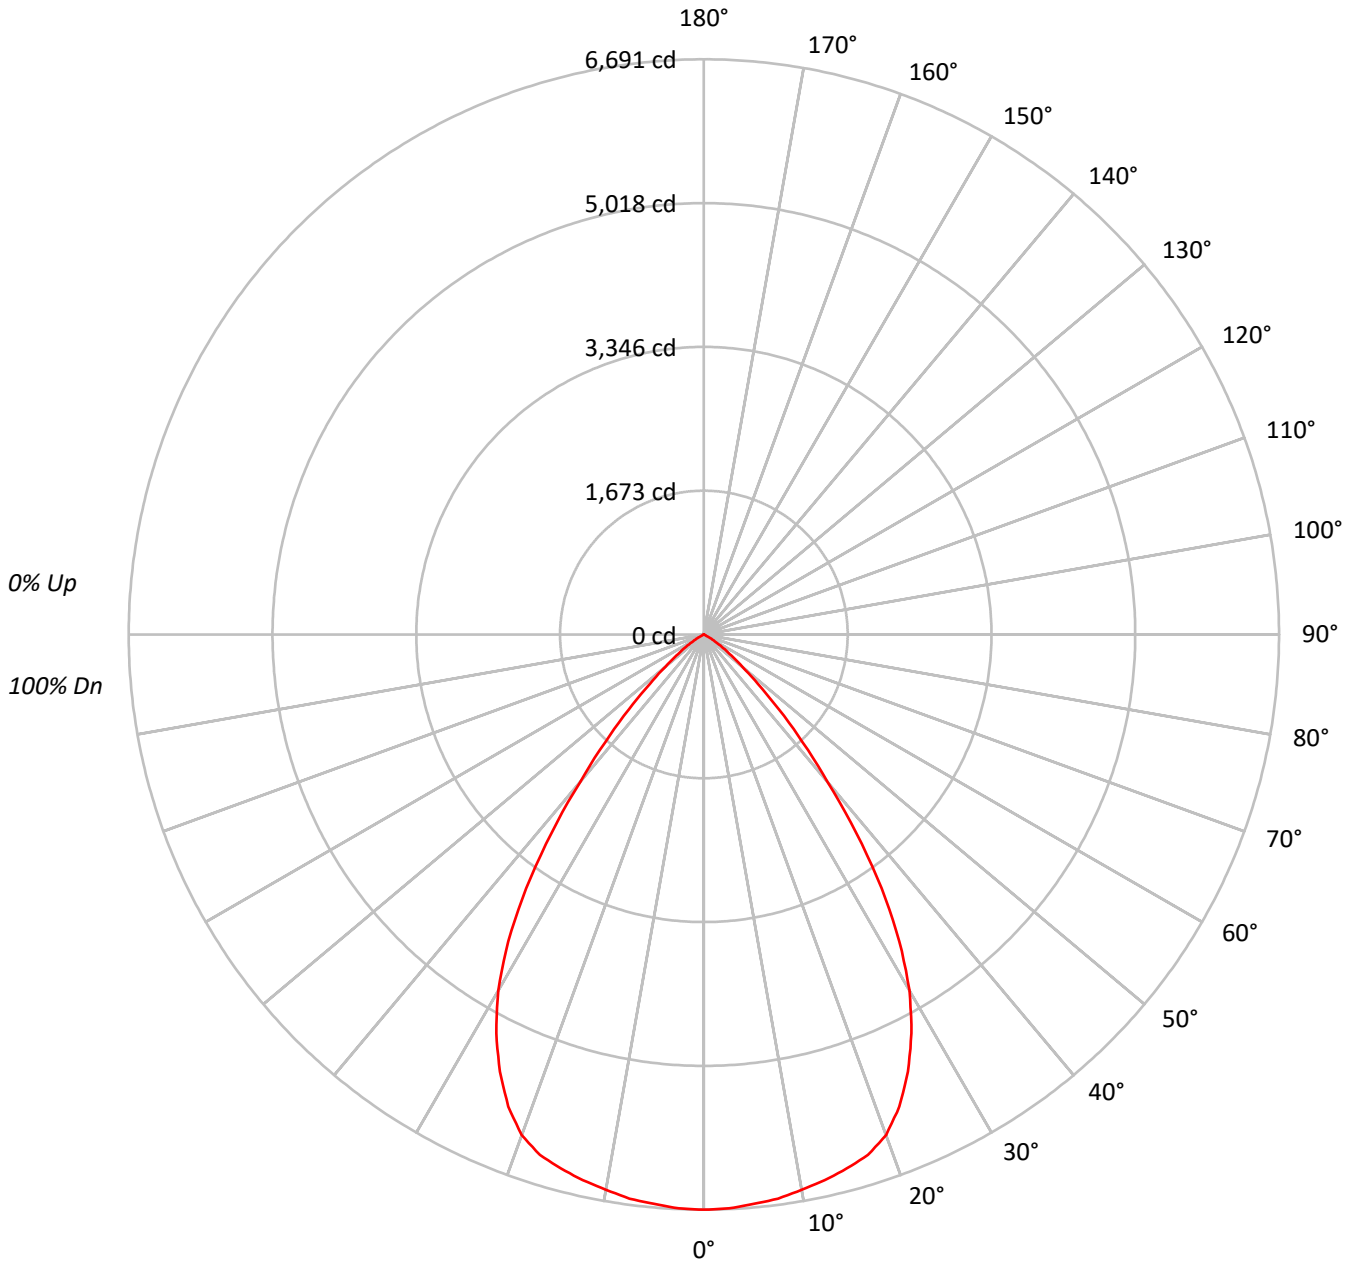



TEST NUMBER: P770946

CATALOG NUMBER: LD6D70BD010-EU6DR7070959040-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	731020
5°	729195
10°	727619
15°	727409
20°	720299
25°	676632
30°	603213
35°	480952
40°	319348
45°	190922
50°	98979
55°	52023
60°	18400
65°	310
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 190922 cd/sqm



TEST NUMBER: P770946

CATALOG NUMBER: LD6D70BD010-EU6DR7070959040-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	632.3	7.5
10°-20°	1813.4	21.4
20°-30°	2558.1	30.2
30°-40°	2208.3	26.1
40°-50°	988.9	11.7
50°-60°	258.9	3.1
60°-70°	16.9	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5003.7	59.0
0°-40°	7212.1	85.1
0°-60°	8459.9	99.8
0°-90°	8476.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8476.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6691	
5°	6648	632
15°	6431	1813
25°	5613	2558
35°	3606	2208
45°	1236	989
55°	273	259
65°	1	17
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P770946

CATALOG NUMBER: LD6D70BD010-EU6DR7070959040-6LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	6690.6
2.5°	6683.4
5°	6648.5
7.5°	6619.6
10°	6558.3
12.5°	6502.9
15°	6430.7
17.5°	6347.7
20°	6194.9
22.5°	5943.5
25°	5612.6
27.5°	5228.8
30°	4781.2
32.5°	4233.8
35°	3605.8
37.5°	2912.8
40°	2239.0
42.5°	1701.2
45°	1235.6
47.5°	851.8
50°	582.3
52.5°	401.8
55°	273.1
57.5°	164.8
60°	84.2
62.5°	26.5
65°	1.2
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)