

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771518

Luminaire Tested: LD6D75BD010-EU6DR6070959024-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771518
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR6070959024-6LBCSSQMMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7143.9 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P771518
CATALOG NUMBER: LD6D75BD010-EU6DR6070959024-6LBCSSQMMS

Luminous Intensity Polar Plot

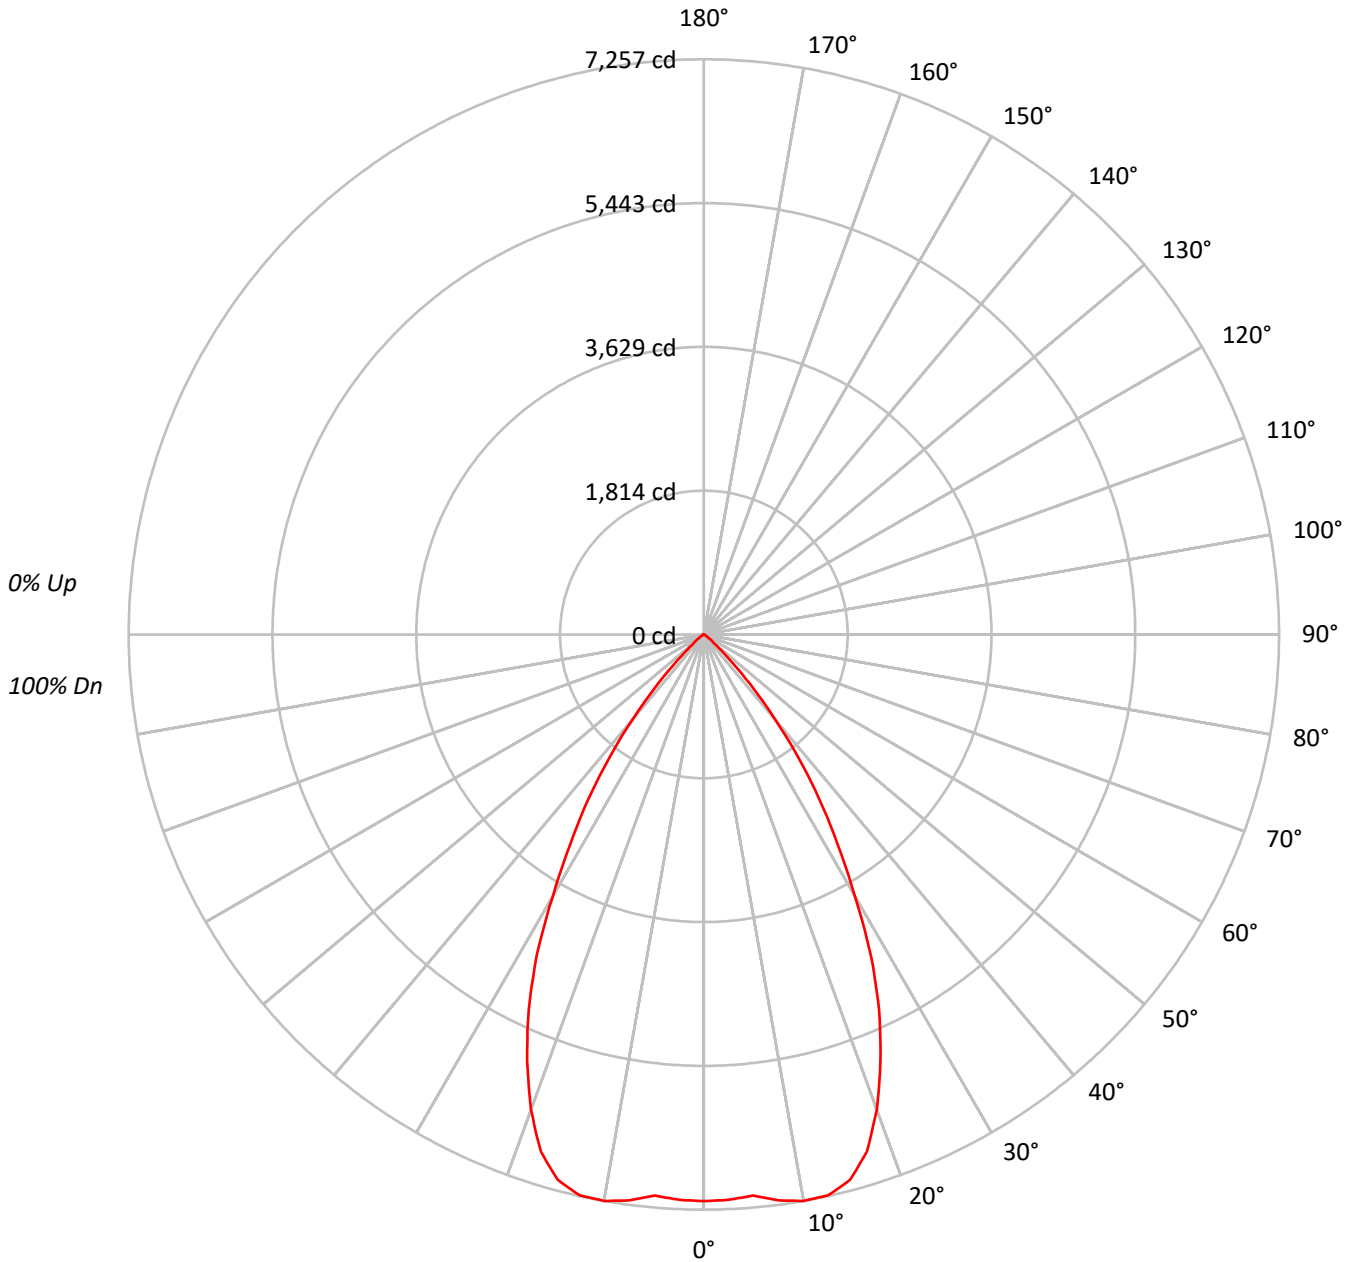



TEST NUMBER: P771518

CATALOG NUMBER: LD6D75BD010-EU6DR6070959024-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75		
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70		
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65		
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61		
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57		
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53		
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	781127
5°	779219
10°	805104
15°	805933
20°	741542
25°	630736
30°	480594
35°	339859
40°	199568
45°	80535
50°	26891
55°	12934
60°	5310
65°	776
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 80535 cd/sqm



TEST NUMBER: P771518

CATALOG NUMBER: LD6D75BD010-EU6DR6070959024-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	685.3	9.6
10°-20°	1973.8	27.6
20°-30°	2362.4	33.1
30°-40°	1580.1	22.1
40°-50°	468.5	6.6
50°-60°	67.3	0.9
60°-70°	6.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5021.6	70.3
0°-40°	6601.7	92.4
0°-60°	7137.6	99.9
0°-90°	7143.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7143.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7149	
5°	7105	685
15°	7125	1974
25°	5232	2362
35°	2548	1580
45°	521	468
55°	68	67
65°	3	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771518

CATALOG NUMBER: LD6D75BD010-EU6DR6070959024-6LBCSSQMMMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	7149.2
2.5°	7140.1
5°	7104.6
7.5°	7200.9
10°	7256.7
12.5°	7246.5
15°	7124.9
17.5°	6837.9
20°	6377.6
22.5°	5825.0
25°	5231.9
27.5°	4563.7
30°	3809.3
32.5°	3136.1
35°	2548.0
37.5°	1958.9
40°	1399.2
42.5°	922.7
45°	521.2
47.5°	266.7
50°	158.2
52.5°	102.4
55°	67.9
57.5°	43.6
60°	24.3
62.5°	10.1
65°	3.0
67.5°	1.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)