

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771153

Luminaire Tested: LD6D75BD010-EU6DR3570959030-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771153
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR3570959030-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7841.3 lumens
Efficiency: N/A
Efficacy: 108.3 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P771153
CATALOG NUMBER: LD6D75BD010-EU6DR3570959030-6LBCSSQMB

Luminous Intensity Polar Plot

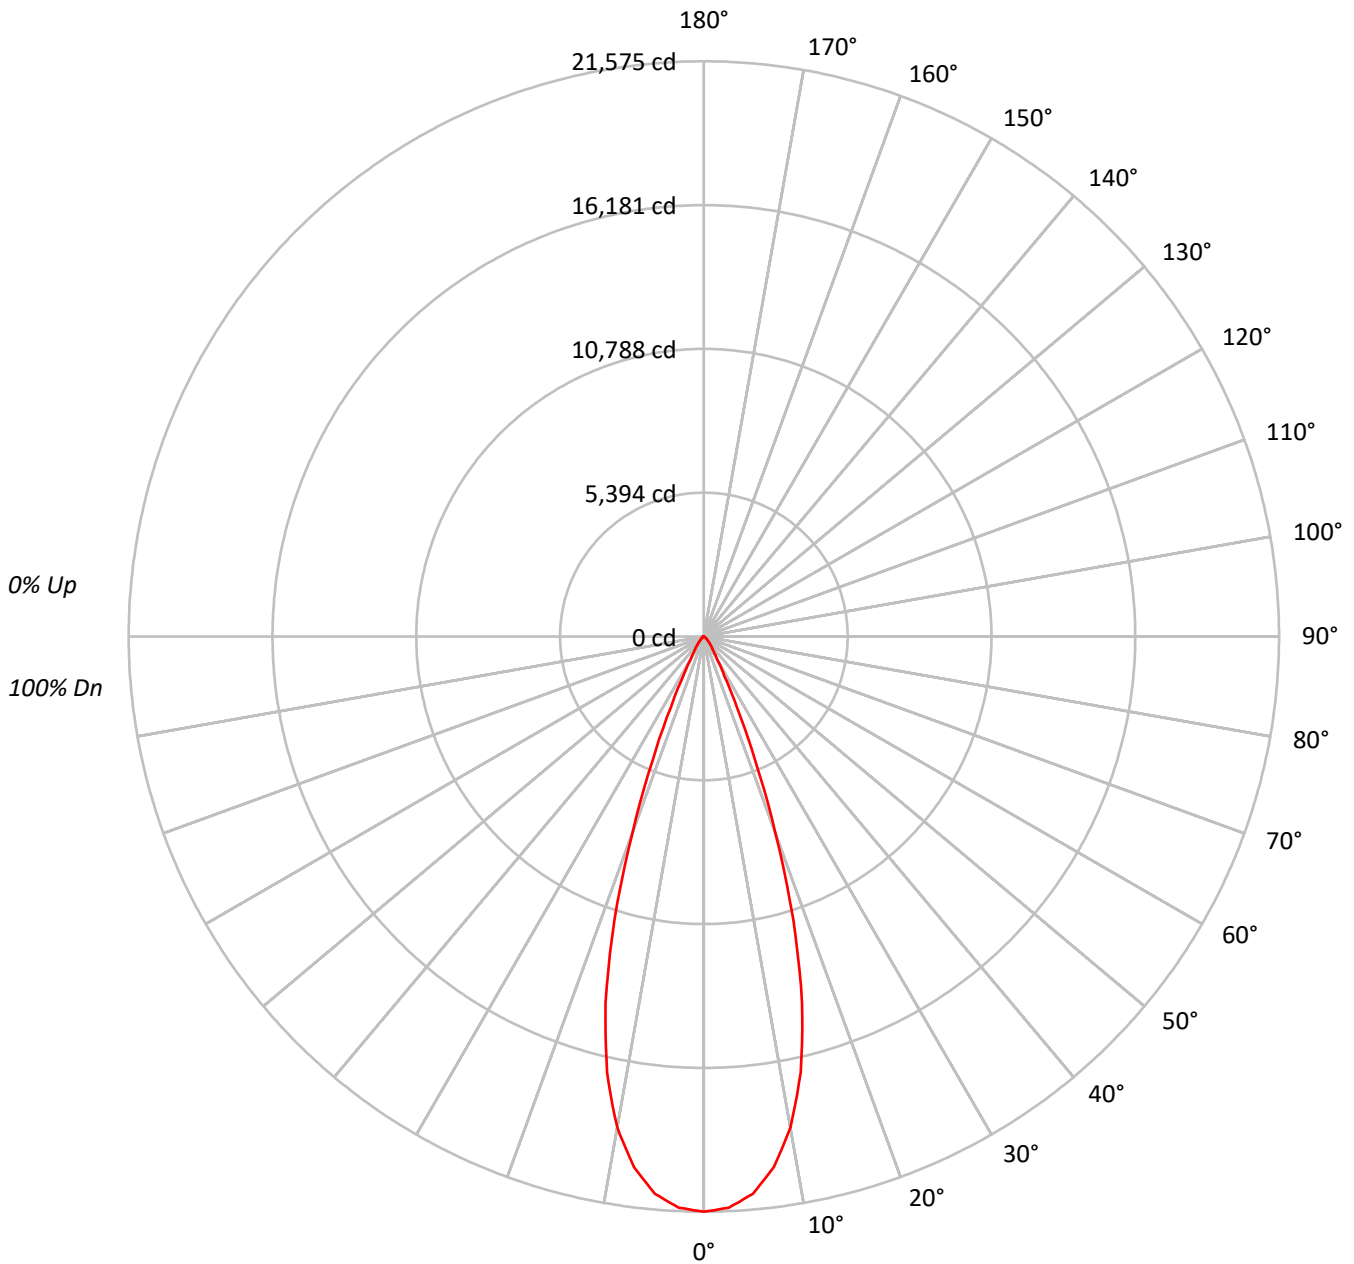



TEST NUMBER: P771153

CATALOG NUMBER: LD6D75BD010-EU6DR3570959030-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2357323
5°	2301935
10°	2074651
15°	1610261
20°	913323
25°	355326
30°	132560
35°	72667
40°	47496
45°	28910
50°	18392
55°	12991
60°	9506
65°	5171
70°	383
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 28910 cd/sqm



TEST NUMBER: P771153

CATALOG NUMBER: LD6D75BD010-EU6DR3570959030-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1930.3	24.6
10°-20°	3768.8	48.1
20°-30°	1537.1	19.6
30°-40°	367.8	4.7
40°-50°	153.3	2.0
50°-60°	63.4	0.8
60°-70°	19.9	0.3
70°-80°	0.5	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7236.1	92.3
0°-40°	7603.9	97.0
0°-60°	7820.6	99.7
0°-90°	7841.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7841.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	21575	
5°	20988	###
15°	14236	3769
25°	2947	1537
35°	545	368
45°	187	153
55°	68	63
65°	20	20
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771153

CATALOG NUMBER: LD6D75BD010-EU6DR3570959030-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

0°	
0°	21575.2
2.5°	21445.8
5°	20988.1
7.5°	20075.1
10°	18699.6
12.5°	16763.0
15°	14235.6
17.5°	11144.7
20°	7855.0
22.5°	5008.8
25°	2947.4
27.5°	1666.1
30°	1050.7
32.5°	737.7
35°	544.8
37.5°	421.2
40°	333.0
42.5°	256.5
45°	187.1
47.5°	140.0
50°	108.2
52.5°	85.9
55°	68.2
57.5°	55.3
60°	43.5
62.5°	31.8
65°	20.0
67.5°	7.1
70°	1.2
72.5°	1.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)