

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771467

Luminaire Tested: LD6D75BD010-EU6DR5570959030-6LBCSSQMW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P771467  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D75BD010-EU6DR5570959030-6LBCSSQMW  
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 55° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 8632.8 lumens  
Efficiency: N/A  
Efficacy: 119.2 lumens/watt  
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 72.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P771467  
CATALOG NUMBER: LD6D75BD010-EU6DR5570959030-6LBCSSQMW

### Luminous Intensity Polar Plot

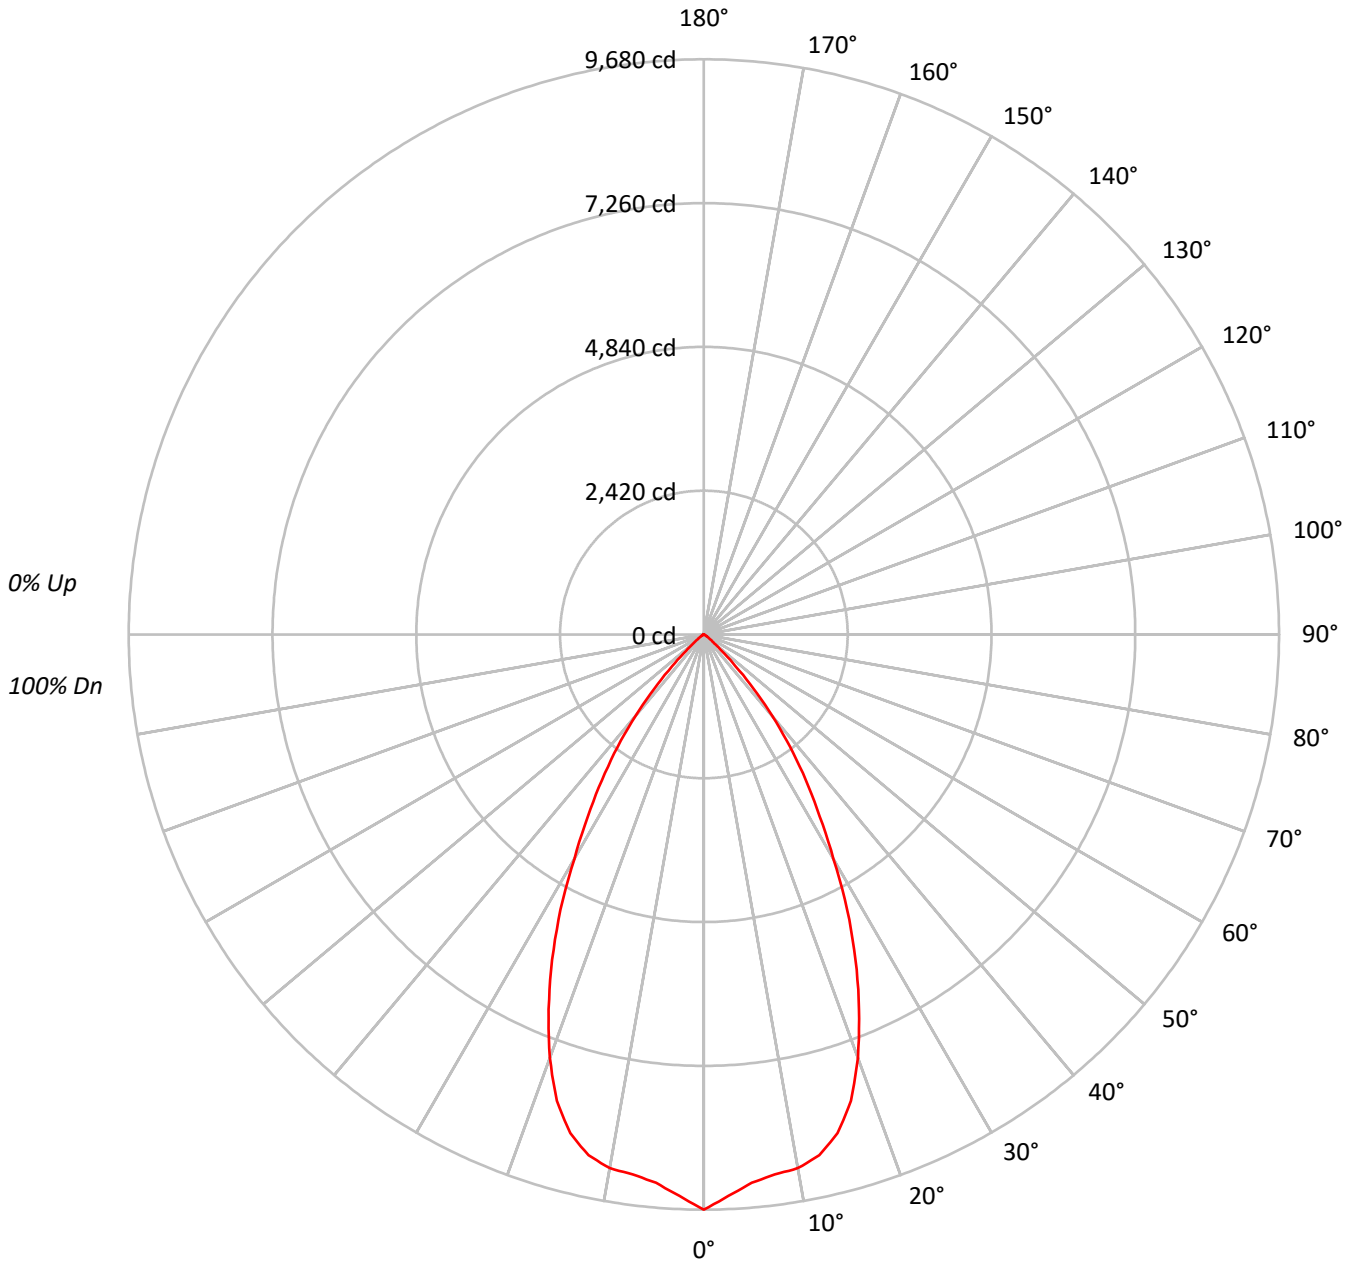



TEST NUMBER: P771467

CATALOG NUMBER: LD6D75BD010-EU6DR5570959030-6LBCSSQMW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57			
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54			
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1057688
5°	1015674
10°	1011852
15°	982778
20°	881209
25°	728266
30°	550123
35°	398881
40°	255265
45°	116584
50°	38126
55°	16458
60°	7080
65°	931
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 116584 cd/sqm



TEST NUMBER: P771467

CATALOG NUMBER: LD6D75BD010-EU6DR5570959030-6LBCSSQMW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	881.2	10.2
10°-20°	2404.9	27.9
20°-30°	2740.6	31.7
30°-40°	1865.7	21.6
40°-50°	642.9	7.4
50°-60°	88.9	1.0
60°-70°	8.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6026.7	69.8
0°-40°	7892.5	91.4
0°-60°	8624.2	99.9
0°-90°	8632.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8632.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	9680	
5°	9260	881
15°	8688	2405
25°	6041	2741
35°	2990	1866
45°	754	643
55°	86	89
65°	4	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771467

CATALOG NUMBER: LD6D75BD010-EU6DR5570959030-6LBCSSQMW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	9680.4
2.5°	9458.5
5°	9260.5
7.5°	9163.4
10°	9120.2
12.5°	8976.2
15°	8688.3
17.5°	8231.3
20°	7578.8
22.5°	6825.4
25°	6040.9
27.5°	5224.0
30°	4360.4
32.5°	3628.6
35°	2990.5
37.5°	2383.5
40°	1789.7
42.5°	1240.3
45°	754.5
47.5°	406.6
50°	224.3
52.5°	133.2
55°	86.4
57.5°	55.2
60°	32.4
62.5°	14.4
65°	3.6
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)