

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771737

Luminaire Tested: LD6D75BD010-EU6DR7070959040-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P771737
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR7070959040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7493.7 lumens
Efficiency: N/A
Efficacy: 103.5 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P771737
CATALOG NUMBER: LD6D75BD010-EU6DR7070959040-6LBSQW1MW

Luminous Intensity Polar Plot

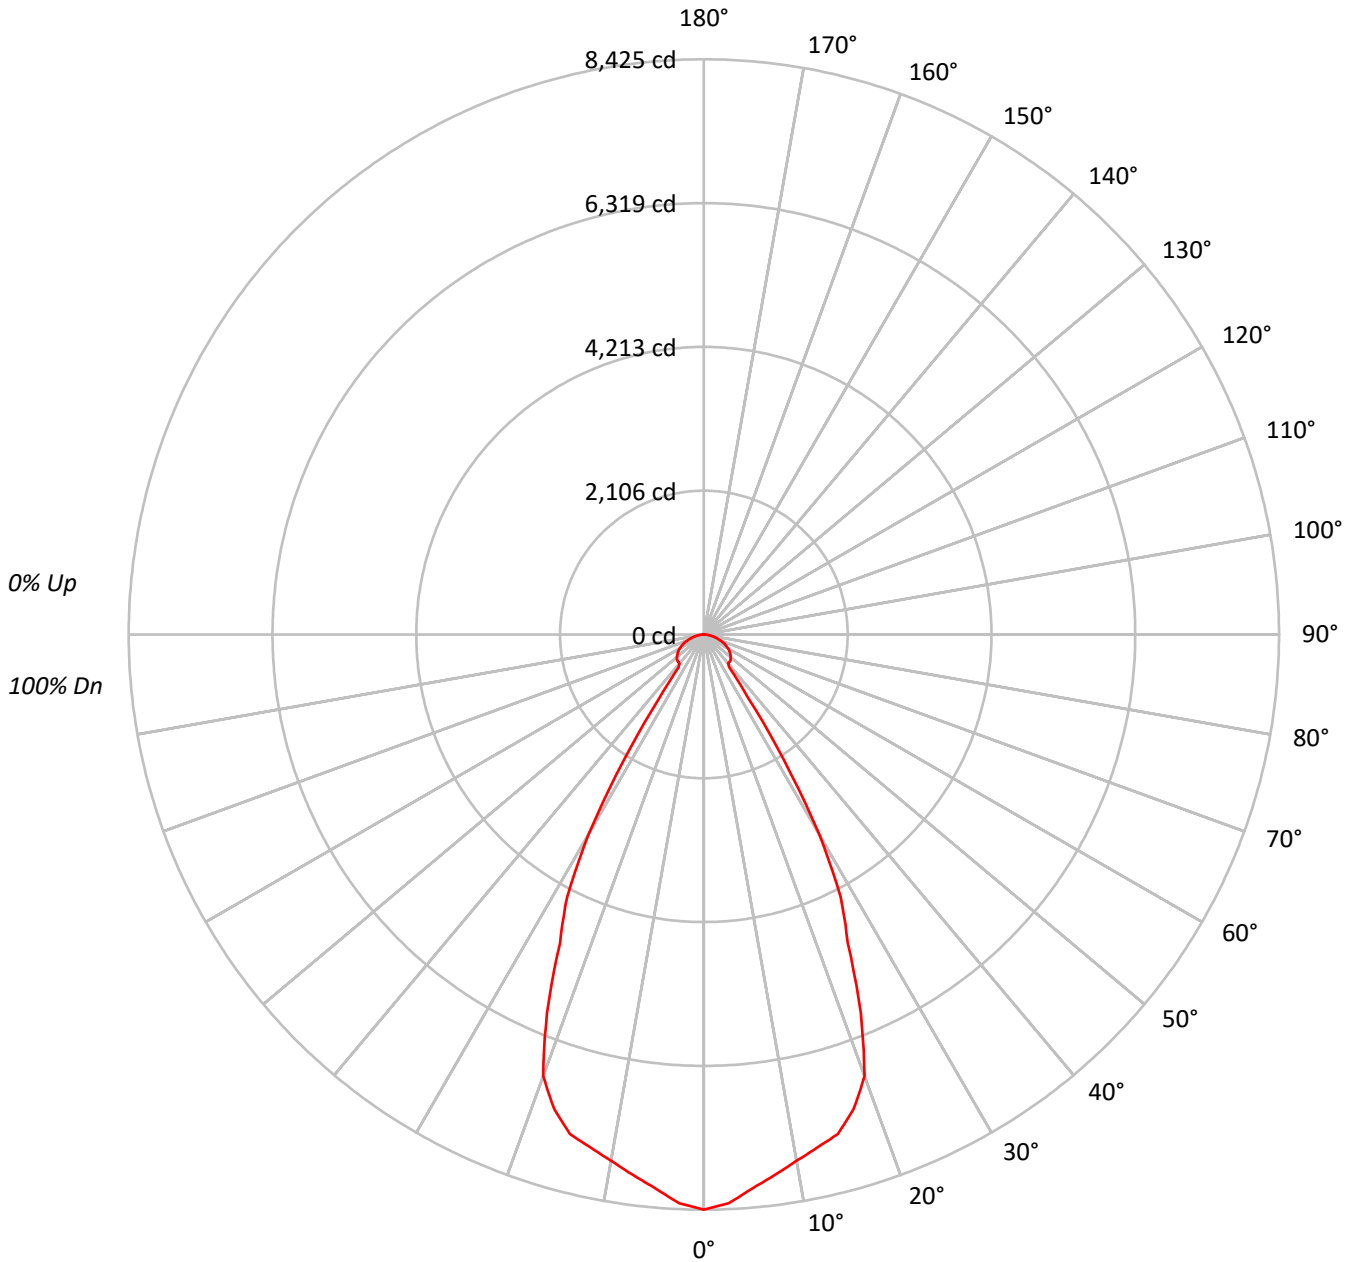



TEST NUMBER: P771737

CATALOG NUMBER: LD6D75BD010-EU6DR7070959040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 112 | 109 | 106 | 103 | 110 | 107 | 104 | 102 | 103 | 101 | 99 | 99 | 97 | 96 | 95 | 94 | 93 | 91 | | | | | | | | | | | | | | | | | | | |
| 2 | 106 | 100 | 95 | 91 | 103 | 98 | 94 | 90 | 95 | 91 | 88 | 92 | 89 | 86 | 89 | 87 | 85 | 83 | | | | | | | | | | | | | | | | | | | |
| 3 | 100 | 92 | 87 | 82 | 98 | 91 | 86 | 81 | 88 | 84 | 80 | 86 | 82 | 79 | 83 | 80 | 78 | 76 | | | | | | | | | | | | | | | | | | | |
| 4 | 94 | 86 | 80 | 75 | 92 | 85 | 79 | 74 | 82 | 77 | 73 | 80 | 76 | 73 | 78 | 75 | 72 | 70 | | | | | | | | | | | | | | | | | | | |
| 5 | 89 | 80 | 74 | 69 | 87 | 79 | 73 | 69 | 77 | 72 | 68 | 75 | 71 | 67 | 74 | 70 | 67 | 65 | | | | | | | | | | | | | | | | | | | |
| 6 | 85 | 75 | 68 | 64 | 83 | 74 | 68 | 64 | 73 | 67 | 63 | 71 | 66 | 63 | 70 | 66 | 62 | 61 | | | | | | | | | | | | | | | | | | | |
| 7 | 80 | 70 | 64 | 59 | 79 | 70 | 64 | 59 | 68 | 63 | 59 | 67 | 62 | 59 | 66 | 62 | 58 | 57 | | | | | | | | | | | | | | | | | | | |
| 8 | 77 | 66 | 60 | 56 | 75 | 66 | 60 | 56 | 65 | 59 | 55 | 64 | 59 | 55 | 63 | 58 | 55 | 53 | | | | | | | | | | | | | | | | | | | |
| 9 | 73 | 63 | 57 | 52 | 72 | 62 | 56 | 52 | 61 | 56 | 52 | 60 | 55 | 52 | 60 | 55 | 52 | 50 | | | | | | | | | | | | | | | | | | | |
| 10 | 70 | 59 | 53 | 49 | 69 | 59 | 53 | 49 | 58 | 53 | 49 | 57 | 52 | 49 | 57 | 52 | 49 | 48 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 920544 |
| 5° | 893186 |
| 10° | 868288 |
| 15° | 856903 |
| 20° | 800167 |
| 25° | 601128 |
| 30° | 424944 |
| 35° | 150522 |
| 40° | 79145 |
| 45° | 84305 |
| 50° | 87302 |
| 55° | 88940 |
| 60° | 89485 |
| 65° | 87591 |
| 70° | 82675 |
| 75° | 76578 |
| 80° | 67954 |
| 85° | 55160 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 89515 cd/sqm



TEST NUMBER: P771737

CATALOG NUMBER: LD6D75BD010-EU6DR7070959040-6LBSQW1MW

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 768.1 | 10.3 |
| 10°-20° | 2106.9 | 28.1 |
| 20°-30° | 2320.5 | 31.0 |
| 30°-40° | 886.6 | 11.8 |
| 40°-50° | 418.6 | 5.6 |
| 50°-60° | 416.2 | 5.6 |
| 60°-70° | 333.2 | 4.4 |
| 70°-80° | 191.5 | 2.6 |
| 80°-90° | 52.0 | 0.7 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 5195.6 | 69.3 |
| 0°-40° | 6082.2 | 81.2 |
| 0°-60° | 6917.0 | 92.3 |
| 0°-90° | 7493.7 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 7493.7 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 8425 | |
| 5° | 8144 | 768 |
| 15° | 7576 | 2107 |
| 25° | 4986 | 2321 |
| 35° | 1128 | 887 |
| 45° | 546 | 419 |
| 55° | 467 | 416 |
| 65° | 339 | 333 |
| 75° | 181 | 192 |
| 85° | 44 | 52 |
| 90° | 0 | |



TEST NUMBER: P771737

CATALOG NUMBER: LD6D75BD010-EU6DR7070959040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 8425.2 |
| 2.5° | 8337.1 |
| 5° | 8143.7 |
| 7.5° | 7982.3 |
| 10° | 7826.2 |
| 12.5° | 7694.2 |
| 15° | 7575.5 |
| 17.5° | 7288.7 |
| 20° | 6881.8 |
| 22.5° | 6004.1 |
| 25° | 4986.3 |
| 27.5° | 4340.6 |
| 30° | 3368.2 |
| 32.5° | 2175.7 |
| 35° | 1128.5 |
| 37.5° | 609.6 |
| 40° | 554.9 |
| 42.5° | 550.9 |
| 45° | 545.6 |
| 47.5° | 533.6 |
| 50° | 513.6 |
| 52.5° | 490.9 |
| 55° | 466.9 |
| 57.5° | 440.2 |
| 60° | 409.5 |
| 62.5° | 374.8 |
| 65° | 338.8 |
| 67.5° | 298.8 |
| 70° | 258.8 |
| 72.5° | 218.8 |
| 75° | 181.4 |
| 77.5° | 142.7 |
| 80° | 108.0 |
| 82.5° | 76.0 |
| 85° | 44.0 |
| 87.5° | 17.3 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)