

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771428

Luminaire Tested: LD6D75BD010-EU6DR5070959050-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771428
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR5070959050-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9150.9 lumens
Efficiency: N/A
Efficacy: 126.4 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P771428
CATALOG NUMBER: LD6D75BD010-EU6DR5070959050-6LBCSSQMW

Luminous Intensity Polar Plot

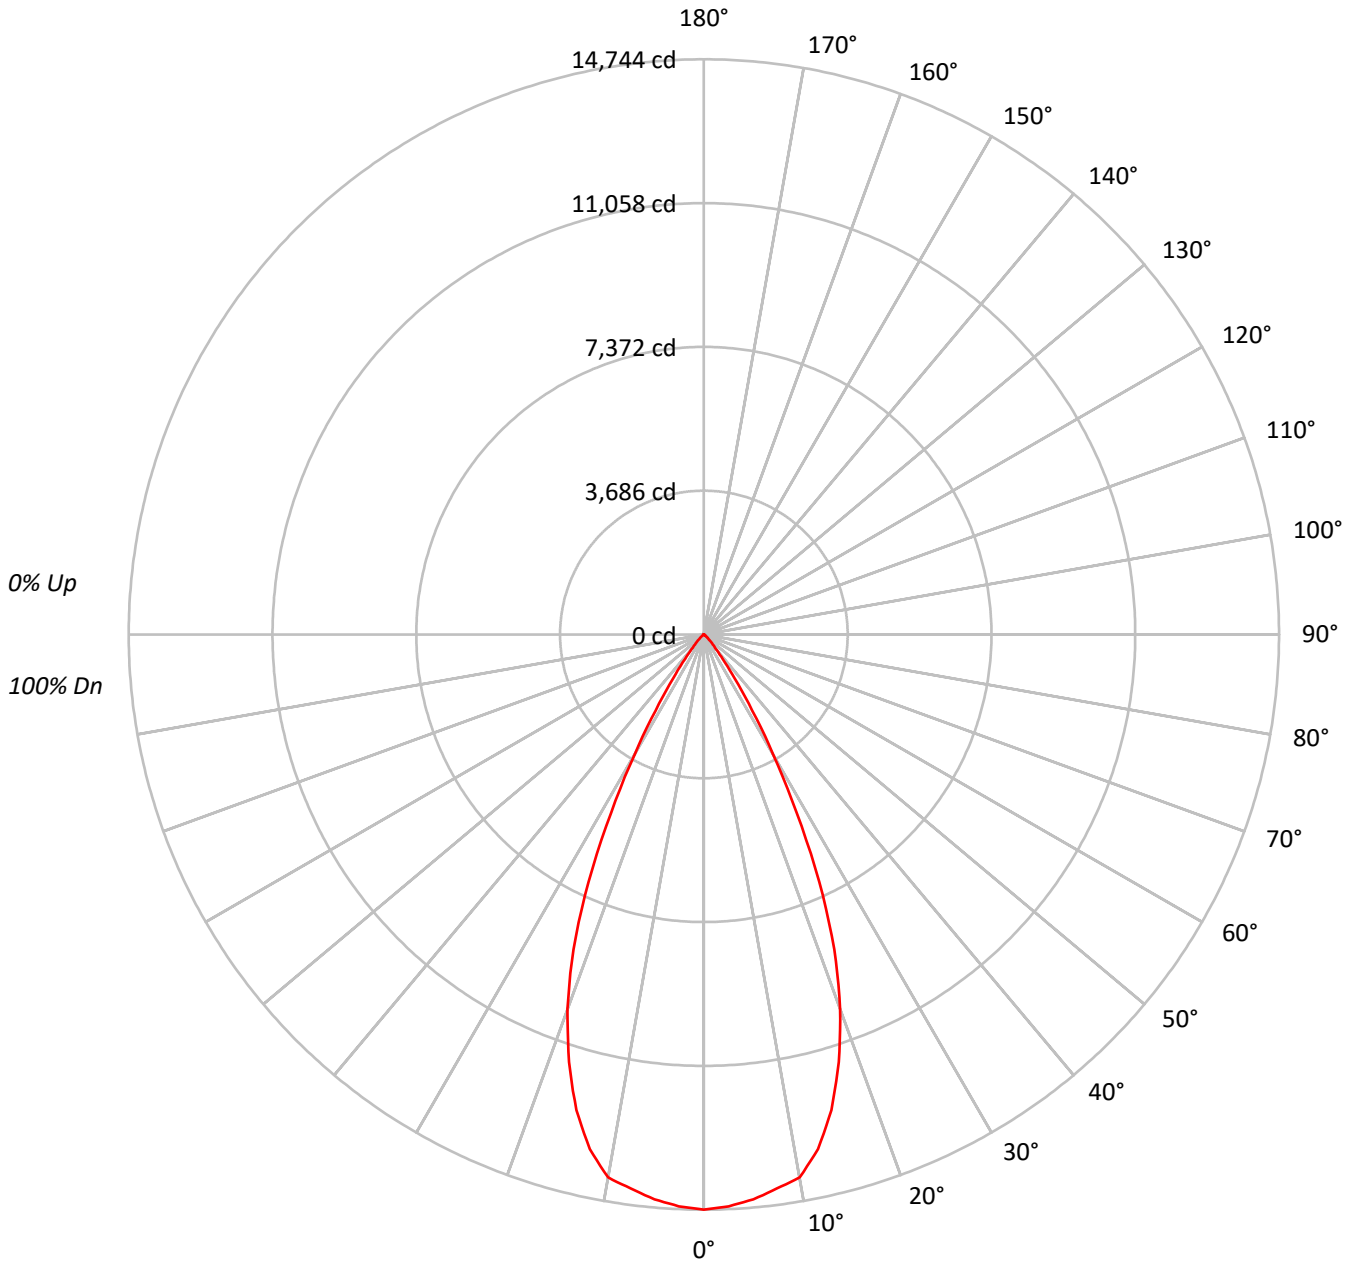



TEST NUMBER: P771428
 CATALOG NUMBER: LD6D75BD010-EU6DR5070959050-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1610995
5°	1594106
10°	1567848
15°	1427648
20°	1187972
25°	843276
30°	446354
35°	181894
40°	67549
45°	30919
50°	12680
55°	6629
60°	3256
65°	957
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 30919 cd/sqm



TEST NUMBER: P771428

CATALOG NUMBER: LD6D75BD010-EU6DR5070959050-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1373.8	15.0
10°-20°	3471.9	37.9
20°-30°	3118.6	34.1
30°-40°	976.5	10.7
40°-50°	171.0	1.9
50°-60°	34.1	0.4
60°-70°	5.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7964.3	87.0
0°-40°	8940.7	97.7
0°-60°	9145.8	99.9
0°-90°	9150.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9150.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14744	
5°	14534	###
15°	12621	3472
25°	6995	3119
35°	1364	976
45°	200	171
55°	35	34
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771428

CATALOG NUMBER: LD6D75BD010-EU6DR5070959050-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

0°	
0°	14744.5
2.5°	14671.1
5°	14534.4
7.5°	14325.5
10°	14131.6
12.5°	13510.1
15°	12621.2
17.5°	11492.5
20°	10217.1
22.5°	8741.5
25°	6994.9
27.5°	5142.7
30°	3537.9
32.5°	2303.5
35°	1363.7
37.5°	783.2
40°	473.6
42.5°	308.3
45°	200.1
47.5°	121.8
50°	74.6
52.5°	51.0
55°	34.8
57.5°	23.6
60°	14.9
62.5°	8.7
65°	3.7
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)