

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771738

Luminaire Tested: LD6D75BD010-EU6DR7070959050-6LBCSSQMB

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P771738  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D75BD010-EU6DR7070959050-6LBCSSQMB  
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 9023.4 lumens  
Efficiency: N/A  
Efficacy: 124.6 lumens/watt  
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 72.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P771738  
CATALOG NUMBER: LD6D75BD010-EU6DR7070959050-6LBCSSQMB

### Luminous Intensity Polar Plot

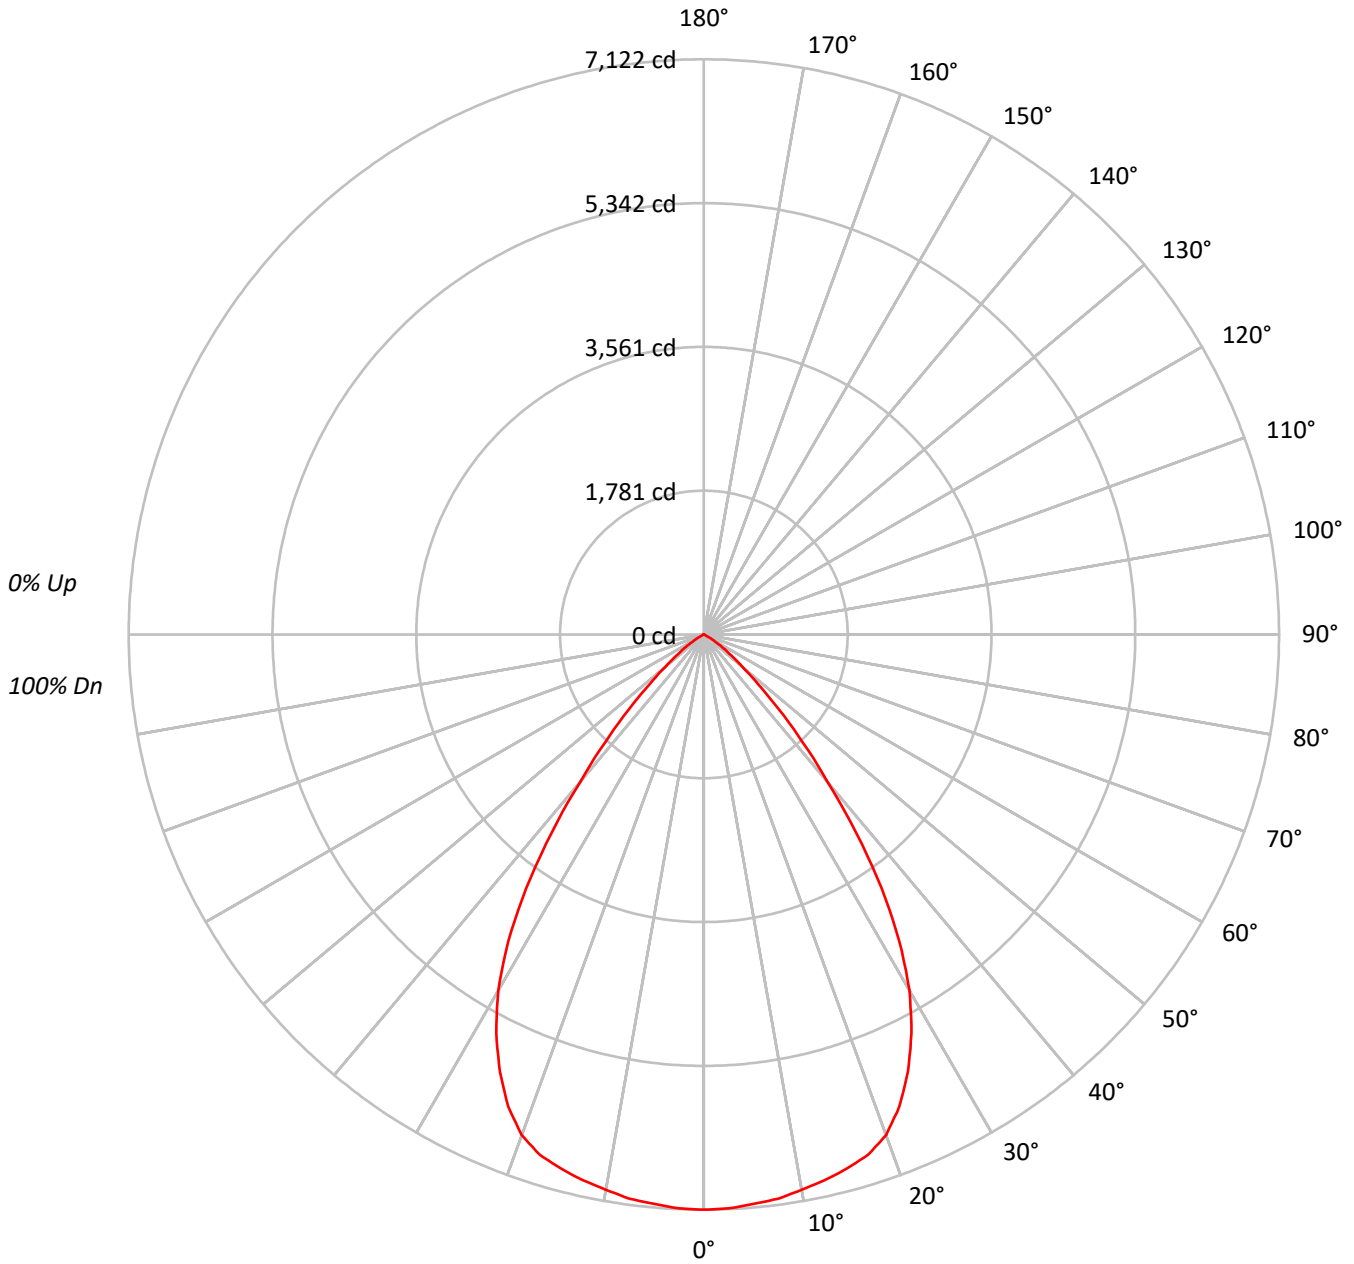



TEST NUMBER: P771738

CATALOG NUMBER: LD6D75BD010-EU6DR7070959050-6LBCSSQMB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	85	82	87	84	81	85	82	79	78	78	78	78
4	95	87	81	76	93	86	80	76	83	78	75	81	77	74	79	76	73	71	71	71	71
5	89	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	65	65	65	65
6	84	75	68	63	83	74	68	63	72	67	63	71	66	62	69	65	62	60	60	60	60
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	61	57	56	56	56	56
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51	51	51	51
9	71	61	54	50	70	60	54	50	59	53	50	58	53	49	57	53	49	48	48	48	48
10	67	57	50	46	66	56	50	46	55	50	46	55	50	46	54	49	46	44	44	44	44

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	778155
5°	776214
10°	774527
15°	774318
20°	766750
25°	720261
30°	642109
35°	511963
40°	339944
45°	203238
50°	105370
55°	55376
60°	19580
65°	336
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 203238 cd/sqm



TEST NUMBER: P771738

CATALOG NUMBER: LD6D75BD010-EU6DR7070959050-6LBCSSQMB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	673.0	7.5
10°-20°	1930.3	21.4
20°-30°	2723.1	30.2
30°-40°	2350.7	26.1
40°-50°	1052.7	11.7
50°-60°	275.6	3.1
60°-70°	17.9	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5326.4	59.0
0°-40°	7677.1	85.1
0°-60°	9005.4	99.8
0°-90°	9023.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9023.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7122	
5°	7077	673
15°	6845	1930
25°	5974	2723
35°	3838	2351
45°	1315	1053
55°	291	276
65°	1	18
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771738

CATALOG NUMBER: LD6D75BD010-EU6DR7070959050-6LBCSSQMB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	7122.0
2.5°	7114.3
5°	7077.2
7.5°	7046.5
10°	6981.1
12.5°	6922.2
15°	6845.4
17.5°	6757.0
20°	6594.4
22.5°	6326.7
25°	5974.5
27.5°	5566.0
30°	5089.5
32.5°	4506.8
35°	3838.3
37.5°	3100.6
40°	2383.4
42.5°	1810.9
45°	1315.3
47.5°	906.7
50°	619.9
52.5°	427.8
55°	290.7
57.5°	175.5
60°	89.6
62.5°	28.2
65°	1.3
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)