

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772439

Luminaire Tested: LD6D80BD010-EU6DR6570959040-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P772439
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D80BD010-EU6DR6570959040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8059.5 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P772439
CATALOG NUMBER: LD6D80BD010-EU6DR6570959040-6LBSQW1MW

Luminous Intensity Polar Plot

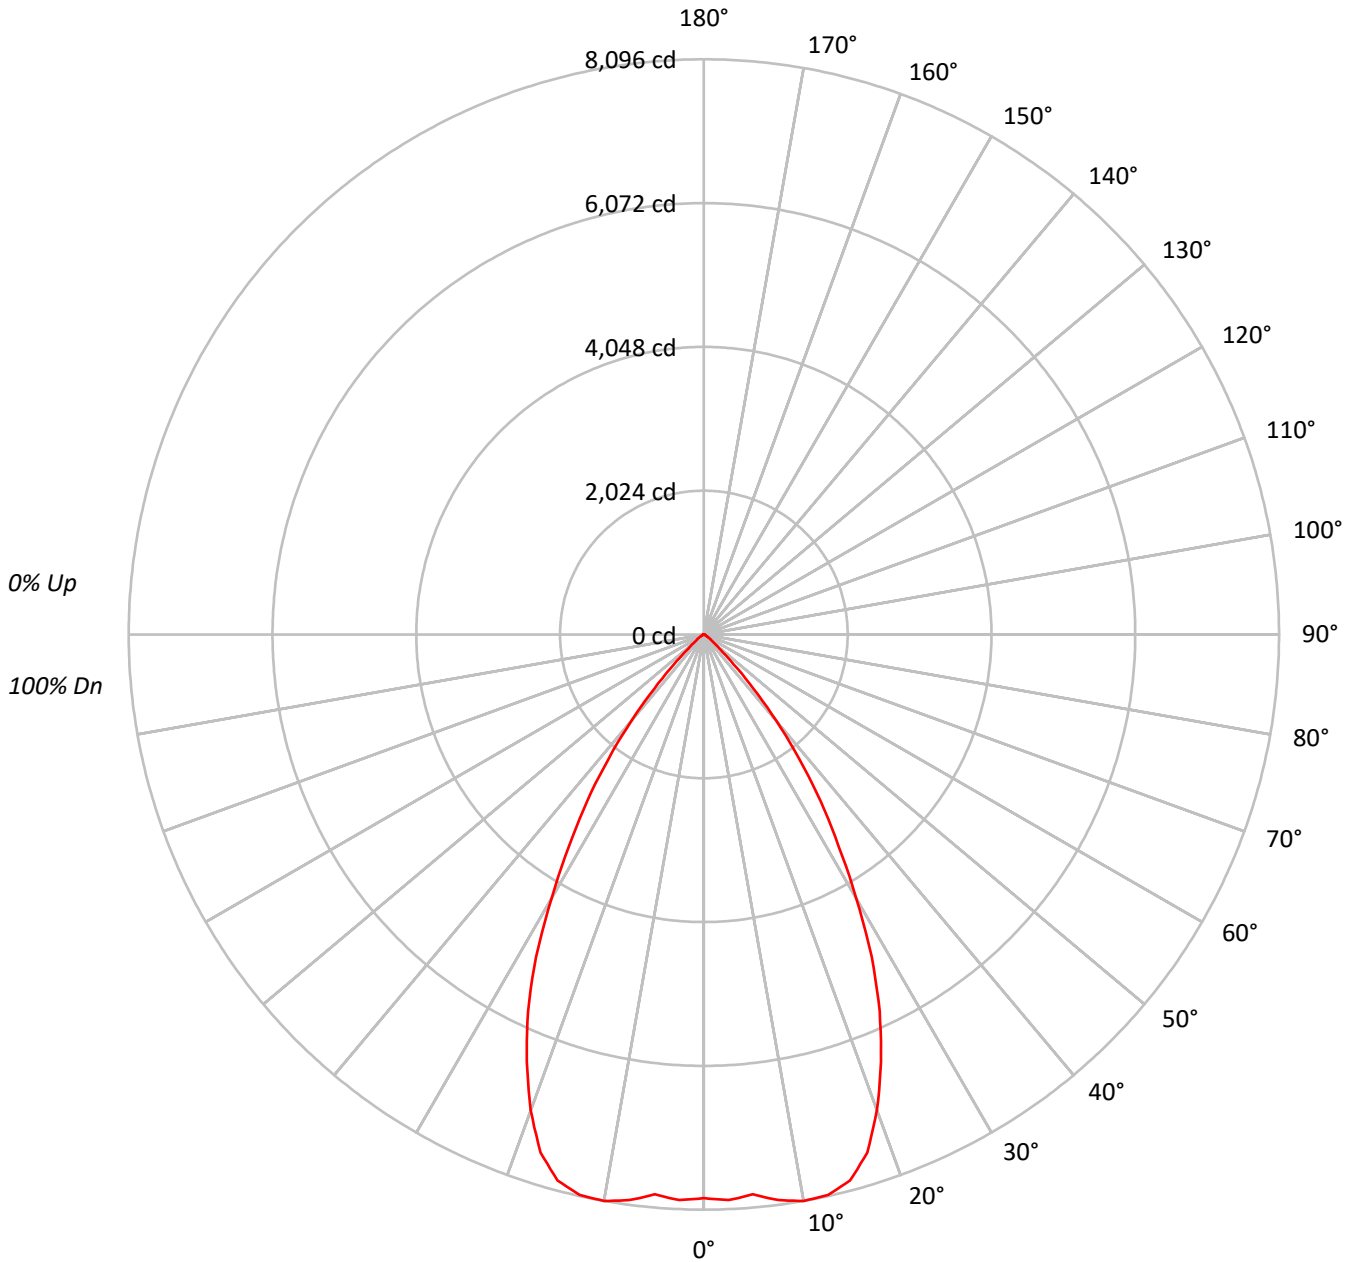



TEST NUMBER: P772439

CATALOG NUMBER: LD6D80BD010-EU6DR6570959040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	866995
5°	867707
10°	898254
15°	899751
20°	828363
25°	705807
30°	540320
35°	381728
40°	225327
45°	91475
50°	33163
55°	18478
60°	10598
65°	5843
70°	6134
75°	4770
80°	4971
85°	4262

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 91475 cd/sqm



TEST NUMBER: P772439

CATALOG NUMBER: LD6D80BD010-EU6DR6570959040-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	764.1	9.5
10°-20°	2204.0	27.3
20°-30°	2644.4	32.8
30°-40°	1777.1	22.1
40°-50°	532.0	6.6
50°-60°	93.9	1.2
60°-70°	26.7	0.3
70°-80°	13.1	0.2
80°-90°	4.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5612.5	69.6
0°-40°	7389.6	91.7
0°-60°	8015.5	99.5
0°-90°	8059.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8059.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7935	
5°	7911	764
15°	7954	2204
25°	5855	2644
35°	2862	1777
45°	592	532
55°	97	94
65°	23	27
75°	11	13
85°	3	4
90°	0	



TEST NUMBER: P772439

CATALOG NUMBER: LD6D80BD010-EU6DR6570959040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	7935.1
2.5°	7968.9
5°	7911.4
7.5°	8030.9
10°	8096.3
12.5°	8080.5
15°	7954.3
17.5°	7645.3
20°	7124.3
22.5°	6510.9
25°	5854.6
27.5°	5113.8
30°	4282.7
32.5°	3529.5
35°	2861.9
37.5°	2202.2
40°	1579.8
42.5°	1031.8
45°	592.0
47.5°	313.5
50°	195.1
52.5°	135.3
55°	97.0
57.5°	69.9
60°	48.5
62.5°	31.6
65°	22.6
67.5°	20.3
70°	19.2
72.5°	14.7
75°	11.3
77.5°	10.1
80°	7.9
82.5°	5.6
85°	3.4
87.5°	2.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)