

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772855

Luminaire Tested: LD6D85BD010-EU6DR4570959024-6LBSQW1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P772855  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D85BD010-EU6DR4570959024-6LBSQW1MW  
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 8303.1 lumens  
Efficiency: N/A  
Efficacy: 94.7 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 87.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P772855  
CATALOG NUMBER: LD6D85BD010-EU6DR4570959024-6LBSQW1MW

### Luminous Intensity Polar Plot

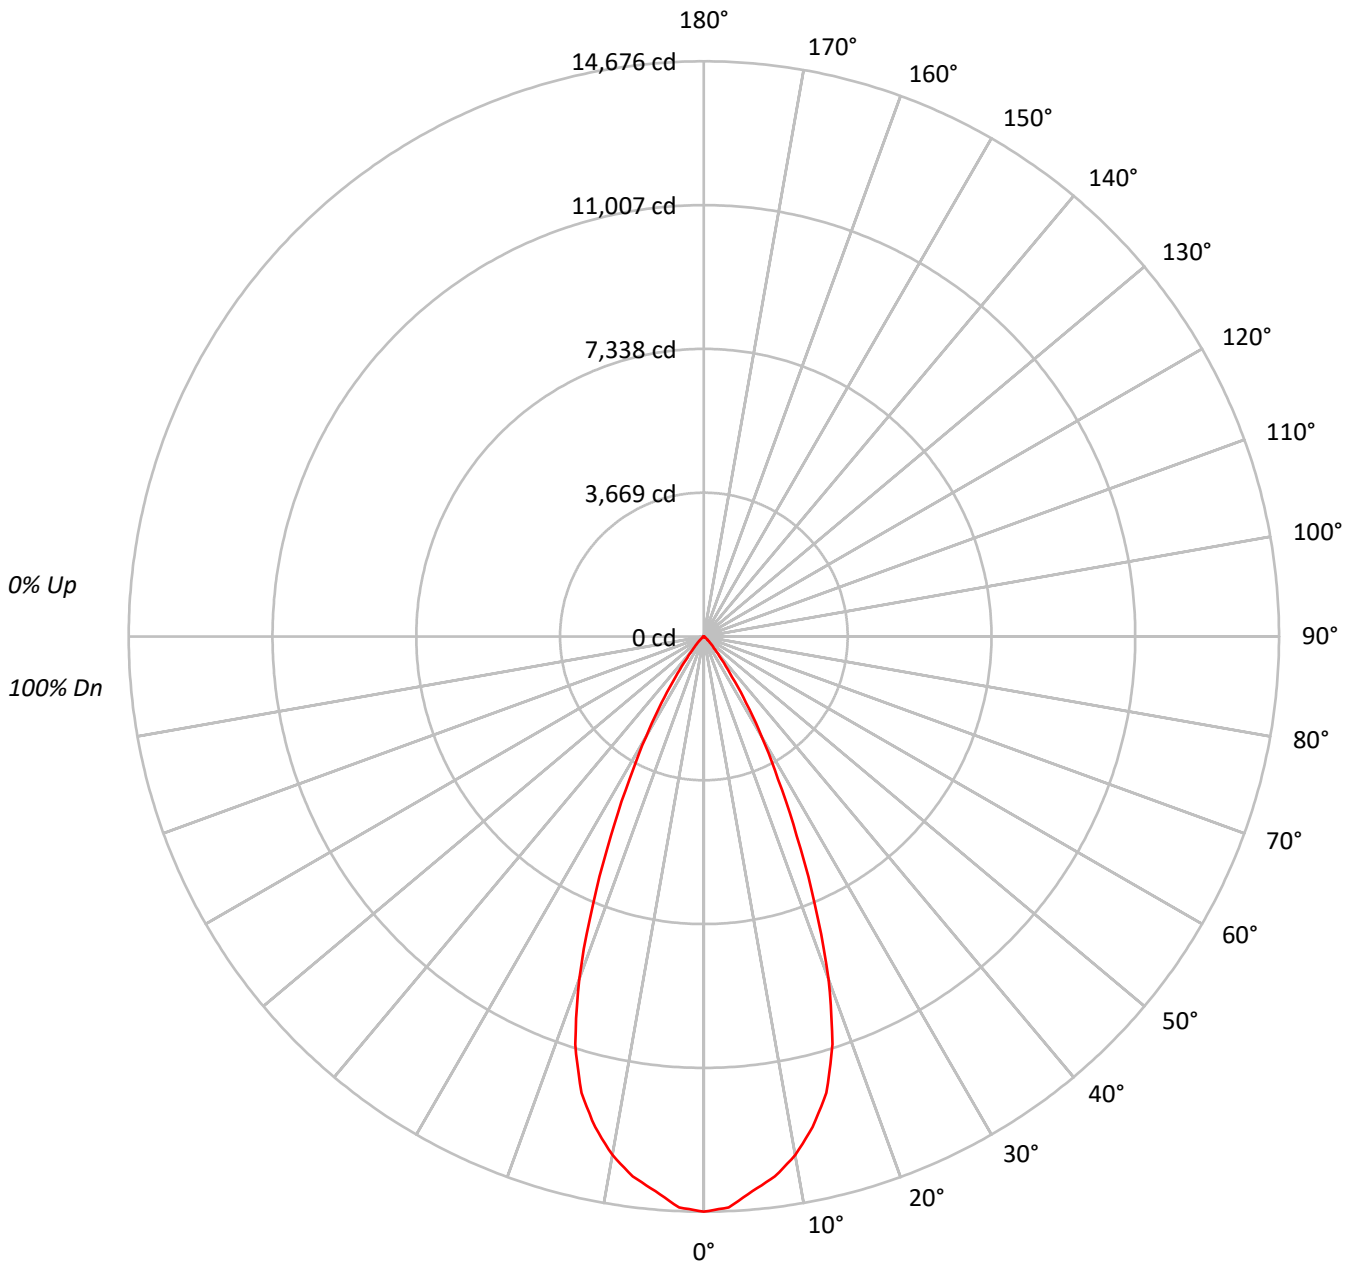



TEST NUMBER: P772855

CATALOG NUMBER: LD6D85BD010-EU6DR4570959024-6LBSQW1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1603500
5°	1557846
10°	1490441
15°	1364066
20°	1082175
25°	675619
30°	372384
35°	167209
40°	65852
45°	31043
50°	14720
55°	7696
60°	3780
65°	905
70°	383
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 31043 cd/sqm



TEST NUMBER: P772855

CATALOG NUMBER: LD6D85BD010-EU6DR4570959024-6LBSQW1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1334.6	16.1
10°-20°	3284.6	39.6
20°-30°	2601.1	31.3
30°-40°	866.2	10.4
40°-50°	171.9	2.1
50°-60°	39.0	0.5
60°-70°	5.6	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7220.2	87.0
0°-40°	8086.4	97.4
0°-60°	8297.3	99.9
0°-90°	8303.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8303.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	14676	
5°	14204	###
15°	12059	3285
25°	5604	2601
35°	1254	866
45°	201	172
55°	40	39
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P772855

CATALOG NUMBER: LD6D85BD010-EU6DR4570959024-6LBSQW1MW

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	14675.9
2.5°	14580.1
5°	14203.8
7.5°	13893.3
10°	13433.9
12.5°	12822.1
15°	12059.1
17.5°	10911.7
20°	9307.2
22.5°	7395.7
25°	5604.2
27.5°	4103.6
30°	2951.6
32.5°	2007.3
35°	1253.6
37.5°	743.4
40°	461.7
42.5°	303.6
45°	200.9
47.5°	129.3
50°	86.6
52.5°	57.7
55°	40.4
57.5°	26.5
60°	17.3
62.5°	9.2
65°	3.5
67.5°	1.2
70°	1.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)