

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772712

Luminaire Tested: LD6D85BD010-EU6DR3570959027-6LBSQW1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P772712  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D85BD010-EU6DR3570959027-6LBSQW1MW  
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 8729.9 lumens  
Efficiency: N/A  
Efficacy: 99.5 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 87.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P772712  
CATALOG NUMBER: LD6D85BD010-EU6DR3570959027-6LBSQW1MW

### Luminous Intensity Polar Plot

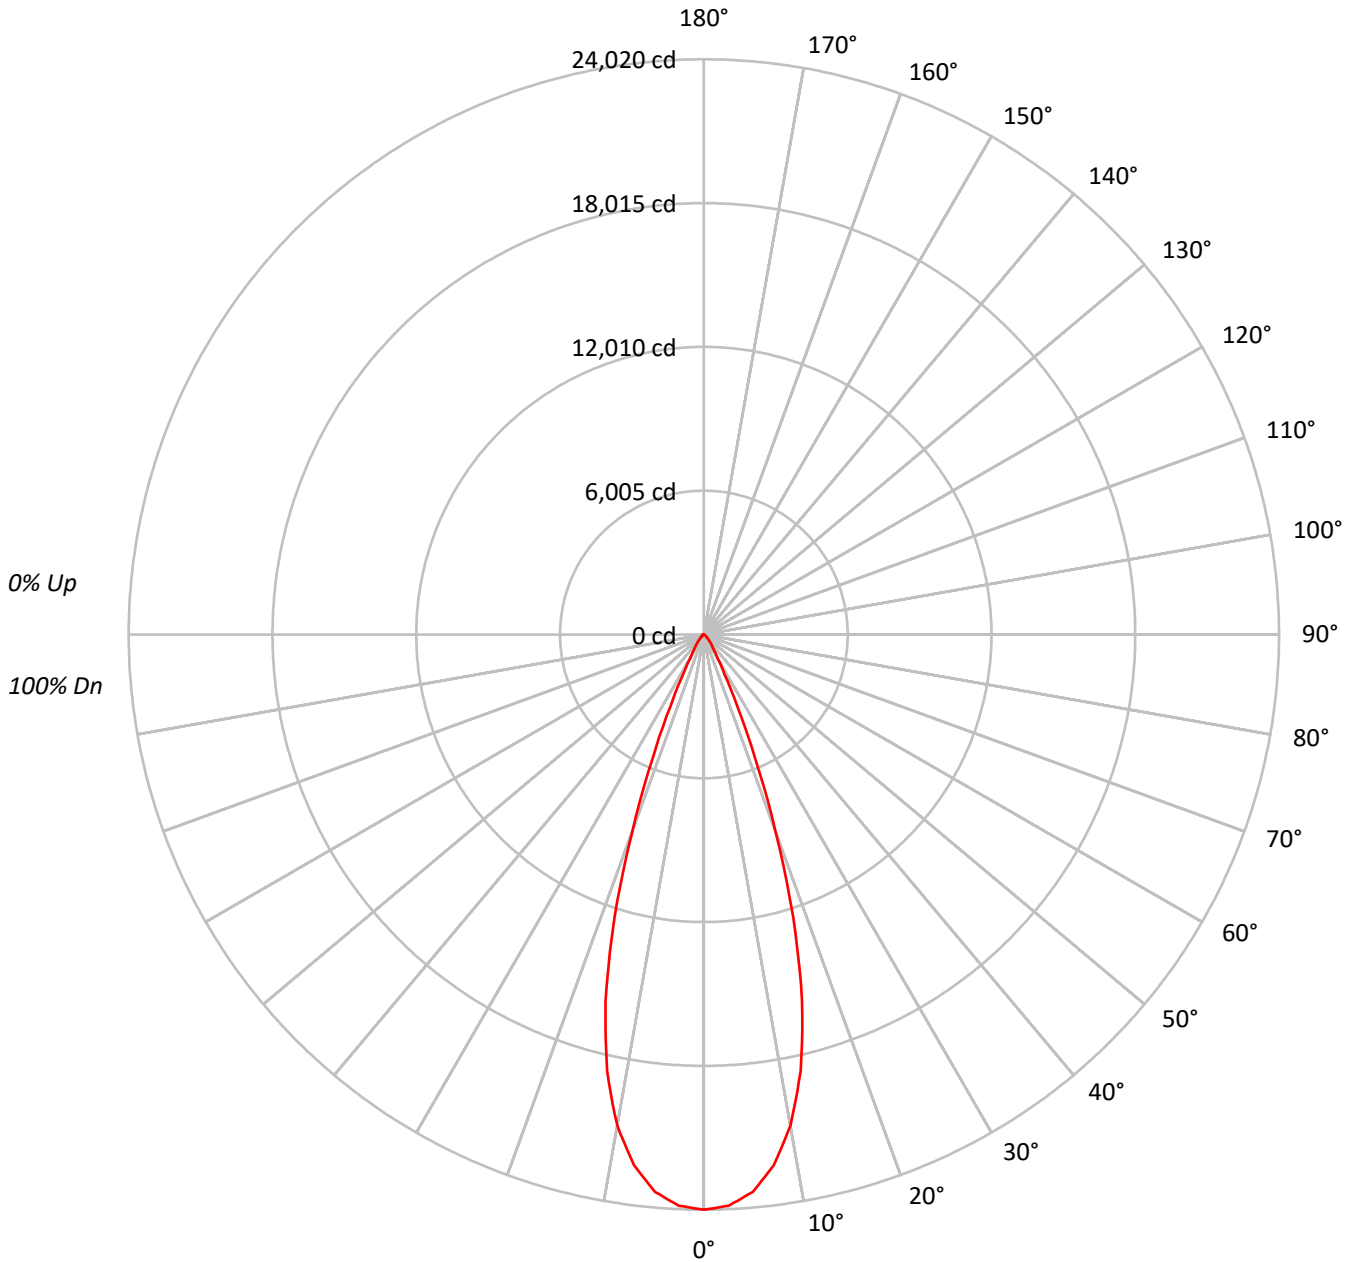



TEST NUMBER: P772712

CATALOG NUMBER: LD6D85BD010-EU6DR3570959027-6LBSQW1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|-----|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF  | 20  |     |     |     |     |     |     |     |     | 20  |     |     |     |     |     |     |     |     | 20 |    |     |  |  |  |  |  |  | 20 |  |  |  |  |  |  |  |  |   |
| RC  | 80  |     |     |     |     |     |     |     |     | 50  |     |     |     |     |     |     |     |     | 30 |    |     |  |  |  |  |  |  | 10 |  |  |  |  |  |  |  |  | 0 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0   |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    | 100 |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 1   | 115 | 112 | 110 | 108 | 112 | 110 | 108 | 107 | 106 | 105 | 103 | 103 | 101 | 100 | 99  | 98  | 98  | 96  |    |    | 96  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 2   | 110 | 106 | 103 | 101 | 108 | 105 | 102 | 99  | 102 | 99  | 97  | 99  | 97  | 95  | 96  | 95  | 93  | 92  |    |    | 92  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 3   | 106 | 101 | 97  | 94  | 105 | 100 | 96  | 93  | 97  | 95  | 92  | 95  | 93  | 91  | 93  | 91  | 89  | 88  |    |    | 88  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 4   | 103 | 97  | 92  | 89  | 101 | 96  | 92  | 89  | 94  | 90  | 88  | 92  | 89  | 87  | 90  | 88  | 86  | 84  |    |    | 84  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 5   | 99  | 93  | 88  | 85  | 98  | 92  | 87  | 84  | 90  | 86  | 84  | 89  | 85  | 83  | 87  | 84  | 82  | 81  |    |    | 81  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 6   | 96  | 89  | 84  | 81  | 94  | 88  | 84  | 81  | 87  | 83  | 80  | 85  | 82  | 80  | 84  | 81  | 79  | 78  |    |    | 78  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 7   | 93  | 85  | 81  | 78  | 91  | 85  | 80  | 77  | 84  | 80  | 77  | 83  | 79  | 77  | 82  | 79  | 76  | 75  |    |    | 75  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 8   | 90  | 82  | 78  | 74  | 88  | 82  | 77  | 74  | 81  | 77  | 74  | 80  | 76  | 74  | 79  | 76  | 73  | 72  |    |    | 72  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 9   | 87  | 79  | 75  | 72  | 86  | 79  | 75  | 72  | 78  | 74  | 71  | 77  | 74  | 71  | 77  | 73  | 71  | 70  |    |    | 70  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |
| 10  | 84  | 77  | 72  | 69  | 83  | 76  | 72  | 69  | 76  | 72  | 69  | 75  | 71  | 69  | 74  | 71  | 69  | 68  |    |    | 68  |  |  |  |  |  |  |    |  |  |  |  |  |  |  |  |   |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 2624454 |
| 5°  | 2562794 |
| 10° | 2309757 |
| 15° | 1792738 |
| 20° | 1016818 |
| 25° | 395592  |
| 30° | 147586  |
| 35° | 80897   |
| 40° | 52873   |
| 45° | 32186   |
| 50° | 20483   |
| 55° | 14477   |
| 60° | 10598   |
| 65° | 5765    |
| 70° | 415     |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 32186 cd/sqm



TEST NUMBER: P772712

CATALOG NUMBER: LD6D85BD010-EU6DR3570959027-6LBSQW1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 2149.0 | 24.6      |
| 10°-20°   | 4195.8 | 48.1      |
| 20°-30°   | 1711.2 | 19.6      |
| 30°-40°   | 409.5  | 4.7       |
| 40°-50°   | 170.7  | 2.0       |
| 50°-60°   | 70.7   | 0.8       |
| 60°-70°   | 22.1   | 0.3       |
| 70°-80°   | 0.5    | 0.0       |
| 80°-90°   | 0.4    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 8056.1 | 92.3      |
| 0°-40°    | 8465.6 | 97.0      |
| 0°-60°    | 8706.9 | 99.7      |
| 0°-90°    | 8729.9 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 8729.9 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 24020 |      |
| 5°  | 23366 | ###  |
| 15° | 15849 | 4196 |
| 25° | 3281  | 1711 |
| 35° | 606   | 410  |
| 45° | 208   | 171  |
| 55° | 76    | 71   |
| 65° | 22    | 22   |
| 75° | 0     | 1    |
| 85° | 0     | 0    |
| 90° | 0     |      |



TEST NUMBER: P772712

CATALOG NUMBER: LD6D85BD010-EU6DR3570959027-6LBSQW1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |         |
|-------|---------|
| 0°    | 24020.1 |
| 2.5°  | 23876.0 |
| 5°    | 23366.5 |
| 7.5°  | 22350.0 |
| 10°   | 20818.7 |
| 12.5° | 18662.5 |
| 15°   | 15848.8 |
| 17.5° | 12407.6 |
| 20°   | 8745.1  |
| 22.5° | 5576.4  |
| 25°   | 3281.4  |
| 27.5° | 1854.9  |
| 30°   | 1169.8  |
| 32.5° | 821.3   |
| 35°   | 606.5   |
| 37.5° | 469.0   |
| 40°   | 370.7   |
| 42.5° | 285.6   |
| 45°   | 208.3   |
| 47.5° | 155.9   |
| 50°   | 120.5   |
| 52.5° | 95.6    |
| 55°   | 76.0    |
| 57.5° | 61.6    |
| 60°   | 48.5    |
| 62.5° | 35.4    |
| 65°   | 22.3    |
| 67.5° | 7.9     |
| 70°   | 1.3     |
| 72.5° | 1.3     |
| 75°   | 0.0     |
| 77.5° | 0.0     |
| 80°   | 0.0     |
| 82.5° | 1.3     |
| 85°   | 0.0     |
| 87.5° | 0.0     |
| 90°   | 0.0     |

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)