

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773118

Luminaire Tested: LD6D85BD010-EU6DR6070959035-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P773118
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D85BD010-EU6DR6070959035-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10229.8 lumens
Efficiency: N/A
Efficacy: 116.6 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P773118

CATALOG NUMBER: LD6D85BD010-EU6DR6070959035-6LBCSSQMW

Luminous Intensity Polar Plot

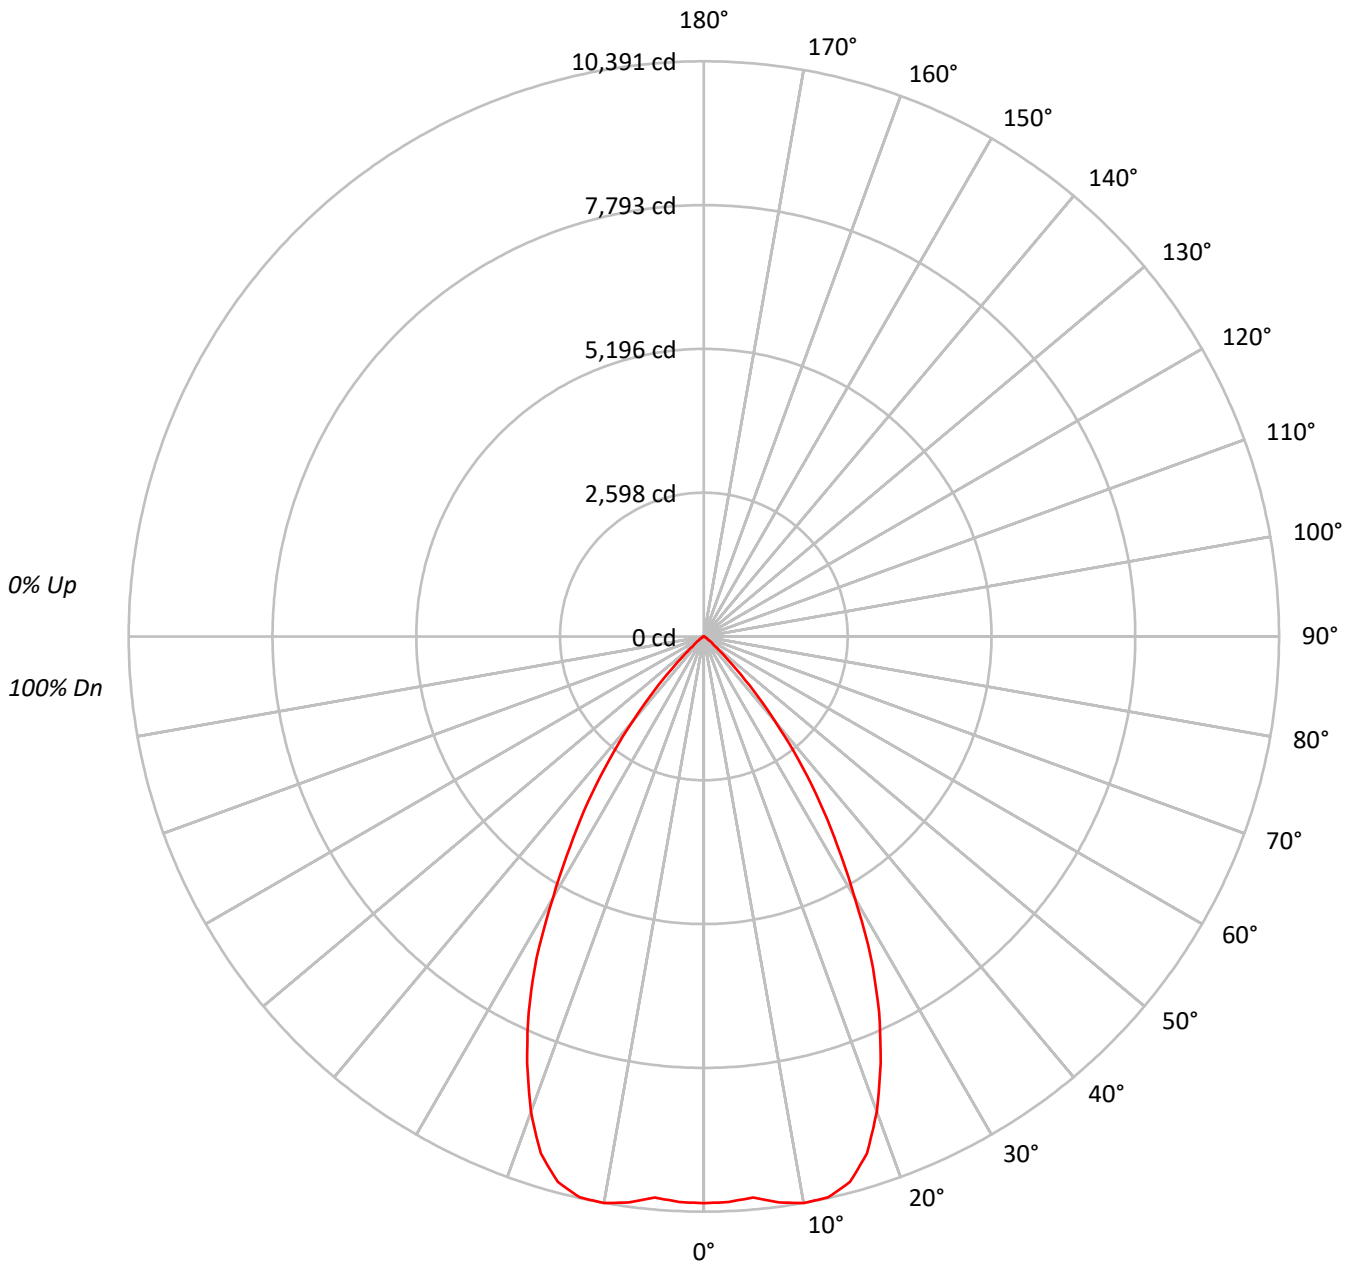



TEST NUMBER: P773118

CATALOG NUMBER: LD6D85BD010-EU6DR6070959035-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94			
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87			
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81			
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75			
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70			
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65			
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1118535
5°	1115799
10°	1152865
15°	1154045
20°	1061850
25°	903181
30°	688196
35°	486660
40°	285773
45°	115317
50°	38500
55°	18535
60°	7605
65°	1138
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 115317 cd/sqm



TEST NUMBER: P773118

CATALOG NUMBER: LD6D85BD010-EU6DR6070959035-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	981.4	9.6
10°-20°	2826.4	27.6
20°-30°	3382.9	33.1
30°-40°	2262.6	22.1
40°-50°	670.8	6.6
50°-60°	96.4	0.9
60°-70°	9.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7190.7	70.3
0°-40°	9453.3	92.4
0°-60°	10220.6	99.9
0°-90°	10229.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10229.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10237	
5°	10173	981
15°	10202	2826
25°	7492	3383
35°	3649	2263
45°	746	671
55°	97	96
65°	4	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P773118

CATALOG NUMBER: LD6D85BD010-EU6DR6070959035-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	10237.3
2.5°	10224.2
5°	10173.4
7.5°	10311.3
10°	10391.2
12.5°	10376.7
15°	10202.4
17.5°	9791.6
20°	9132.4
22.5°	8341.1
25°	7491.8
27.5°	6535.0
30°	5454.8
32.5°	4490.7
35°	3648.6
37.5°	2805.1
40°	2003.6
42.5°	1321.2
45°	746.3
47.5°	381.8
50°	226.5
52.5°	146.6
55°	97.3
57.5°	62.4
60°	34.8
62.5°	14.5
65°	4.4
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)