

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772675

Luminaire Tested: LD6D85BD010-EU6DR3070959050-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P772675
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D85BD010-EU6DR3070959050-6LBCSSQMMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9775.1 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P772675

CATALOG NUMBER: LD6D85BD010-EU6DR3070959050-6LBCSSQMMS

Luminous Intensity Polar Plot

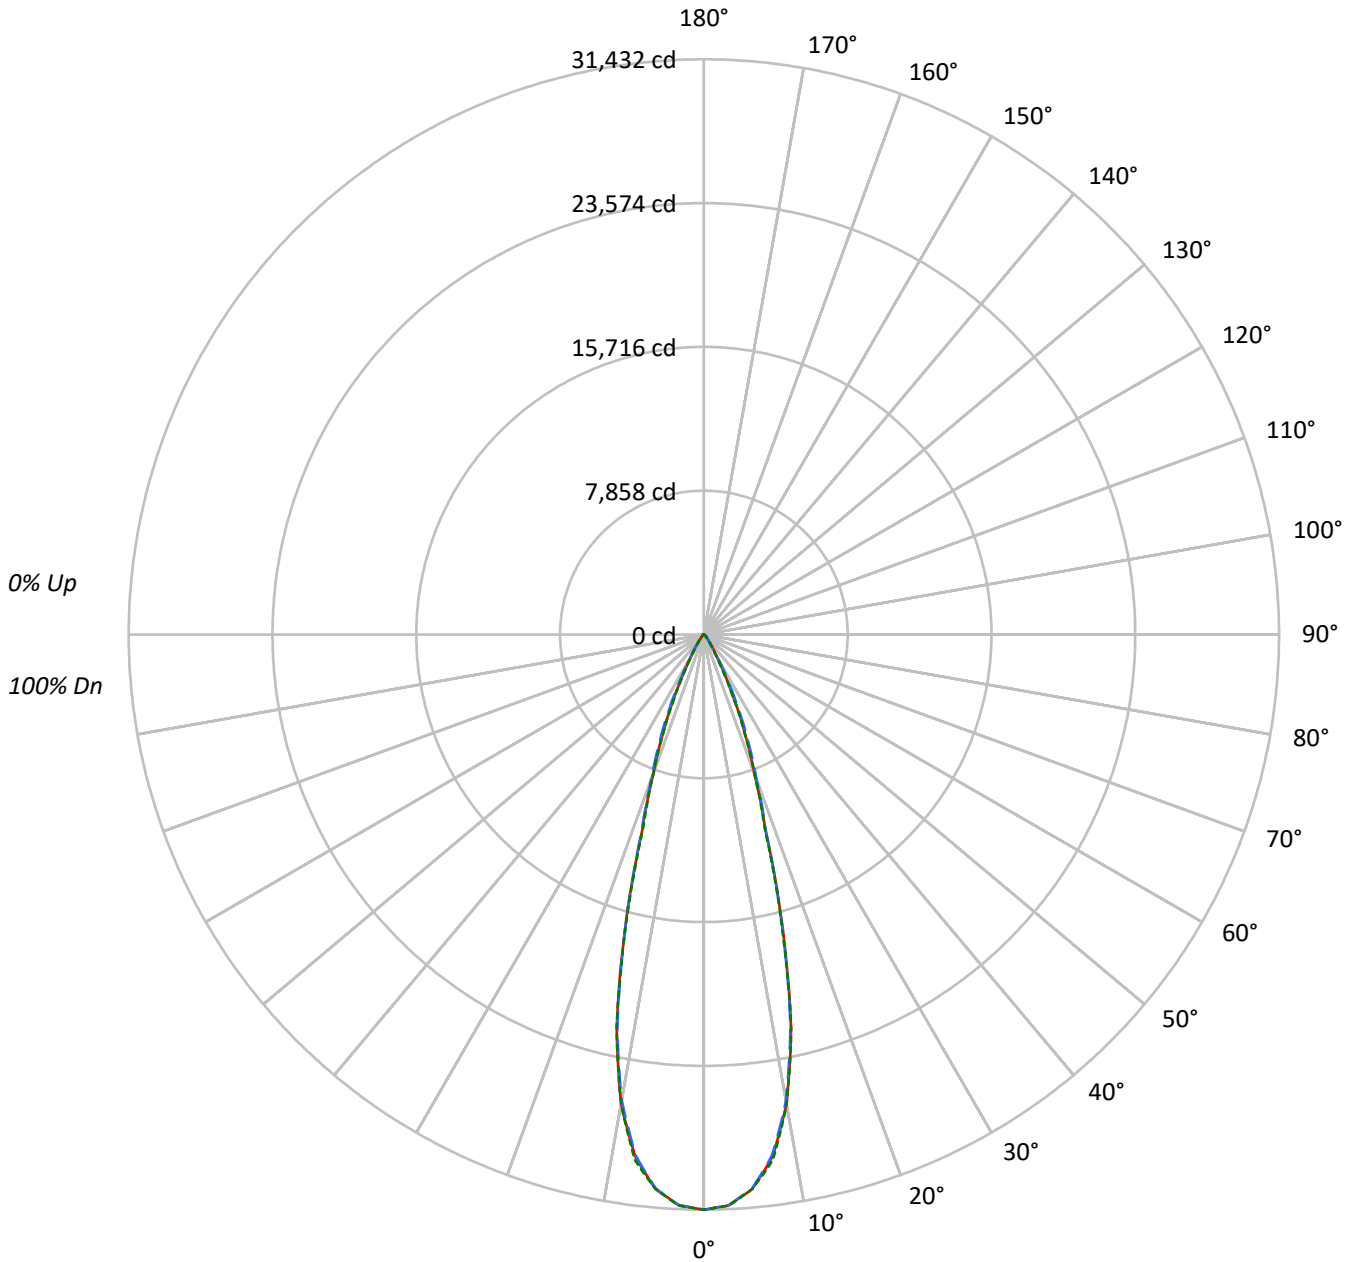



TEST NUMBER: P772675

CATALOG NUMBER: LD6D85BD010-EU6DR3070959050-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2405897	2405897	2405897
5°	2336830	2334102	2336945
10°	2024047	2009777	2023573
15°	1320594	1313502	1306893
20°	656672	681304	655792
25°	330782	373010	324008
30°	132436	144306	115386
35°	61429	58831	49319
40°	26519	29457	24980
45°	18705	23219	18879
50°	6430	16909	6799
55°	3710	7006	3910
60°	2602	3077	2602
65°	1684	1684	1684
70°	1029	694	1029
75°	0	444	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 23219 cd/sqm



TEST NUMBER: P772675

CATALOG NUMBER: LD6D85BD010-EU6DR3070959050-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2764.0	28.3
10°-20°	4451.4	45.5
20°-30°	1923.6	19.7
30°-40°	438.4	4.5
40°-50°	150.5	1.5
50°-60°	36.8	0.4
60°-70°	9.5	0.1
70°-80°	1.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9138.9	93.5
0°-40°	9577.3	98.0
0°-60°	9764.6	99.9
0°-90°	9775.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9775.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	31432	31432	31432	31432	31432	
5°	30413	30384	30378	30441	30415	2766
15°	16665	16464	16576	16522	16492	4462
25°	3917	4065	4417	3961	3836	1875
35°	657	671	630	625	528	446
45°	173	214	214	214	174	123
55°	28	29	52	31	29	27
65°	9	9	9	9	9	9
75°	0	0	2	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P772675

CATALOG NUMBER: LD6D85BD010-EU6DR3070959050-6LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	31431.8	31431.8	31431.8	31431.8	31431.8
2.5°	31223.5	31201.9	31214.2	31229.6	31235.8
5°	30413.3	30384.0	30377.8	30441.1	30414.8
7.5°	28779.1	28737.4	28674.1	28817.6	28951.9
10°	26041.4	25995.1	25857.8	25925.7	26035.3
12.5°	21999.8	21850.1	21847.0	22063.1	22033.7
15°	16665.0	16464.4	16575.5	16521.5	16492.1
17.5°	11206.7	11129.5	11277.7	11232.9	11040.0
20°	8061.7	8081.7	8364.1	8222.1	8050.9
22.5°	5882.7	5955.2	6290.1	5924.3	5790.1
25°	3916.6	4064.8	4416.6	3961.4	3836.4
27.5°	2408.9	2476.8	2833.3	2378.1	2310.2
30°	1498.4	1464.5	1632.7	1401.2	1305.5
32.5°	983.0	939.8	993.8	892.0	814.8
35°	657.4	671.3	629.6	625.0	527.8
37.5°	410.5	472.2	416.7	444.4	339.5
40°	265.4	342.6	294.8	325.6	250.0
42.5°	217.6	263.9	242.3	257.7	222.2
45°	172.8	214.5	214.5	214.5	174.4
47.5°	95.7	143.5	183.6	146.6	101.9
50°	54.0	72.5	142.0	75.6	57.1
52.5°	37.0	41.7	97.2	43.2	38.6
55°	27.8	29.3	52.5	30.9	29.3
57.5°	21.6	23.1	27.8	23.1	21.6
60°	17.0	17.0	20.1	18.5	17.0
62.5°	12.3	12.3	13.9	12.3	12.3
65°	9.3	9.3	9.3	9.3	9.3
67.5°	4.6	6.2	6.2	6.2	6.2
70°	4.6	3.1	3.1	3.1	4.6
72.5°	3.1	1.5	1.5	1.5	1.5
75°	0.0	0.0	1.5	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)