

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772988

Luminaire Tested: LD6D85BD010-EU6DR5070959050-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P772988
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D85BD010-EU6DR5070959050-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11036.9 lumens
Efficiency: N/A
Efficacy: 125.8 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P772988

CATALOG NUMBER: LD6D85BD010-EU6DR5070959050-6LBCSSQMW

Luminous Intensity Polar Plot

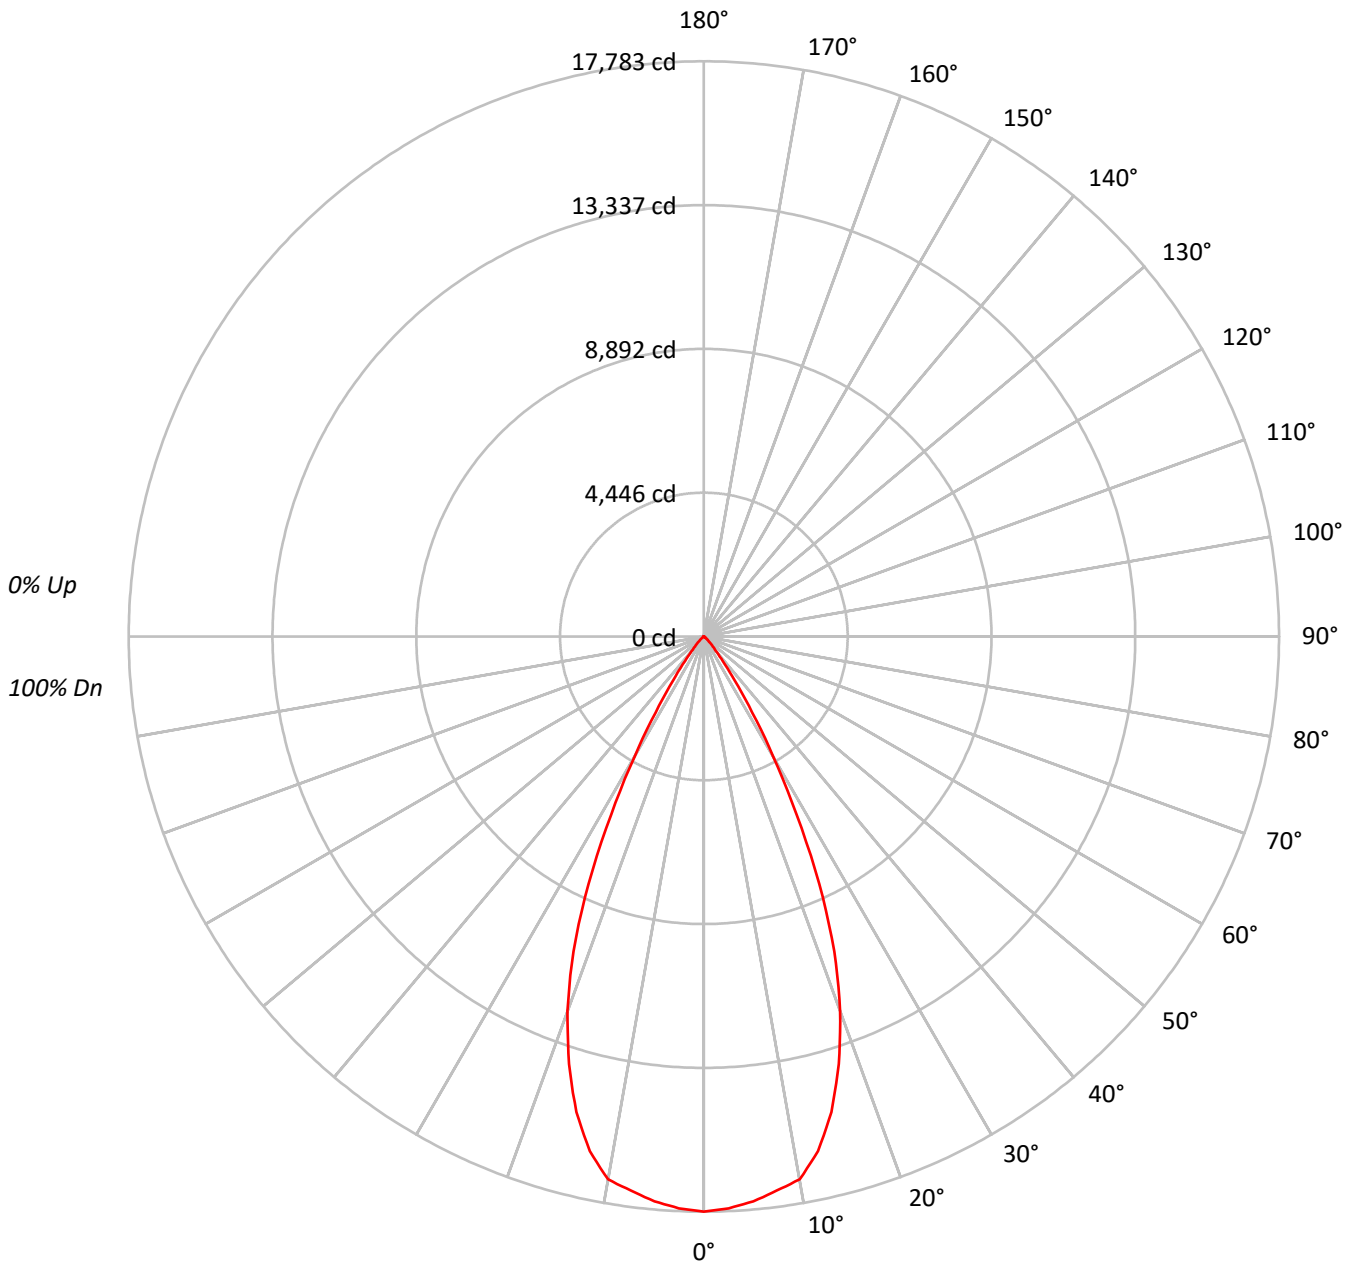



TEST NUMBER: P772988

CATALOG NUMBER: LD6D85BD010-EU6DR5070959050-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	102		102	101	99		98	97	97	95
2	109	105	101	98	107	103	100	97	100	98	95		97	95	93		95	93	91	90
3	105	99	95	91	103	98	94	90	95	92	89		93	90	88		91	88	86	85
4	100	94	89	85	99	93	88	85	90	87	84		89	85	83		87	84	82	80
5	96	89	84	80	95	88	83	79	86	82	79		85	81	78		83	80	77	76
6	92	84	79	75	91	83	79	75	82	78	74		81	77	74		79	76	74	72
7	88	80	75	71	87	79	74	71	78	74	71		77	73	70		76	73	70	69
8	85	76	71	67	84	76	71	67	75	70	67		74	70	67		73	69	66	65
9	81	73	68	64	80	72	67	64	71	67	64		71	67	64		70	66	63	62
10	78	70	64	61	77	69	64	61	68	64	61		68	64	61		67	63	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1942995
5°	1922624
10°	1890968
15°	1721871
20°	1432796
25°	1017070
30°	538339
35°	219375
40°	81470
45°	37301
50°	15298
55°	8001
60°	3933
65°	1163
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 37301 cd/sqm



TEST NUMBER: P772988

CATALOG NUMBER: LD6D85BD010-EU6DR5070959050-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1656.9	15.0
10°-20°	4187.4	37.9
20°-30°	3761.4	34.1
30°-40°	1177.7	10.7
40°-50°	206.2	1.9
50°-60°	41.1	0.4
60°-70°	6.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9605.6	87.0
0°-40°	10783.3	97.7
0°-60°	11030.6	99.9
0°-90°	11036.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11036.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	17783	
5°	17530	###
15°	15222	4187
25°	8436	3761
35°	1645	1178
45°	241	206
55°	42	41
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P772988

CATALOG NUMBER: LD6D85BD010-EU6DR5070959050-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

0°	
0°	17783.1
2.5°	17694.7
5°	17529.7
7.5°	17277.9
10°	17044.0
12.5°	16294.3
15°	15222.3
17.5°	13861.0
20°	12322.7
22.5°	10543.0
25°	8436.5
27.5°	6202.6
30°	4267.0
32.5°	2778.2
35°	1644.7
37.5°	944.6
40°	571.2
42.5°	371.8
45°	241.4
47.5°	146.9
50°	90.0
52.5°	61.5
55°	42.0
57.5°	28.5
60°	18.0
62.5°	10.5
65°	4.5
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)