

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773647

Luminaire Tested: LD6D90BD010-EU6DR4570959027-6LBSQW1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P773647  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D90BD010-EU6DR4570959027-6LBSQW1B  
Description: 6 INCH SQAURE DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 9435.2 lumens  
Efficiency: N/A  
Efficacy: 95.4 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 98.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P773647  
CATALOG NUMBER: LD6D90BD010-EU6DR4570959027-6LBSQW1B

### Luminous Intensity Polar Plot

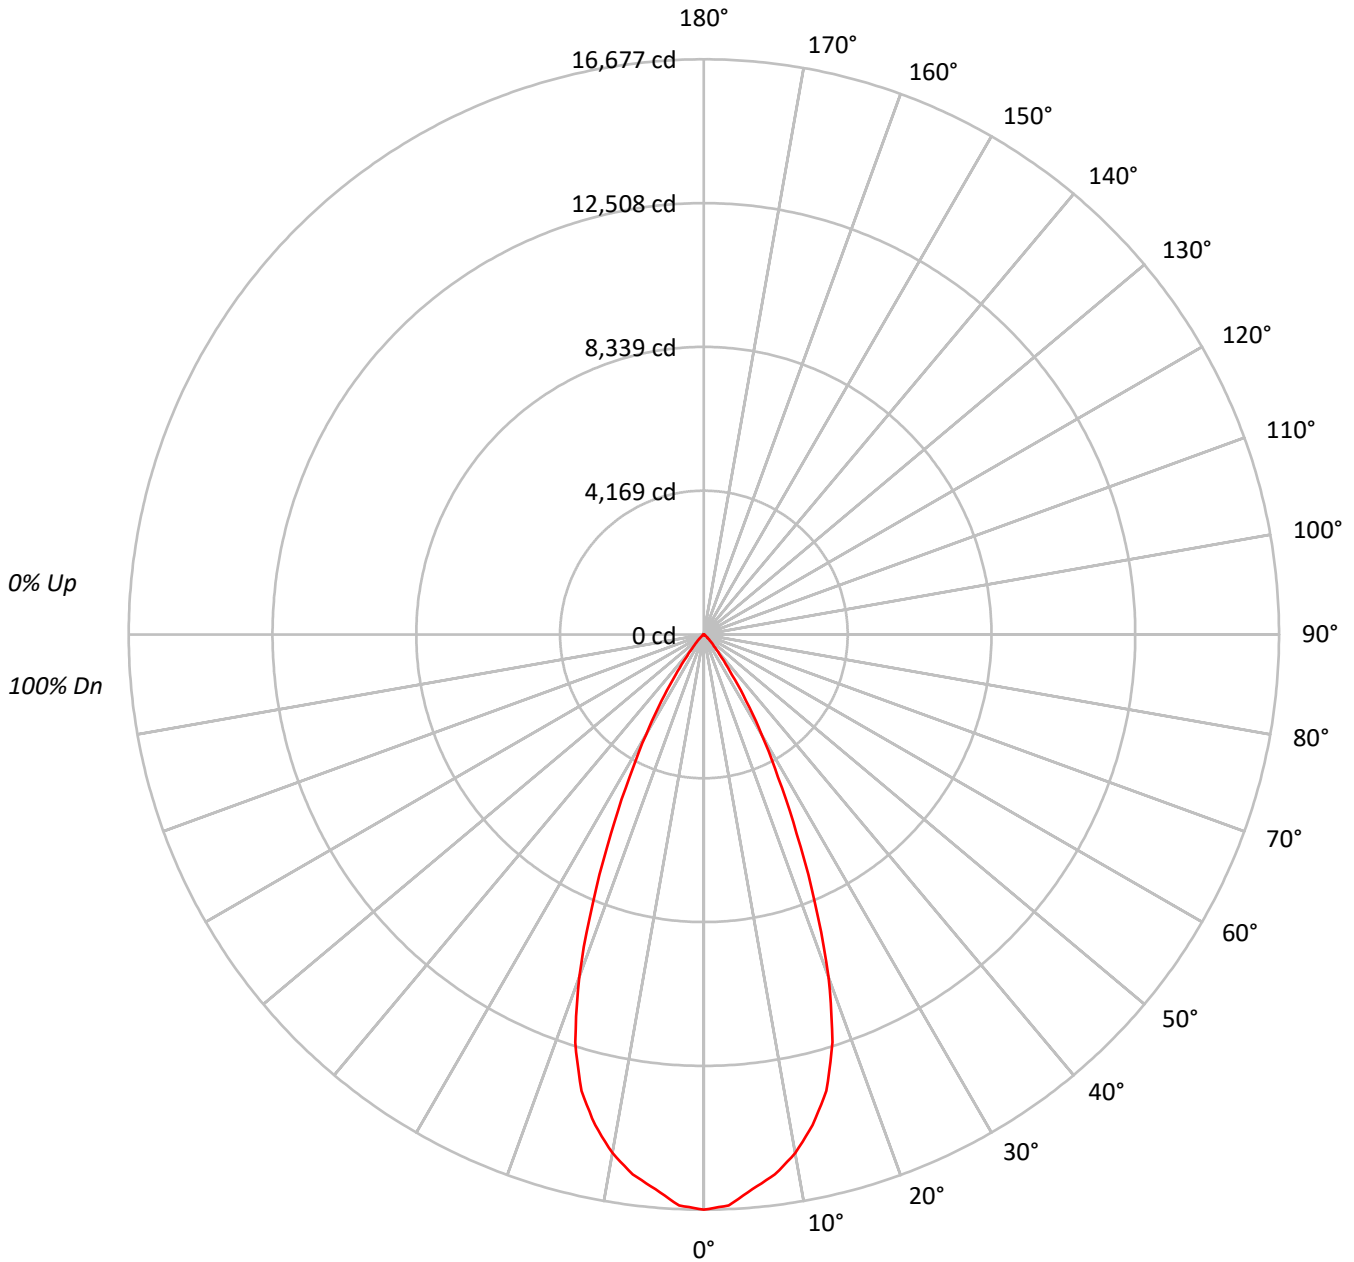



TEST NUMBER: P773647

CATALOG NUMBER: LD6D90BD010-EU6DR4570959027-6LBSQW1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95		
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85		
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81		
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77		
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73		
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69		
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66		
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63		
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60		

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1822131
5°	1770249
10°	1693650
15°	1550050
20°	1229725
25°	767736
30°	423152
35°	190004
40°	74838
45°	35261
50°	16726
55°	8744
60°	4305
65°	1008
70°	415
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 35261 cd/sqm



TEST NUMBER: P773647

CATALOG NUMBER: LD6D90BD010-EU6DR4570959027-6LBSQW1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1516.5	16.1
10°-20°	3732.4	39.6
20°-30°	2955.7	31.3
30°-40°	984.3	10.4
40°-50°	195.3	2.1
50°-60°	44.4	0.5
60°-70°	6.4	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8204.6	87.0
0°-40°	9188.9	97.4
0°-60°	9428.6	99.9
0°-90°	9435.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9435.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	16677	
5°	16140	###
15°	13703	3732
25°	6368	2956
35°	1424	984
45°	228	195
55°	46	44
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P773647

CATALOG NUMBER: LD6D90BD010-EU6DR4570959027-6LBSQW1B

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	16676.9
2.5°	16568.0
5°	16140.4
7.5°	15787.6
10°	15265.5
12.5°	14570.3
15°	13703.3
17.5°	12399.5
20°	10576.2
22.5°	8404.0
25°	6368.3
27.5°	4663.1
30°	3354.0
32.5°	2281.0
35°	1424.5
37.5°	844.7
40°	524.7
42.5°	345.0
45°	228.2
47.5°	146.9
50°	98.4
52.5°	65.6
55°	45.9
57.5°	30.2
60°	19.7
62.5°	10.5
65°	3.9
67.5°	1.3
70°	1.3
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)