

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773531

Luminaire Tested: LD6D90BD010-EU6DR3570959040-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P773531
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D90BD010-EU6DR3570959040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10092.3 lumens
Efficiency: N/A
Efficacy: 102.0 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P773531
CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBSQW1MW

Luminous Intensity Polar Plot

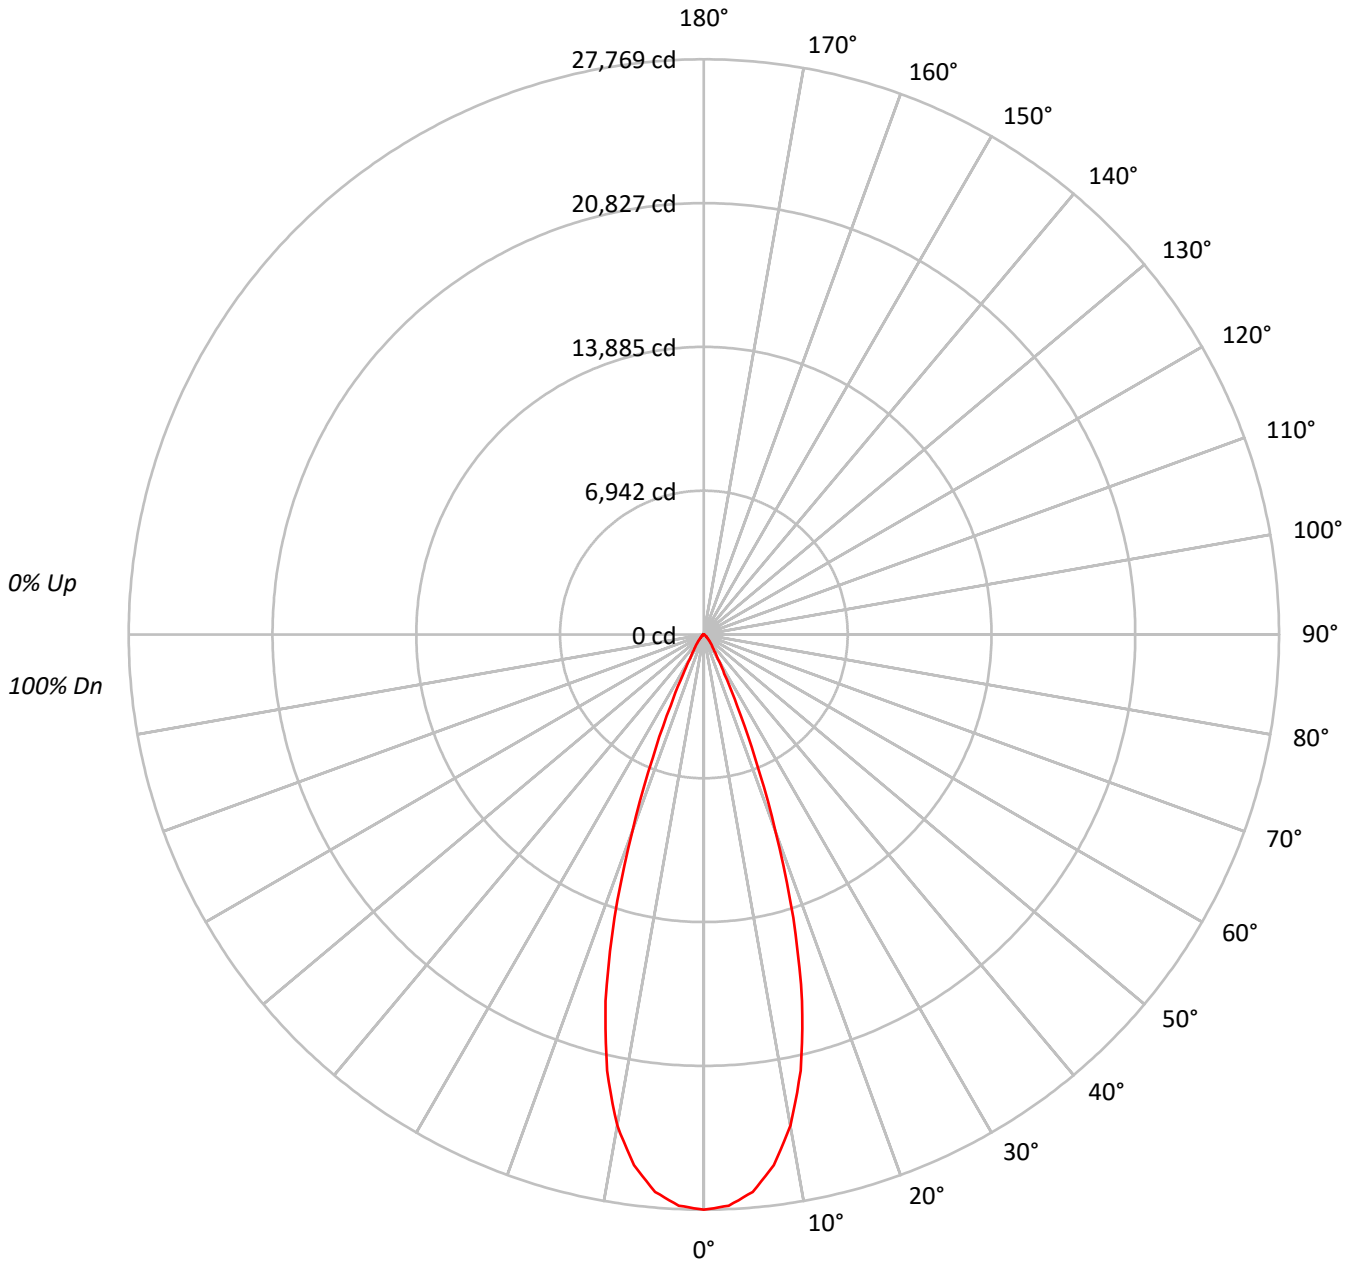



TEST NUMBER: P773531

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3034051
5°	2962757
10°	2670233
15°	2072528
20°	1175507
25°	457329
30°	170611
35°	93528
40°	61131
45°	37208
50°	23678
55°	16725
60°	12237
65°	6644
70°	479
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 37208 cd/sqm



TEST NUMBER: P773531

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2484.4	24.6
10°-20°	4850.7	48.1
20°-30°	1978.3	19.6
30°-40°	473.4	4.7
40°-50°	197.3	2.0
50°-60°	81.6	0.8
60°-70°	25.6	0.3
70°-80°	0.6	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9313.4	92.3
0°-40°	9786.8	97.0
0°-60°	10065.7	99.7
0°-90°	10092.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10092.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	27769	
5°	27013	###
15°	18322	4851
25°	3794	1978
35°	701	473
45°	241	197
55°	88	82
65°	26	26
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P773531

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	27768.9
2.5°	27602.3
5°	27013.2
7.5°	25838.1
10°	24067.8
12.5°	21575.2
15°	18322.3
17.5°	14344.1
20°	10109.9
22.5°	6446.6
25°	3793.5
27.5°	2144.3
30°	1352.3
32.5°	949.5
35°	701.2
37.5°	542.1
40°	428.6
42.5°	330.1
45°	240.8
47.5°	180.2
50°	139.3
52.5°	110.5
55°	87.8
57.5°	71.2
60°	56.0
62.5°	40.9
65°	25.7
67.5°	9.1
70°	1.5
72.5°	1.5
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.5
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)