

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774248

Luminaire Tested: LD6D95BD010-EU6DR3570959024-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774248
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR3570959024-6LBCSSQMMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8805.6 lumens
Efficiency: N/A
Efficacy: 88.8 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774248
CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBCSSQMMS

Luminous Intensity Polar Plot

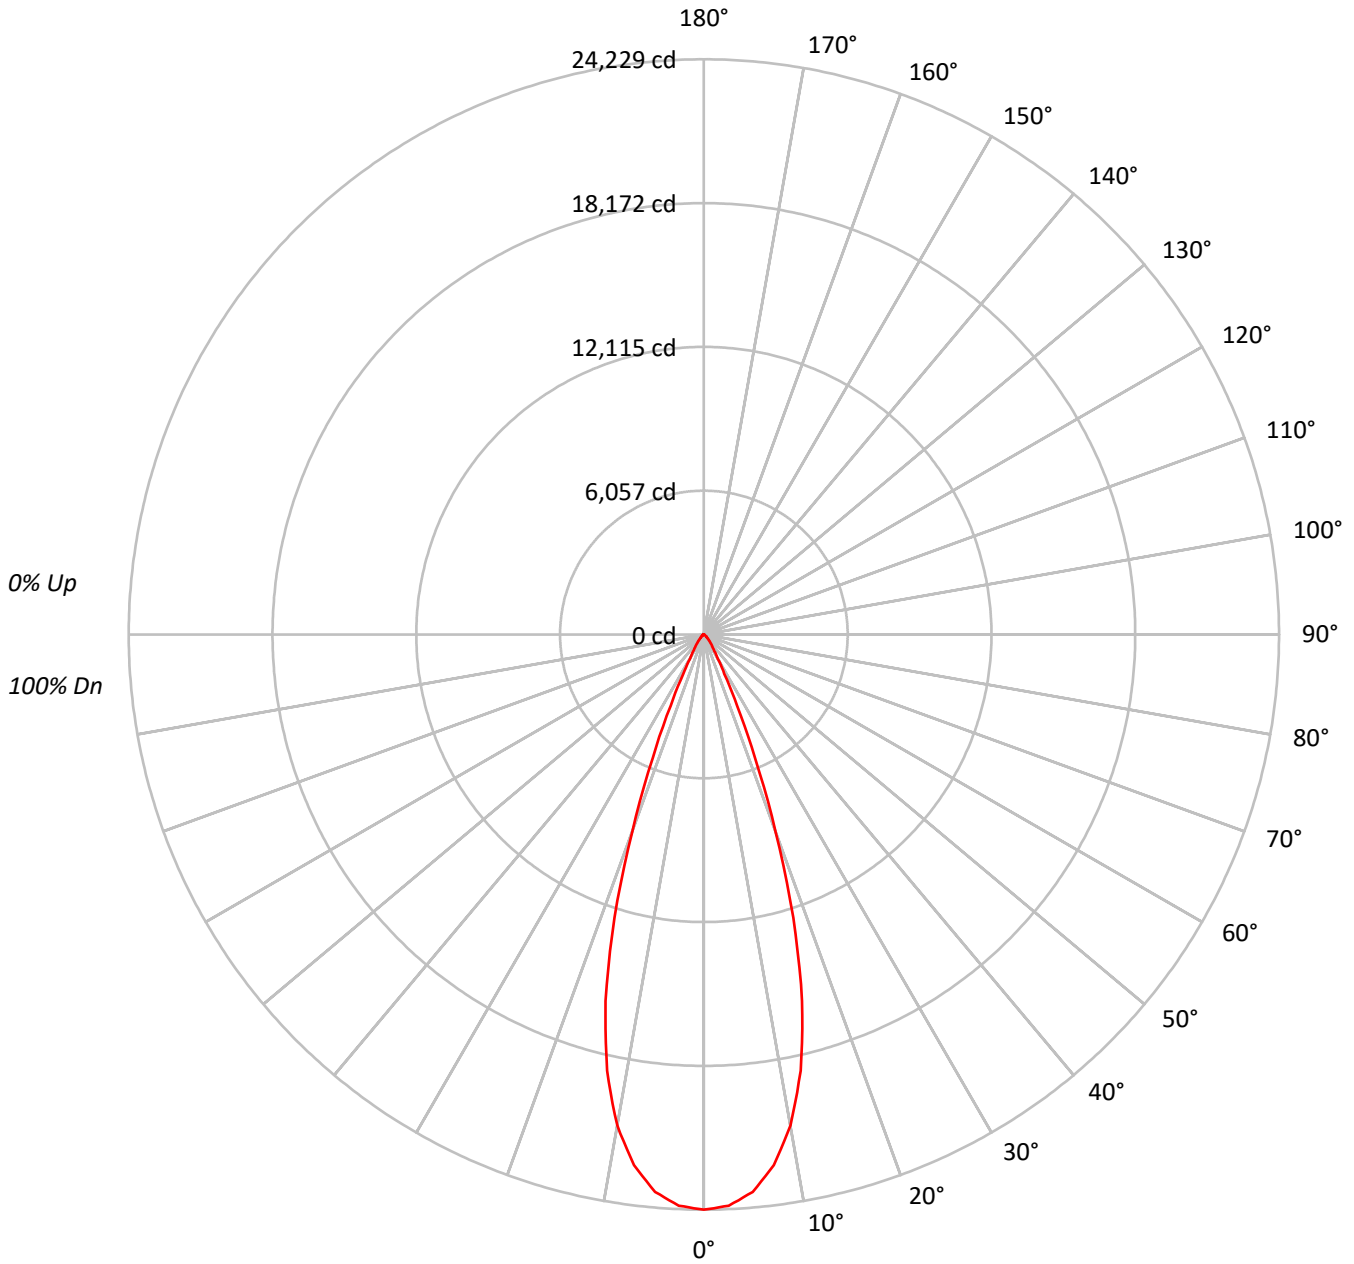



TEST NUMBER: P774248

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2647235
5°	2585036
10°	2329805
15°	1808303
20°	1025643
25°	399016
30°	148860
35°	81604
40°	53329
45°	32464
50°	20670
55°	14592
60°	10686
65°	5817
70°	415
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 32464 cd/sqm



TEST NUMBER: P774248

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2167.7	24.6
10°-20°	4232.3	48.1
20°-30°	1726.1	19.6
30°-40°	413.1	4.7
40°-50°	172.1	2.0
50°-60°	71.3	0.8
60°-70°	22.3	0.3
70°-80°	0.5	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8126.0	92.3
0°-40°	8539.1	97.0
0°-60°	8782.5	99.7
0°-90°	8805.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8805.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	24229	
5°	23569	###
15°	15986	4232
25°	3310	1726
35°	612	413
45°	210	172
55°	77	71
65°	22	22
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P774248

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBCSSQMMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	24228.6
2.5°	24083.3
5°	23569.3
7.5°	22544.0
10°	20999.4
12.5°	18824.5
15°	15986.4
17.5°	12515.3
20°	8821.0
22.5°	5624.8
25°	3309.8
27.5°	1871.0
30°	1179.9
32.5°	828.5
35°	611.8
37.5°	473.0
40°	373.9
42.5°	288.0
45°	210.1
47.5°	157.2
50°	121.6
52.5°	96.5
55°	76.6
57.5°	62.1
60°	48.9
62.5°	35.7
65°	22.5
67.5°	7.9
70°	1.3
72.5°	1.3
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)