

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774259

Luminaire Tested: LD6D95BD010-EU6DR3570959024-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774259
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR3570959024-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8374.0 lumens
Efficiency: N/A
Efficacy: 84.4 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774259

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBSQW1MW

Luminous Intensity Polar Plot

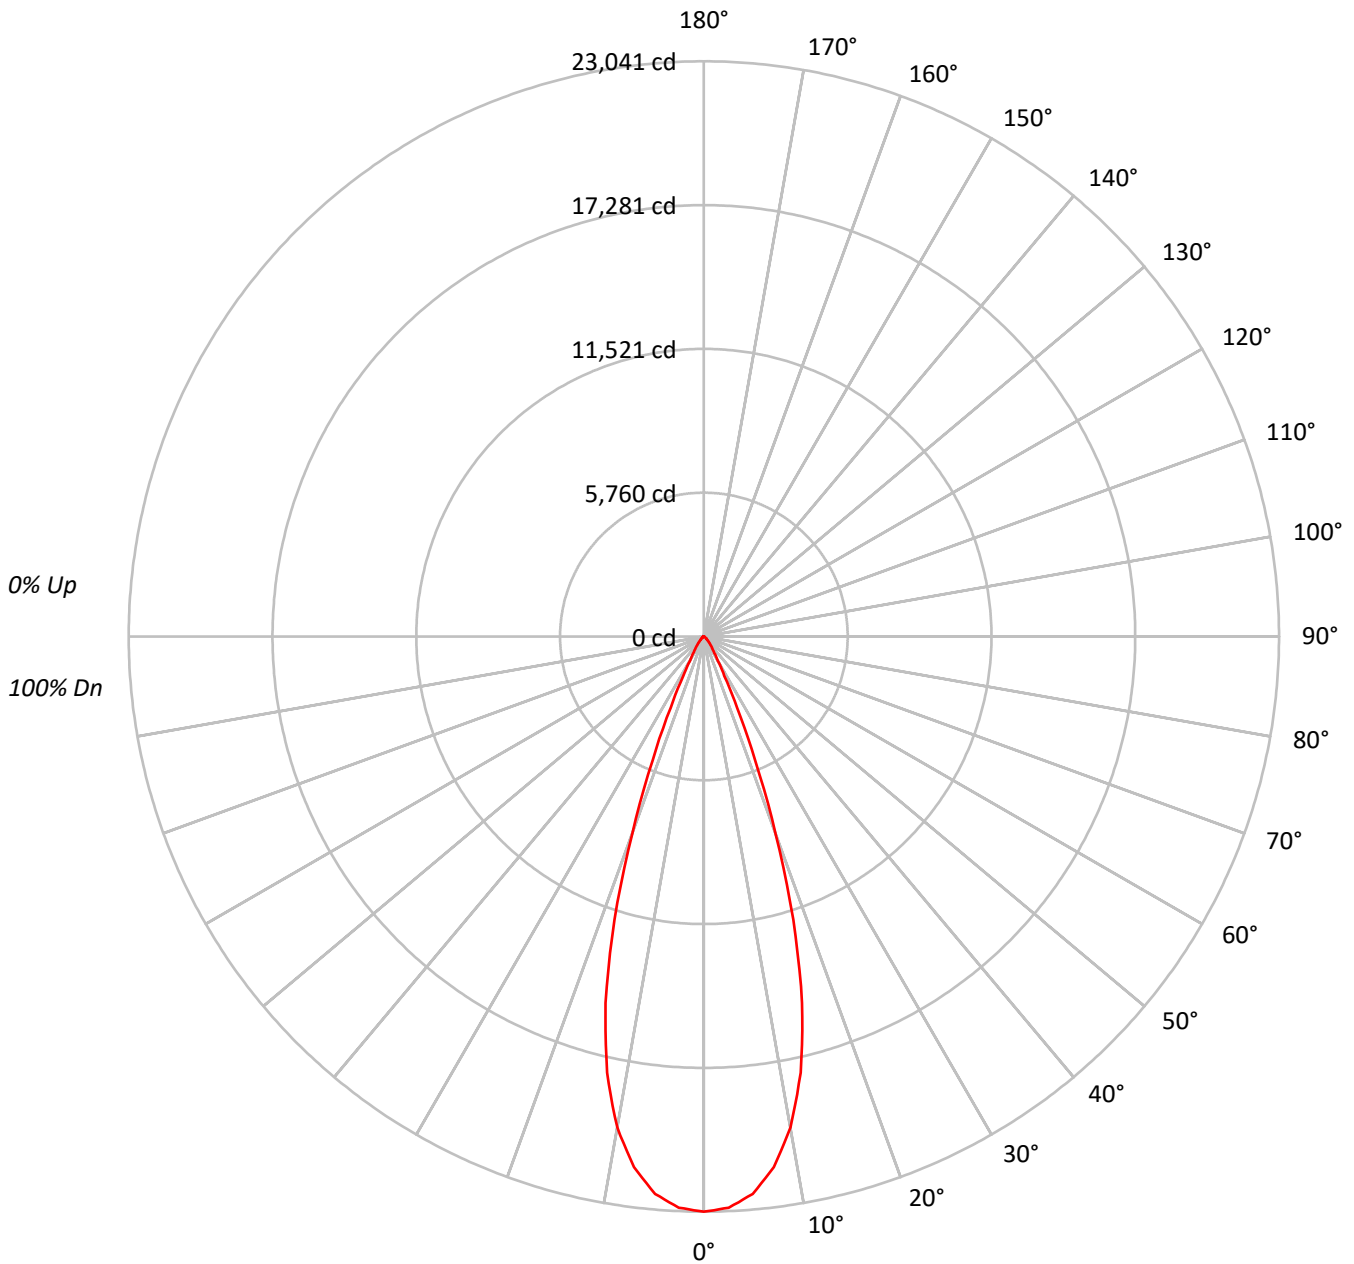



TEST NUMBER: P774259

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96																
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88																
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84																
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81																
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78																
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75																
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72																
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70																
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2517466
5°	2458303
10°	2215586
15°	1719654
20°	975355
25°	379462
30°	141568
35°	77602
40°	50719
45°	30873
50°	19650
55°	13887
60°	10161
65°	5533
70°	415
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 30873 cd/sqm



TEST NUMBER: P774259

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2061.4	24.6
10°-20°	4024.8	48.1
20°-30°	1641.4	19.6
30°-40°	392.8	4.7
40°-50°	163.7	2.0
50°-60°	67.8	0.8
60°-70°	21.2	0.3
70°-80°	0.5	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7727.6	92.3
0°-40°	8120.4	97.0
0°-60°	8351.9	99.7
0°-90°	8374.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8374.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	23041	
5°	22414	###
15°	15203	4025
25°	3148	1641
35°	582	393
45°	200	164
55°	73	68
65°	21	21
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P774259

CATALOG NUMBER: LD6D95BD010-EU6DR3570959024-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	23040.9
2.5°	22902.6
5°	22413.8
7.5°	21438.8
10°	19969.9
12.5°	17901.7
15°	15202.7
17.5°	11901.8
20°	8388.5
22.5°	5349.0
25°	3147.6
27.5°	1779.2
30°	1122.1
32.5°	787.8
35°	581.8
37.5°	449.8
40°	355.6
42.5°	273.9
45°	199.8
47.5°	149.5
50°	115.6
52.5°	91.7
55°	72.9
57.5°	59.1
60°	46.5
62.5°	33.9
65°	21.4
67.5°	7.5
70°	1.3
72.5°	1.3
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)