

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774493

Luminaire Tested: LD6D95BD010-EU6DR5070959024-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774493
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR5070959024-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9195.6 lumens
Efficiency: N/A
Efficacy: 92.7 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774493
CATALOG NUMBER: LD6D95BD010-EU6DR5070959024-6LBSQW1MW

Luminous Intensity Polar Plot

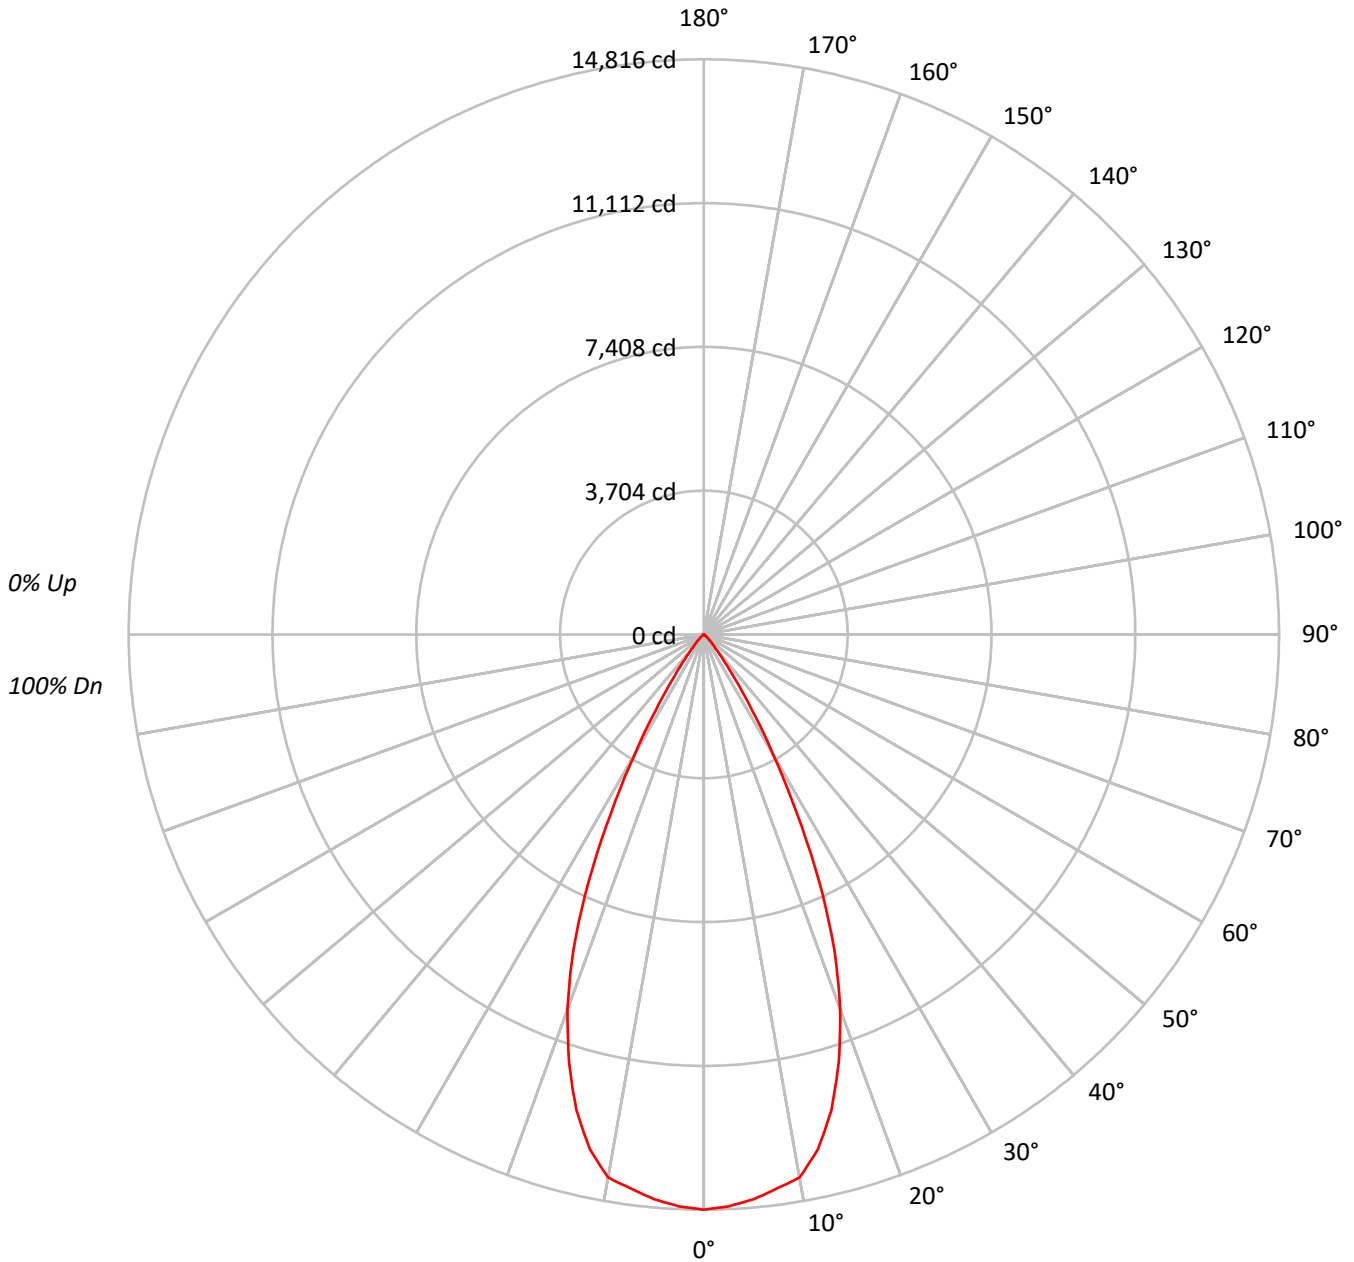



TEST NUMBER: P774493

CATALOG NUMBER: LD6D95BD010-EU6DR5070959024-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95		
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85		
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80		
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76		
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72		
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69		
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65		
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62		
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1618862
5°	1601882
10°	1575504
15°	1434627
20°	1193774
25°	847400
30°	448524
35°	182774
40°	67878
45°	31074
50°	12748
55°	6667
60°	3278
65°	957
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 31074 cd/sqm



TEST NUMBER: P774493

CATALOG NUMBER: LD6D95BD010-EU6DR5070959024-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1380.5	15.0
10°-20°	3488.8	37.9
20°-30°	3133.9	34.1
30°-40°	981.2	10.7
40°-50°	171.8	1.9
50°-60°	34.2	0.4
60°-70°	5.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8003.2	87.0
0°-40°	8984.4	97.7
0°-60°	9190.4	99.9
0°-90°	9195.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9195.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14816	
5°	14605	###
15°	12683	3489
25°	7029	3134
35°	1370	981
45°	201	172
55°	35	34
65°	4	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774493

CATALOG NUMBER: LD6D95BD010-EU6DR5070959024-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	14816.5
2.5°	14742.8
5°	14605.3
7.5°	14395.5
10°	14200.6
12.5°	13576.0
15°	12682.9
17.5°	11548.6
20°	10267.0
22.5°	8784.2
25°	7029.1
27.5°	5167.8
30°	3555.1
32.5°	2314.7
35°	1370.3
37.5°	787.0
40°	475.9
42.5°	309.8
45°	201.1
47.5°	122.4
50°	75.0
52.5°	51.2
55°	35.0
57.5°	23.7
60°	15.0
62.5°	8.7
65°	3.7
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)