

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774340

Luminaire Tested: LD6D95BD010-EU6DR4070959027-6LBCSSQMW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P774340  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D95BD010-EU6DR4070959027-6LBCSSQMW  
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 40° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 10725.8 lumens  
Efficiency: N/A  
Efficacy: 108.1 lumens/watt  
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 99.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



TEST NUMBER: P774340

CATALOG NUMBER: LD6D95BD010-EU6DR4070959027-6LBCSSQMW

### Luminous Intensity Polar Plot

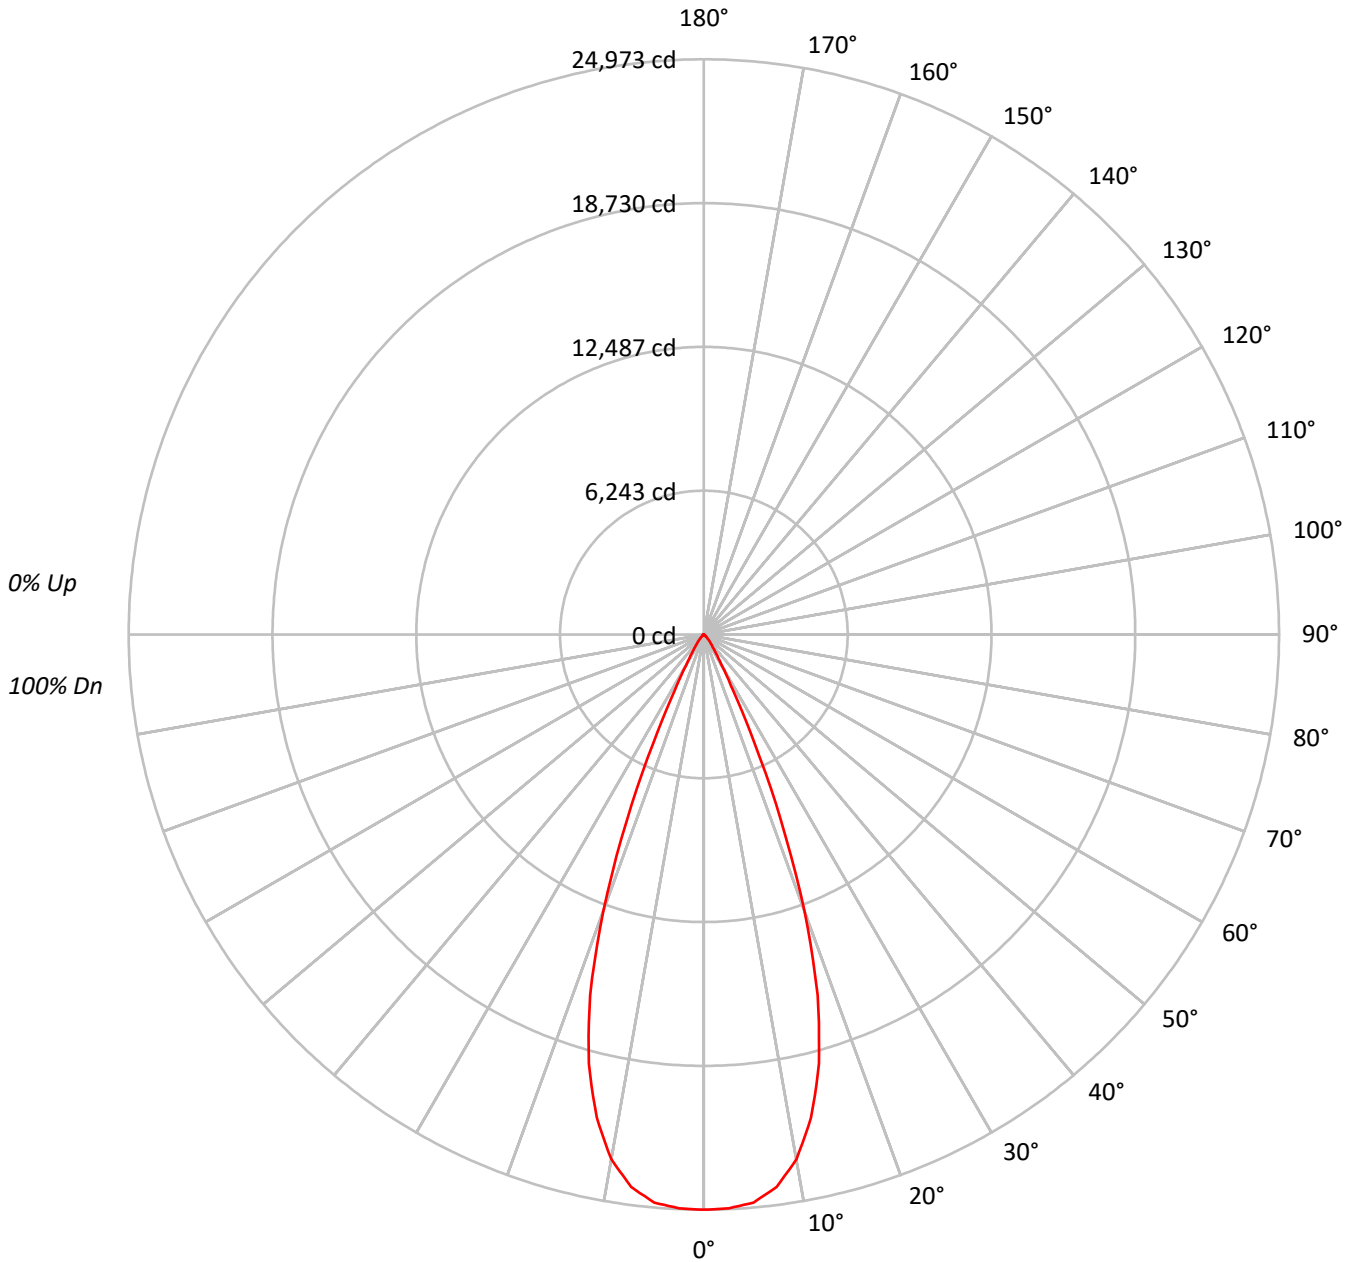



TEST NUMBER: P774340

CATALOG NUMBER: LD6D95BD010-EU6DR4070959027-6LBCSSQMW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96			96																
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88			88																
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84			84																
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81			81																
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77			77																
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74			74																
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72			72																
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69			69																
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67			67																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2728525
5°	2715268
10°	2566520
15°	2181865
20°	1487095
25°	620477
30°	195099
35°	90674
40°	50149
45°	22992
50°	11151
55°	6115
60°	3190
65°	1138
70°	479
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 22992 cd/sqm



TEST NUMBER: P774340

CATALOG NUMBER: LD6D95BD010-EU6DR4070959027-6LBCSSQMW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	2311.6	21.6
10°-20°	5178.7	48.3
20°-30°	2592.3	24.2
30°-40°	475.2	4.4
40°-50°	131.1	1.2
50°-60°	30.8	0.3
60°-70°	5.9	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10082.7	94.0
0°-40°	10557.8	98.4
0°-60°	10719.7	99.9
0°-90°	10725.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10725.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	24973	
5°	24757	###
15°	19289	5179
25°	5147	2592
35°	680	475
45°	149	131
55°	32	31
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774340

CATALOG NUMBER: LD6D95BD010-EU6DR4070959027-6LBCSSQMW

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	24972.6
2.5°	24936.1
5°	24756.7
7.5°	24184.8
10°	23133.0
12.5°	21493.2
15°	19288.9
17.5°	16422.3
20°	12789.7
22.5°	8719.5
25°	5146.8
27.5°	2720.8
30°	1546.4
32.5°	999.3
35°	679.8
37.5°	485.8
40°	351.6
42.5°	240.7
45°	148.8
47.5°	94.8
50°	65.6
52.5°	46.7
55°	32.1
57.5°	20.4
60°	14.6
62.5°	8.8
65°	4.4
67.5°	2.9
70°	1.5
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)