

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774223

Luminaire Tested: LD6D95BD010-EU6DR3070959040-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774223
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR3070959040-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10548.0 lumens
Efficiency: N/A
Efficacy: 106.3 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct


Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774223

CATALOG NUMBER: LD6D95BD010-EU6DR3070959040-6LBCSSQMW

Luminous Intensity Polar Plot

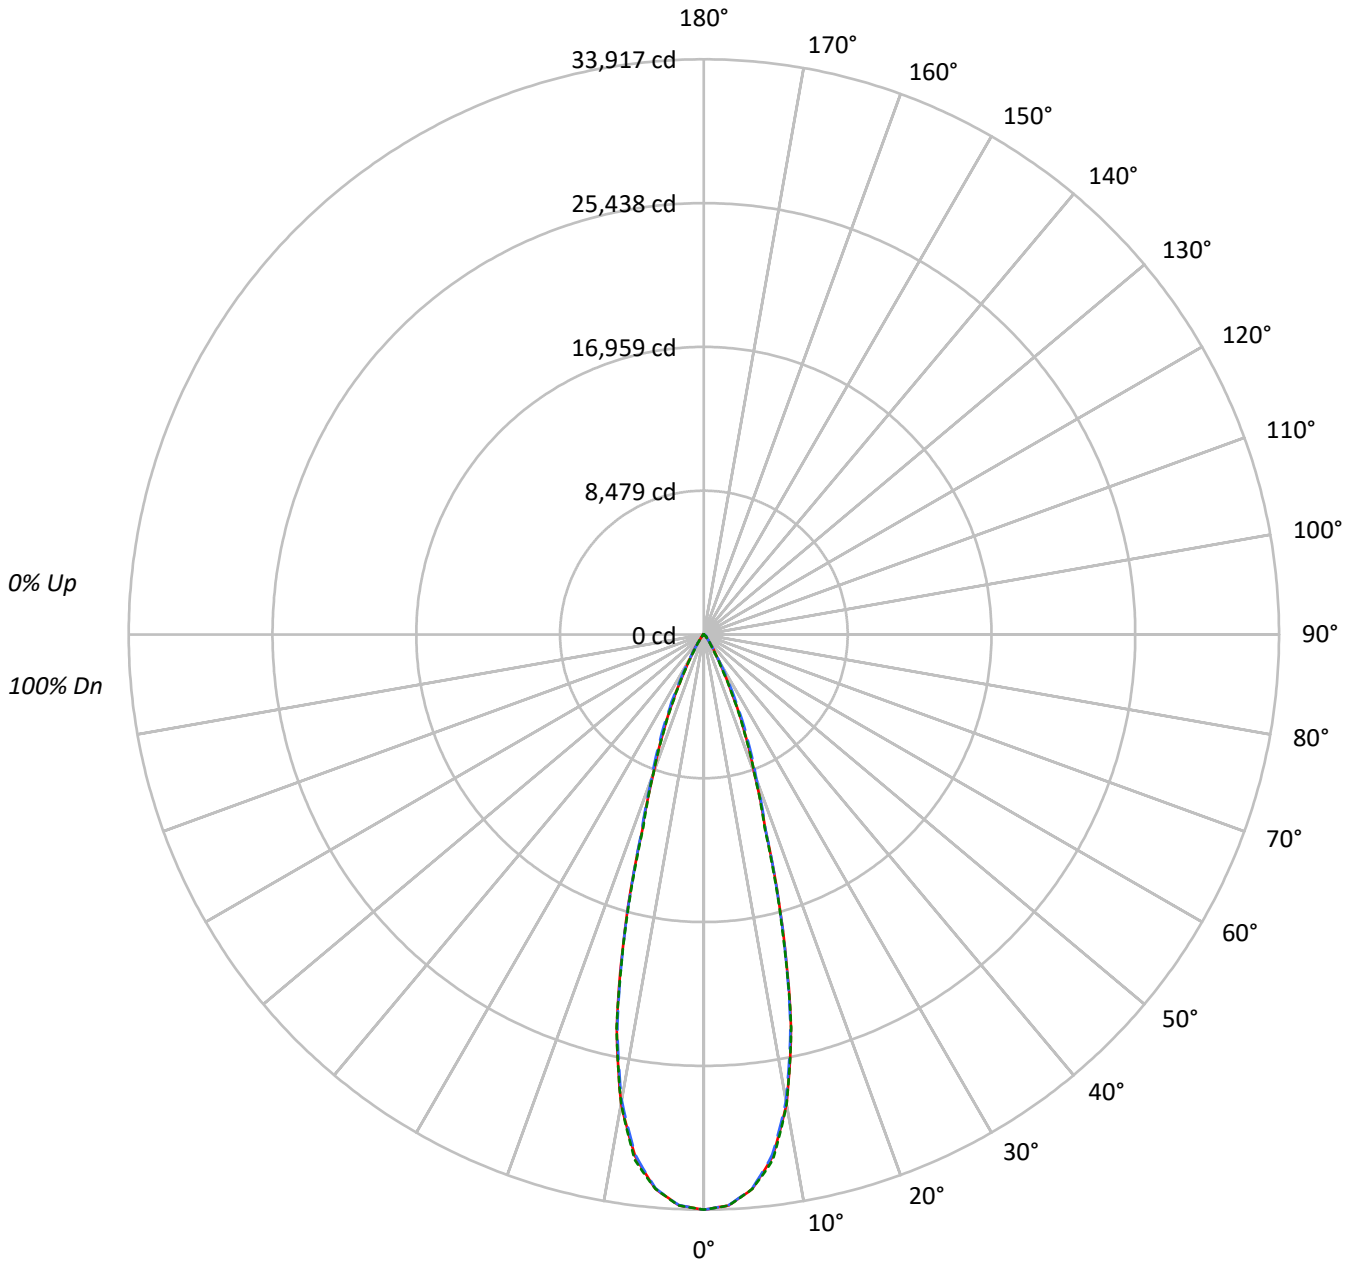



TEST NUMBER: P774223

CATALOG NUMBER: LD6D95BD010-EU6DR3070959040-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2596107	2596107	2596107
5°	2521581	2518638	2521712
10°	2184073	2168668	2183553
15°	1424997	1417342	1410218
20°	708584	735171	707639
25°	356938	402502	349624
30°	142909	155716	124516
35°	66288	63485	53215
40°	28617	31785	26958
45°	20188	25060	20372
50°	6942	18243	7335
55°	4003	7553	4217
60°	2801	3307	2801
65°	1811	1811	1811
70°	1119	739	1119
75°	0	503	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 25060 cd/sqm



TEST NUMBER: P774223

CATALOG NUMBER: LD6D95BD010-EU6DR3070959040-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2982.5	28.3
10°-20°	4803.3	45.5
20°-30°	2075.6	19.7
30°-40°	473.1	4.5
40°-50°	162.4	1.5
50°-60°	39.7	0.4
60°-70°	10.3	0.1
70°-80°	1.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9861.4	93.5
0°-40°	10334.5	98.0
0°-60°	10536.6	99.9
0°-90°	10548.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10548.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	33917	33917	33917	33917	33917	
5°	32818	32786	32780	32848	32820	2985
15°	17982	17766	17886	17828	17796	4815
25°	4226	4386	4766	4275	4140	2023
35°	709	724	679	674	570	481
45°	186	232	232	232	188	132
55°	30	32	57	33	32	29
65°	10	10	10	10	10	10
75°	0	0	2	0	0	2
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P774223

CATALOG NUMBER: LD6D95BD010-EU6DR3070959040-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	33916.8	33916.8	33916.8	33916.8	33916.8
2.5°	33692.0	33668.7	33682.0	33698.7	33705.4
5°	32817.8	32786.2	32779.5	32847.8	32819.5
7.5°	31054.4	31009.4	30941.1	31096.0	31240.9
10°	28100.3	28050.3	27902.1	27975.4	28093.6
12.5°	23739.1	23577.6	23574.3	23807.4	23775.8
15°	17982.5	17766.0	17885.9	17827.7	17796.0
17.5°	12092.7	12009.4	12169.3	12121.0	11912.9
20°	8699.0	8720.7	9025.4	8872.2	8687.4
22.5°	6347.8	6426.0	6787.4	6392.7	6247.8
25°	4226.3	4386.1	4765.8	4274.6	4139.7
27.5°	2599.4	2672.6	3057.3	2566.1	2492.8
30°	1616.9	1580.3	1761.8	1512.0	1408.8
32.5°	1060.7	1014.1	1072.4	962.5	879.2
35°	709.4	724.4	679.4	674.4	569.5
37.5°	442.9	509.6	449.6	479.6	366.3
40°	286.4	369.7	318.1	351.4	269.8
42.5°	234.8	284.7	261.4	278.1	239.8
45°	186.5	231.5	231.5	231.5	188.2
47.5°	103.2	154.9	198.2	158.2	109.9
50°	58.3	78.3	153.2	81.6	61.6
52.5°	40.0	45.0	104.9	46.6	41.6
55°	30.0	31.6	56.6	33.3	31.6
57.5°	23.3	25.0	30.0	25.0	23.3
60°	18.3	18.3	21.6	20.0	18.3
62.5°	13.3	13.3	15.0	13.3	13.3
65°	10.0	10.0	10.0	10.0	10.0
67.5°	5.0	6.7	6.7	6.7	6.7
70°	5.0	3.3	3.3	3.3	5.0
72.5°	3.3	1.7	1.7	1.7	1.7
75°	0.0	0.0	1.7	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)