

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774311

Luminaire Tested: LD6D95BD010-EU6DR3570959040-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774311
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR3570959040-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10337.2 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774311
CATALOG NUMBER: LD6D95BD010-EU6DR3570959040-6LBSQW1MW

Luminous Intensity Polar Plot

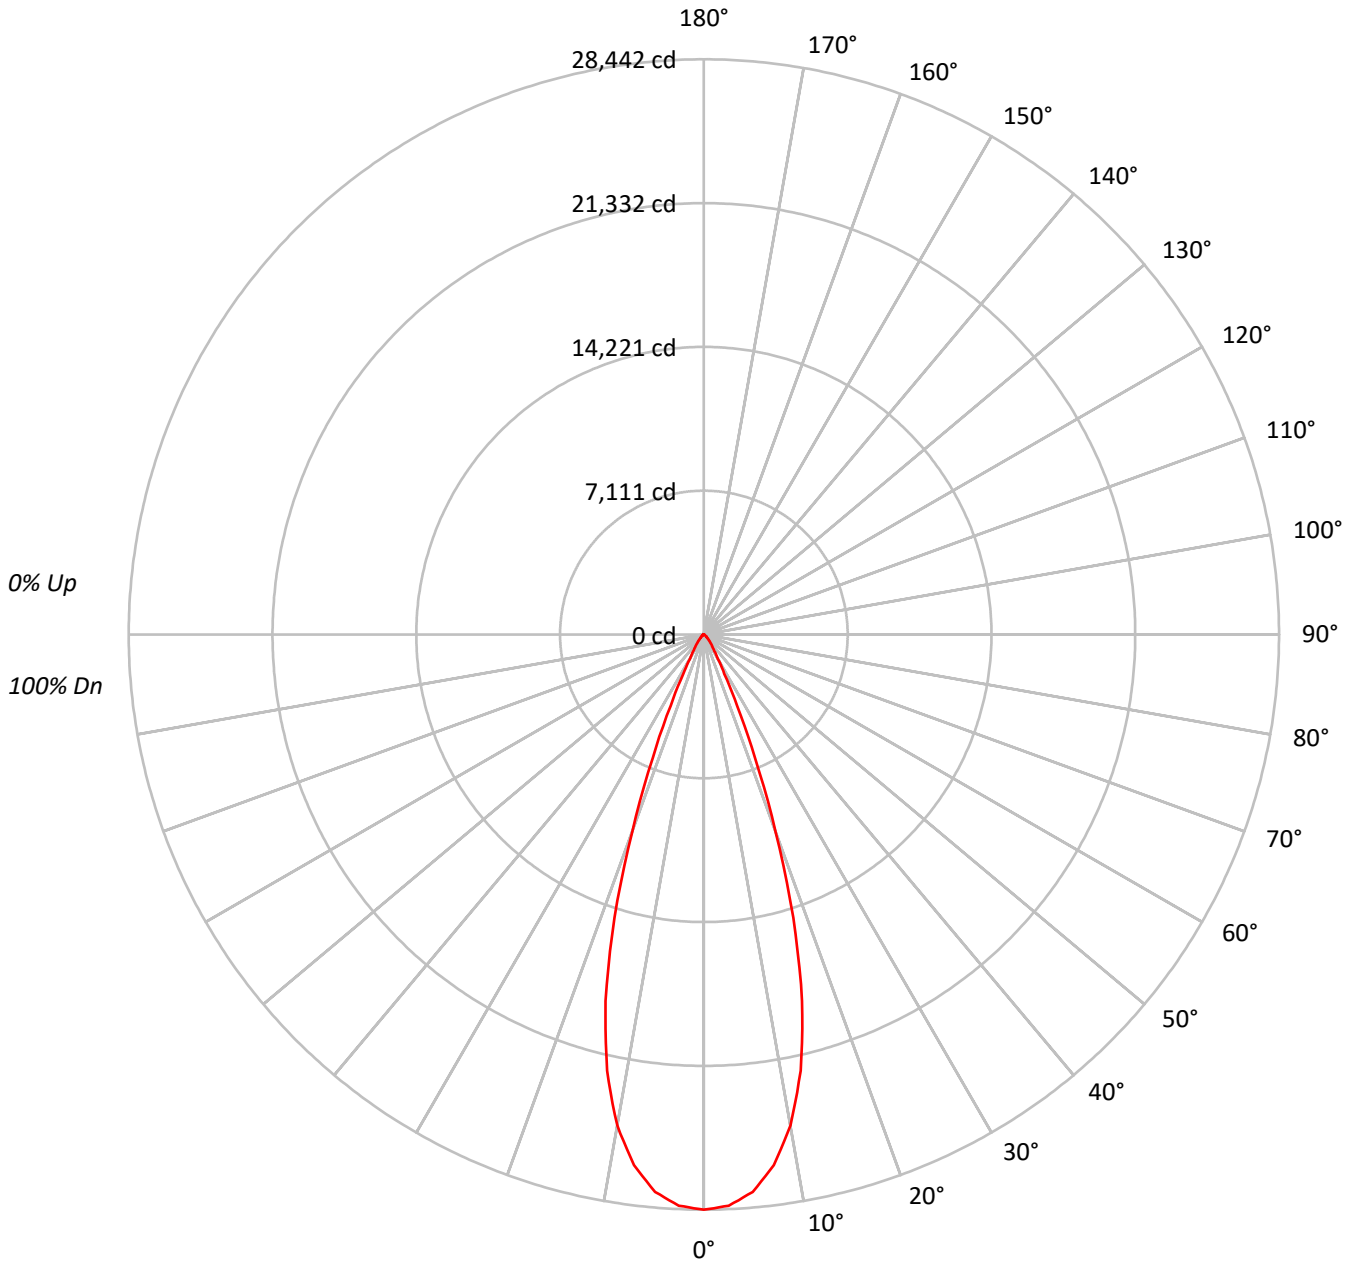



TEST NUMBER: P774311

CATALOG NUMBER: LD6D95BD010-EU6DR3570959040-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96																
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88																
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84																
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81																
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78																
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75																
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72																
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70																
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3107649
5°	3034629
10°	2735014
15°	2122808
20°	1204029
25°	468420
30°	174749
35°	95795
40°	62614
45°	38104
50°	24256
55°	17144
60°	12543
65°	6825
70°	511
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 38104 cd/sqm



TEST NUMBER: P774311

CATALOG NUMBER: LD6D95BD010-EU6DR3570959040-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2544.7	24.6
10°-20°	4968.3	48.1
20°-30°	2026.3	19.6
30°-40°	484.9	4.7
40°-50°	202.1	2.0
50°-60°	83.6	0.8
60°-70°	26.2	0.3
70°-80°	0.6	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9539.3	92.3
0°-40°	10024.2	97.0
0°-60°	10309.9	99.7
0°-90°	10337.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10337.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	28442	
5°	27668	###
15°	18767	4968
25°	3886	2026
35°	718	485
45°	247	202
55°	90	84
65°	26	26
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P774311

CATALOG NUMBER: LD6D95BD010-EU6DR3570959040-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	28442.5
2.5°	28271.9
5°	27668.5
7.5°	26464.9
10°	24651.7
12.5°	22098.5
15°	18766.8
17.5°	14692.0
20°	10355.2
22.5°	6603.0
25°	3885.5
27.5°	2196.4
30°	1385.1
32.5°	972.5
35°	718.2
37.5°	555.3
40°	439.0
42.5°	338.1
45°	246.6
47.5°	184.6
50°	142.7
52.5°	113.2
55°	90.0
57.5°	72.9
60°	57.4
62.5°	41.9
65°	26.4
67.5°	9.3
70°	1.6
72.5°	1.6
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.6
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)