

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774534

Luminaire Tested: LD6D95BD010-EU6DR5070959040-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774534
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR5070959040-6LBCSSQMMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11846.1 lumens
Efficiency: N/A
Efficacy: 119.4 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P774534

CATALOG NUMBER: LD6D95BD010-EU6DR5070959040-6LBCSSQMMS

Luminous Intensity Polar Plot

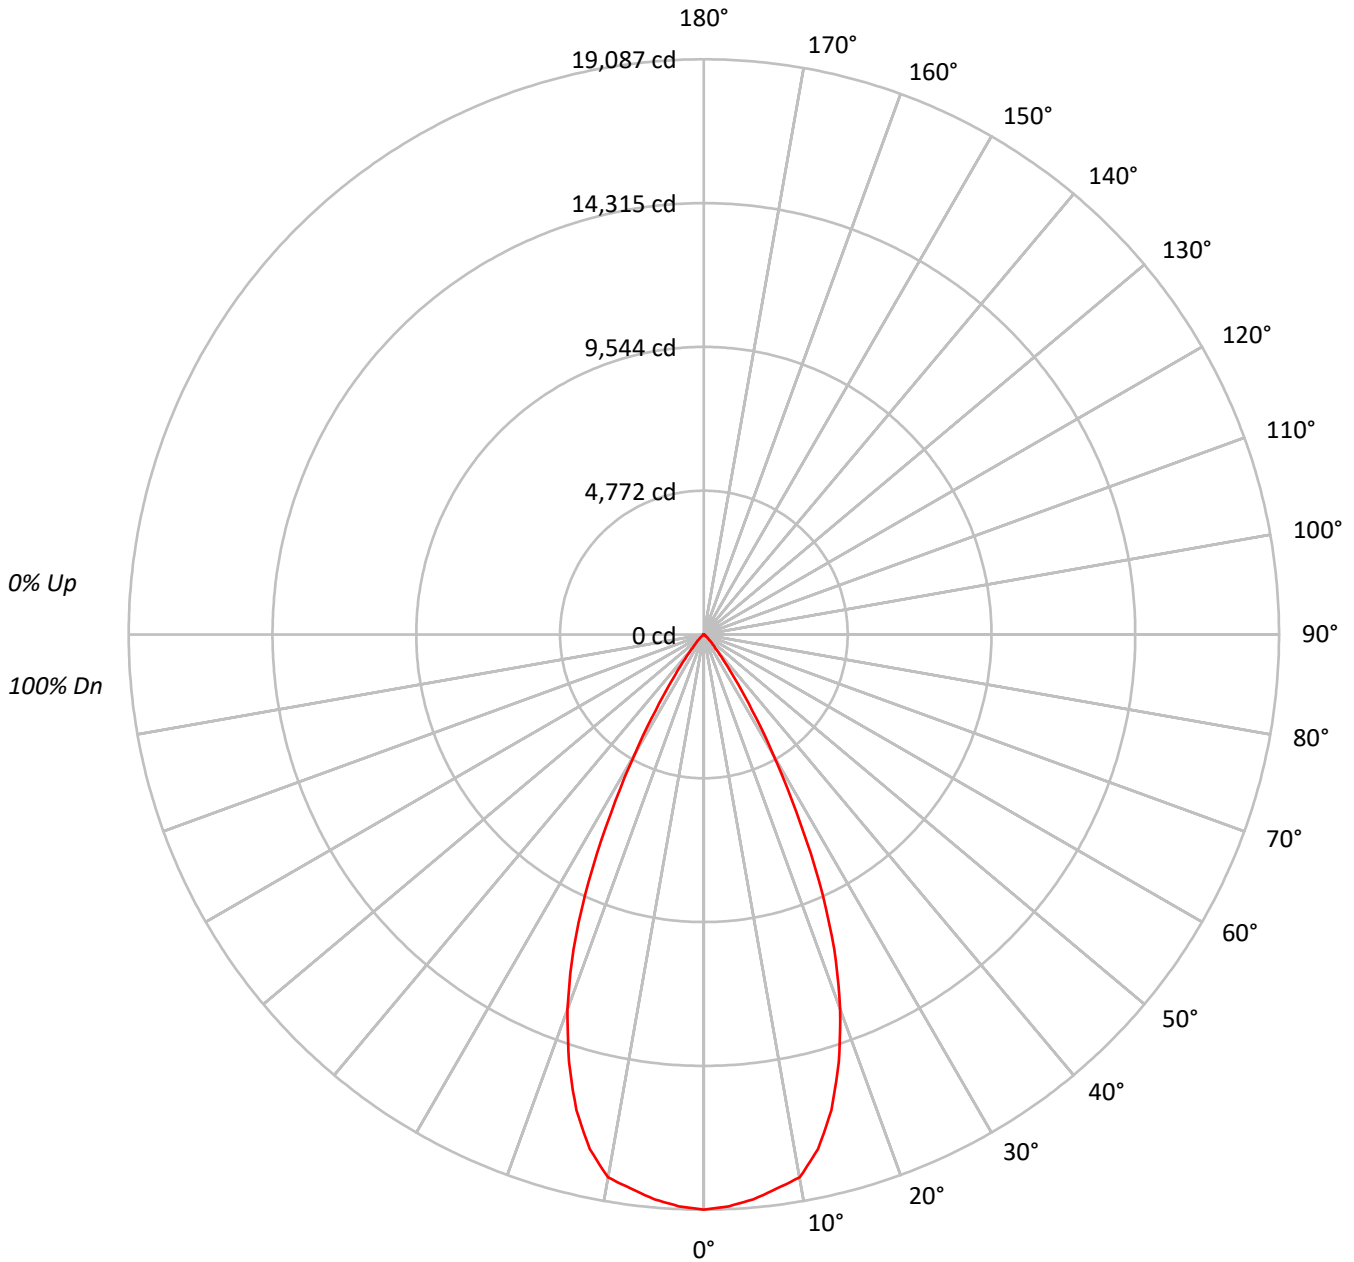



TEST NUMBER: P774534

CATALOG NUMBER: LD6D95BD010-EU6DR5070959040-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95																			
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90																			
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85																			
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80																			
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76																			
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72																			
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69																			
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65																			
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62																			
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2085471
5°	2063605
10°	2029618
15°	1848130
20°	1537860
25°	1091646
30°	577816
35°	235461
40°	87446
45°	40036
50°	16420
55°	8591
60°	4217
65°	1241
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 40036 cd/sqm



TEST NUMBER: P774534

CATALOG NUMBER: LD6D95BD010-EU6DR5070959040-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1778.4	15.0
10°-20°	4494.4	37.9
20°-30°	4037.2	34.1
30°-40°	1264.0	10.7
40°-50°	221.3	1.9
50°-60°	44.1	0.4
60°-70°	6.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10310.0	87.0
0°-40°	11574.0	97.7
0°-60°	11839.5	99.9
0°-90°	11846.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11846.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19087	
5°	18815	###
15°	16338	4494
25°	9055	4037
35°	1765	1264
45°	259	221
55°	45	44
65°	5	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774534

CATALOG NUMBER: LD6D95BD010-EU6DR5070959040-6LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	19087.1
2.5°	18992.2
5°	18815.1
7.5°	18544.8
10°	18293.7
12.5°	17489.1
15°	16338.5
17.5°	14877.3
20°	13226.3
22.5°	11316.1
25°	9055.1
27.5°	6657.4
30°	4579.9
32.5°	2981.9
35°	1765.3
37.5°	1013.8
40°	613.1
42.5°	399.1
45°	259.1
47.5°	157.7
50°	96.6
52.5°	66.0
55°	45.1
57.5°	30.6
60°	19.3
62.5°	11.3
65°	4.8
67.5°	1.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)