

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P205173

Luminaire Tested: **LD6B10D010 EU6B10209035 6LBWLI1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P205173  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD6B10D010 EU6B10209035 6LBWLI1  
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT  
WIDE DISTRIBUTION WITH SPECULAR CLEAR TRIM  
WATTAGE D010TR-10.05 W DE010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W  
DL3-11.1 W DLE-11.39 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 931.1 lumens  
Efficiency: N/A  
Efficacy: 94.0 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 9.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P205173

CATALOG NUMBER: LD6B10D010 EU6B10209035 6LBWLI1

### Luminous Intensity Polar Plot

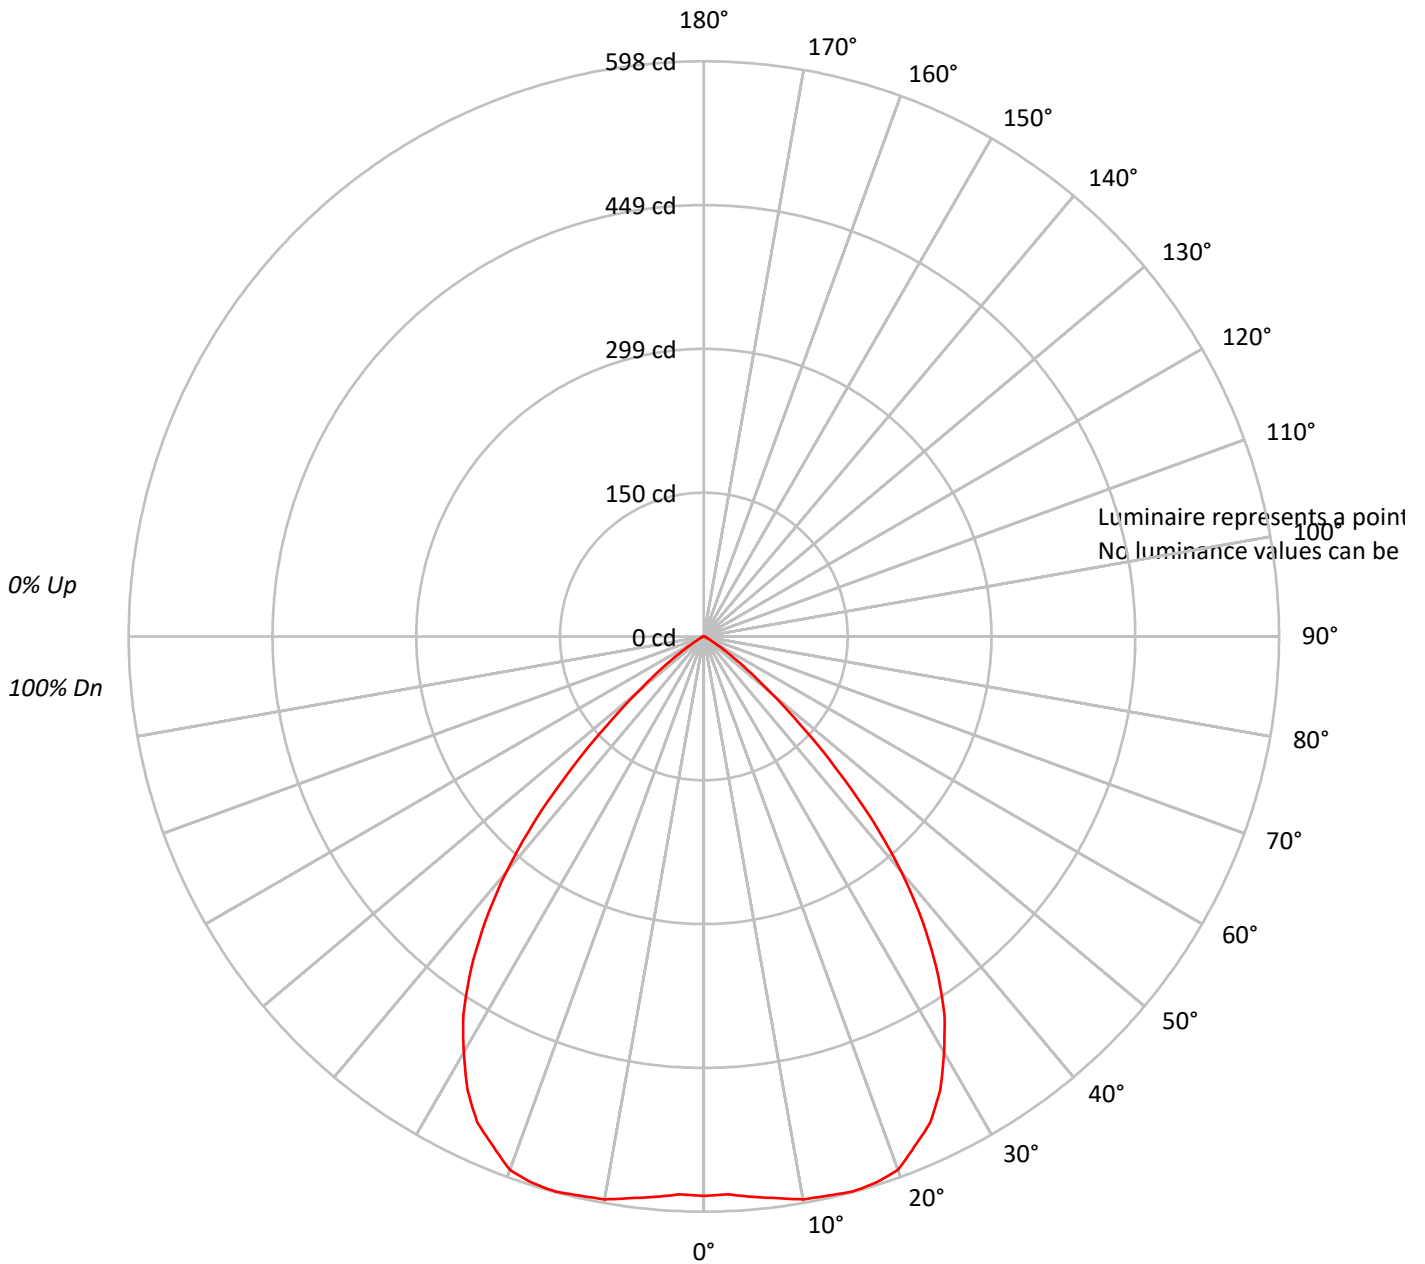



TEST NUMBER: P205173

CATALOG NUMBER: LD6B10D010 EU6B10209035 6LBWLI1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92			92																
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83			83																
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76			76																
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69			69																
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63			63																
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57			57																
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52			52																
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48			48																
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44			44																
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41			41																

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P205173

CATALOG NUMBER: LD6B10D010 EU6B10209035 6LBWLI1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	56.1	6.0
10°-20°	168.7	18.1
20°-30°	254.2	27.3
30°-40°	260.2	27.9
40°-50°	151.6	16.3
50°-60°	34.8	3.7
60°-70°	4.3	0.5
70°-80°	1.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	479.0	51.4
0°-40°	739.2	79.4
0°-60°	925.6	99.4
0°-90°	931.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	931.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	582	
5°	585	56
15°	598	169
25°	557	254
35°	422	260
45°	195	152
55°	34	35
65°	3	4
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P205173

CATALOG NUMBER: LD6B10D010 EU6B10209035 6LBWLI1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	581.6
2.5°	580.6
5°	584.8
7.5°	589.0
10°	594.3
12.5°	595.4
15°	597.5
17.5°	595.4
20°	590.1
22.5°	573.2
25°	557.4
27.5°	532.0
30°	499.3
32.5°	465.5
35°	422.2
37.5°	373.7
40°	319.8
42.5°	259.7
45°	195.3
47.5°	136.2
50°	89.7
52.5°	57.0
55°	33.8
57.5°	17.9
60°	9.5
62.5°	5.3
65°	3.2
67.5°	3.2
70°	2.1
72.5°	1.1
75°	1.1
77.5°	1.1
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)