

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P202605

Luminaire Tested: **LD6B15D010 EU6B10208027 6LBMWMH1**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P202605  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD6B15D010 EU6B10208027 6LBMWMH1  
Description: PORTFOLIO 6 INCH 50 DEGREE CUTOFF RECESSED DOWNLIGHT  
MEDIUM DISTRIBUTION WITH WARM HAZE TRIM  
WATTAGE D010TR-14.39 W DE010-14.29 W D5LT-14.34 W DMX-14.46 W DL2-15.8 W  
DL3-15.28 W DLE-15.432 W  
Light Source: HIGH LUMEN LED  
Ballast/Driver: ELECTRONIC DRIVER

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1100.5 lumens  
Efficiency: N/A  
Efficacy: 77.0 lumens/watt  
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.89  
Luminous Opening: Point Source (0' x 0' x 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P202605

CATALOG NUMBER: LD6B15D010 EU6B10208027 6LBMWMH1

### Luminous Intensity Polar Plot

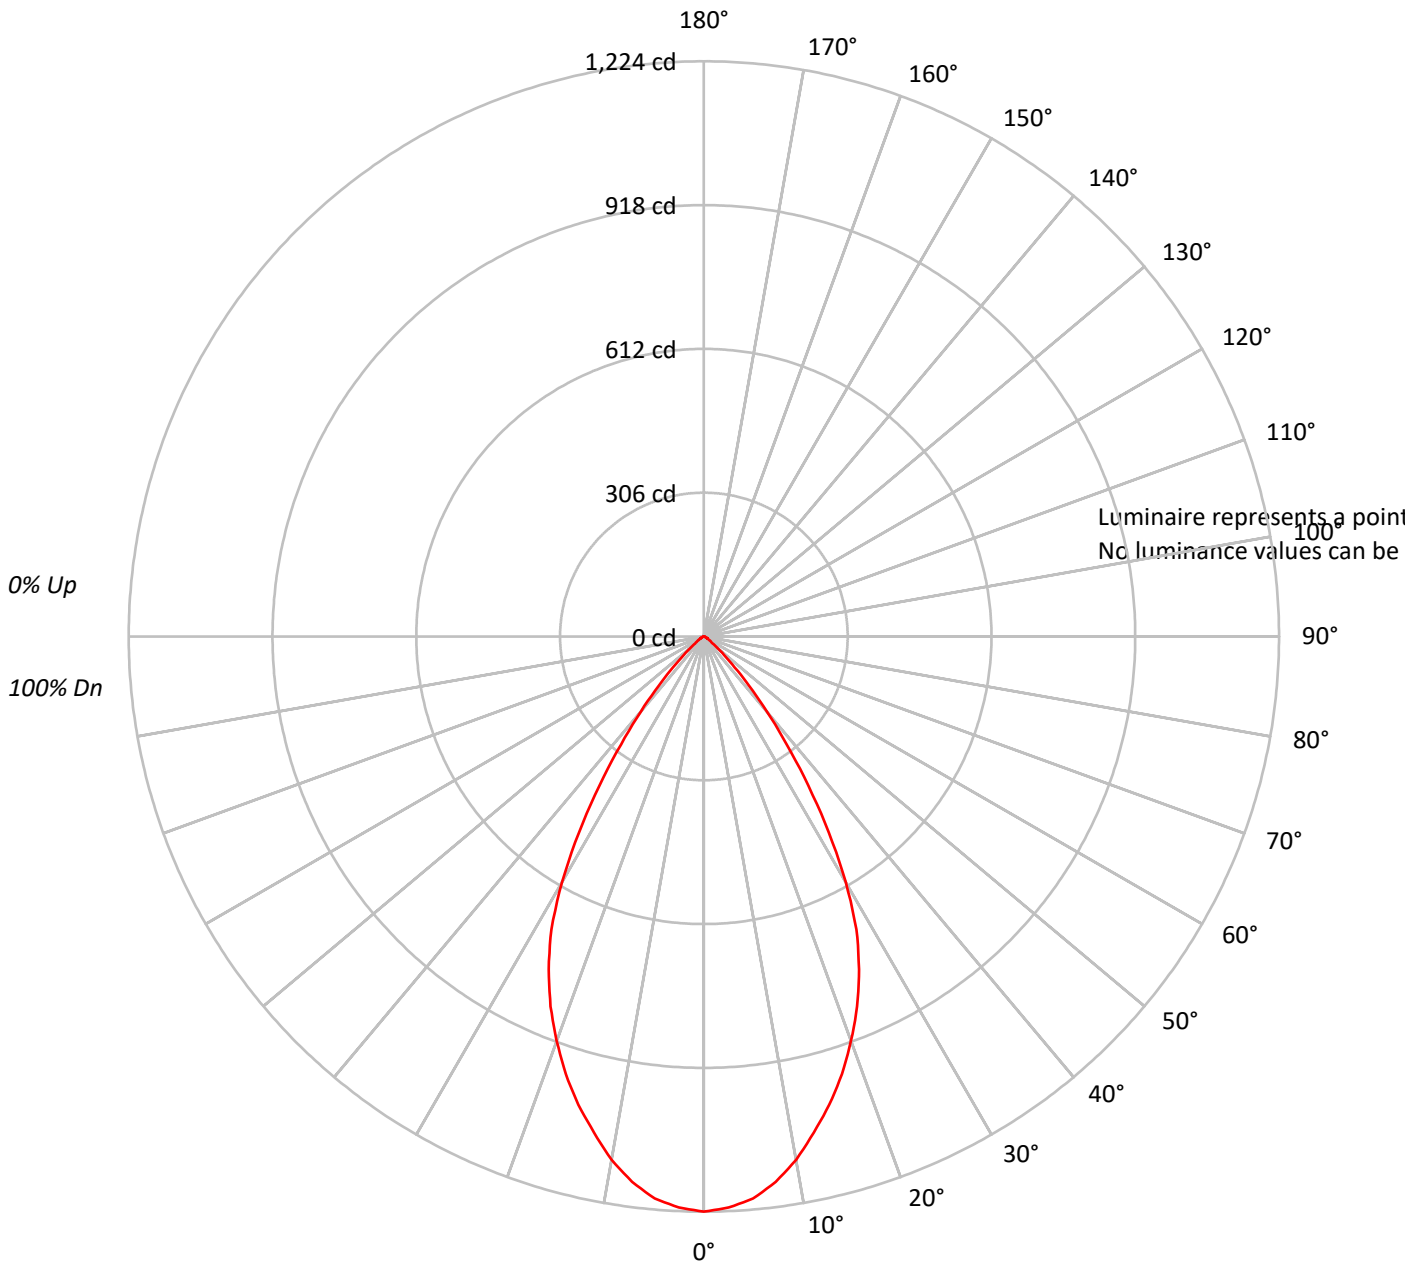



TEST NUMBER: P202605

CATALOG NUMBER: LD6B15D010 EU6B10208027 6LBMWMH1

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									20
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0										
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	86																			
3	102	95	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80																			
4	97	89	83	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74																			
5	92	83	77	73	90	82	77	73	80	76	72	79	75	71	77	74	71	69																			
6	87	78	72	67	85	77	71	67	76	71	67	74	70	66	73	69	66	64																			
7	83	73	67	63	81	72	67	63	71	66	62	70	65	62	69	65	62	60																			
8	78	69	63	58	77	68	62	58	67	62	58	66	61	58	65	61	58	56																			
9	75	65	59	55	73	64	59	55	63	58	54	62	58	54	62	57	54	53																			
10	71	61	55	51	70	61	55	51	60	55	51	59	54	51	58	54	51	50																			

**AVERAGE LUMINANCE (cd/sqm):**





TEST NUMBER: P202605

CATALOG NUMBER: LD6B15D010 EU6B10208027 6LBMWMH1

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	112.3	10.2
10°-20°	288.4	26.2
20°-30°	354.2	32.2
30°-40°	242.9	22.1
40°-50°	78.0	7.1
50°-60°	15.8	1.4
60°-70°	6.2	0.6
70°-80°	2.3	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	754.9	68.6
0°-40°	997.7	90.7
0°-60°	1091.6	99.2
0°-90°	1100.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1100.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1224	
5°	1201	112
15°	1032	288
25°	781	354
35°	387	243
45°	92	78
55°	16	16
65°	6	6
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P202605

CATALOG NUMBER: LD6B15D010 EU6B10208027 6LBMWMH1

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1223.9
2.5°	1216.4
5°	1200.6
7.5°	1170.7
10°	1130.6
12.5°	1081.1
15°	1031.6
17.5°	976.5
20°	915.8
22.5°	852.3
25°	781.4
27.5°	703.0
30°	604.0
32.5°	494.8
35°	387.4
37.5°	289.4
40°	208.2
42.5°	141.9
45°	92.4
47.5°	56.9
50°	34.5
52.5°	21.5
55°	15.9
57.5°	12.1
60°	9.3
62.5°	7.5
65°	6.5
67.5°	4.7
70°	3.7
72.5°	2.8
75°	1.9
77.5°	1.9
80°	0.9
82.5°	0.9
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)