

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P202859

Luminaire Tested: **LD6B40D010 EU6B30509050 6LBWWH1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P202859
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD6B40D010 EU6B30509050 6LBWWH1
Description: PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT
WIDE DISTRIBUTION WITH WHEAT TRIM
WATTAGE D010TR-43.02 W DE010-42.54 W D5LT-42.539 W DMX-41.87 W DL2-41.57
W DL3-44.71 W DLE-39.33 W
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3328.7 lumens
Efficiency: N/A
Efficacy: 79.6 lumens/watt
Spacing Criteria (0/90/45): 1.23 / 1.23 / 1.18
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 41.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P202859

CATALOG NUMBER: LD6B40D010 EU6B30509050 6LBWWH1

Luminous Intensity Polar Plot

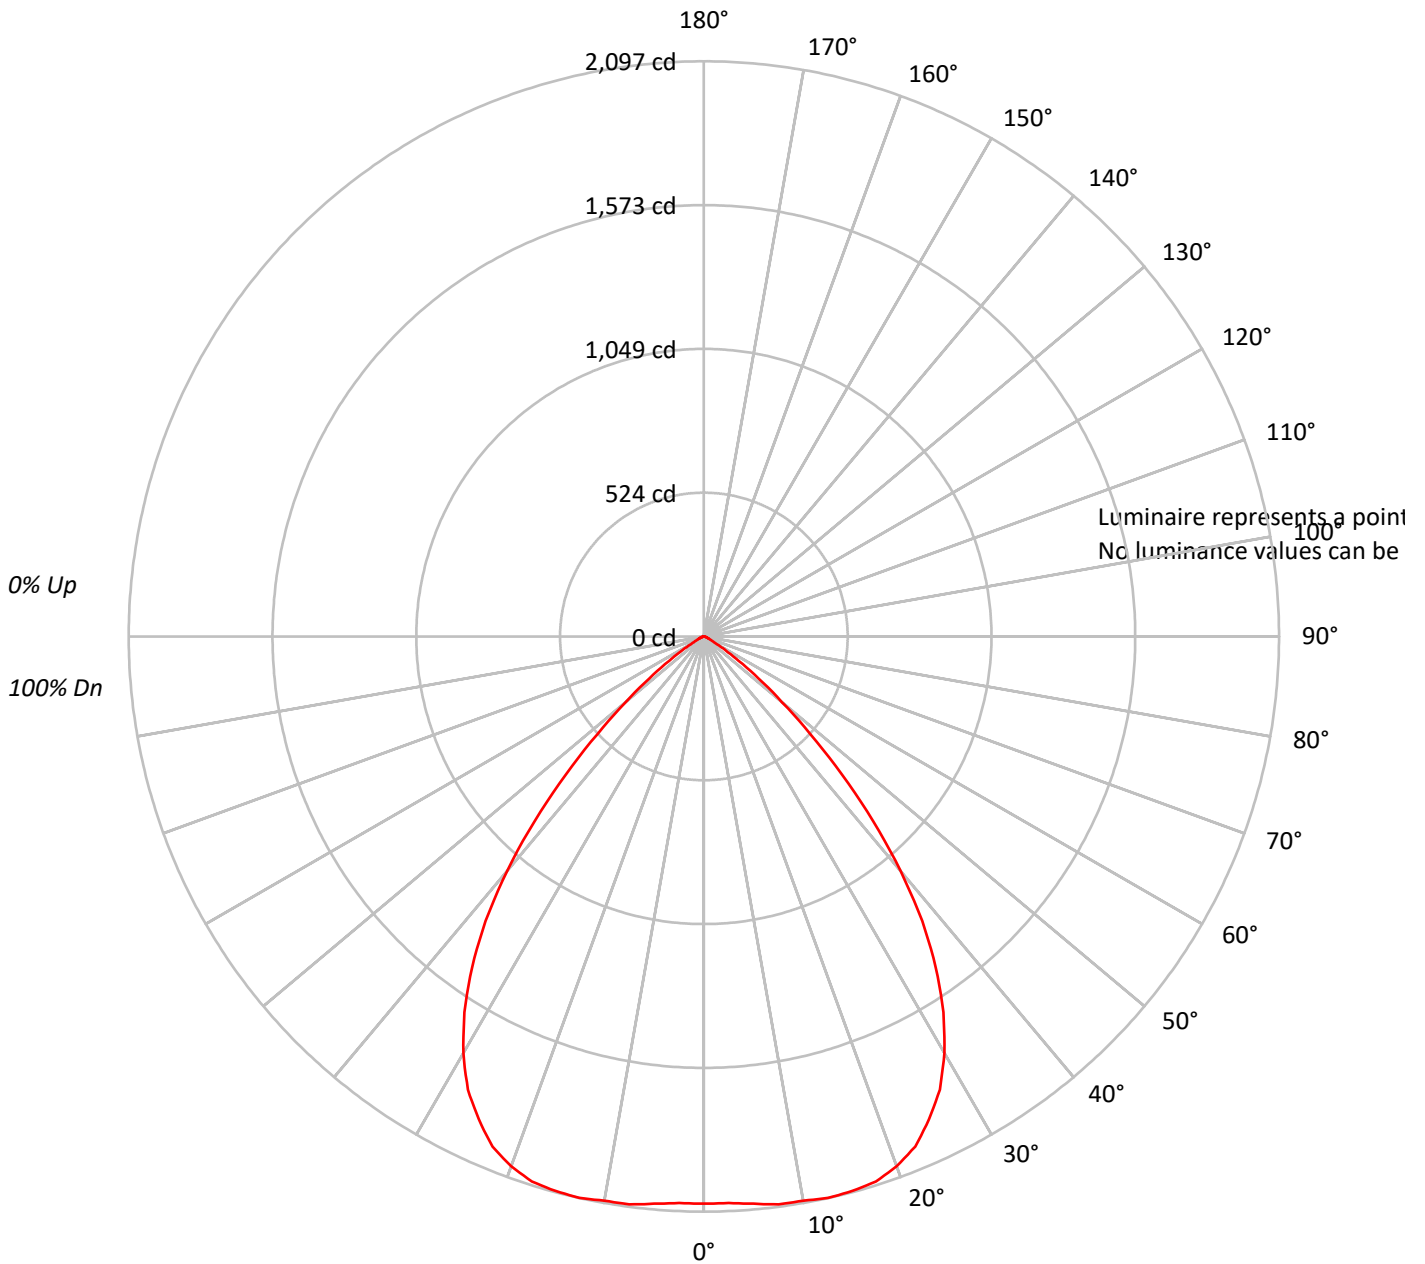



TEST NUMBER: P202859

CATALOG NUMBER: LD6B40D010 EU6B30509050 6LBWWH1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 113 | 109 | 107 | 104 | 110 | 107 | 105 | 102 | 103 | 101 | 99 | 99 | 98 | 96 | 96 | 95 | 93 | 92 | | | |
| 2 | 106 | 100 | 96 | 92 | 104 | 98 | 94 | 91 | 95 | 92 | 89 | 92 | 89 | 87 | 89 | 87 | 85 | 83 | | | |
| 3 | 99 | 92 | 86 | 81 | 97 | 90 | 85 | 81 | 88 | 83 | 79 | 85 | 81 | 78 | 83 | 80 | 77 | 75 | | | |
| 4 | 93 | 84 | 78 | 73 | 91 | 83 | 77 | 72 | 81 | 76 | 71 | 79 | 74 | 71 | 77 | 73 | 70 | 68 | | | |
| 5 | 87 | 77 | 71 | 66 | 85 | 76 | 70 | 65 | 75 | 69 | 65 | 73 | 68 | 64 | 71 | 67 | 63 | 62 | | | |
| 6 | 82 | 71 | 64 | 59 | 80 | 71 | 64 | 59 | 69 | 63 | 59 | 67 | 62 | 58 | 66 | 61 | 58 | 56 | | | |
| 7 | 77 | 66 | 59 | 54 | 75 | 65 | 59 | 54 | 64 | 58 | 54 | 63 | 57 | 53 | 61 | 57 | 53 | 51 | | | |
| 8 | 72 | 61 | 54 | 49 | 71 | 61 | 54 | 49 | 59 | 53 | 49 | 58 | 53 | 49 | 57 | 52 | 49 | 47 | | | |
| 9 | 68 | 57 | 50 | 45 | 67 | 56 | 50 | 45 | 55 | 49 | 45 | 54 | 49 | 45 | 53 | 48 | 45 | 43 | | | |
| 10 | 64 | 53 | 46 | 42 | 63 | 53 | 46 | 42 | 52 | 46 | 42 | 51 | 45 | 42 | 50 | 45 | 41 | 40 | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P202859

CATALOG NUMBER: LD6B40D010 EU6B30509050 6LBWWH1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 198.7 | 6.0 |
| 10°-20° | 591.0 | 17.8 |
| 20°-30° | 889.6 | 26.7 |
| 30°-40° | 909.6 | 27.3 |
| 40°-50° | 552.4 | 16.6 |
| 50°-60° | 155.5 | 4.7 |
| 60°-70° | 23.6 | 0.7 |
| 70°-80° | 7.7 | 0.2 |
| 80°-90° | 0.6 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1679.3 | 50.4 |
| 0°-40° | 2588.8 | 77.8 |
| 0°-60° | 3296.8 | 99.0 |
| 0°-90° | 3328.7 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 3328.7 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2068 | |
| 5° | 2076 | 199 |
| 15° | 2093 | 591 |
| 25° | 1942 | 890 |
| 35° | 1474 | 910 |
| 45° | 710 | 552 |
| 55° | 154 | 156 |
| 65° | 21 | 24 |
| 75° | 8 | 8 |
| 85° | 0 | 1 |
| 90° | 0 | |



TEST NUMBER: P202859

CATALOG NUMBER: LD6B40D010 EU6B30509050 6LBWWH1

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2067.5 |
| 2.5° | 2067.5 |
| 5° | 2075.8 |
| 7.5° | 2088.4 |
| 10° | 2088.4 |
| 12.5° | 2096.7 |
| 15° | 2092.6 |
| 17.5° | 2084.2 |
| 20° | 2055.0 |
| 22.5° | 2013.2 |
| 25° | 1942.2 |
| 27.5° | 1862.8 |
| 30° | 1754.2 |
| 32.5° | 1624.8 |
| 35° | 1474.4 |
| 37.5° | 1307.3 |
| 40° | 1115.2 |
| 42.5° | 914.7 |
| 45° | 710.0 |
| 47.5° | 526.3 |
| 50° | 371.7 |
| 52.5° | 250.6 |
| 55° | 154.5 |
| 57.5° | 91.9 |
| 60° | 45.9 |
| 62.5° | 29.2 |
| 65° | 20.9 |
| 67.5° | 16.7 |
| 70° | 12.5 |
| 72.5° | 8.4 |
| 75° | 8.4 |
| 77.5° | 4.2 |
| 80° | 4.2 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)