

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P205433

Luminaire Tested: **LD6B50D010TE EU6B30508030 6LBSLI1**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P205433
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P35319)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD6B50D010TE EU6B30508030 6LBSLI1
Description: PORTFOLIO 6 INCH SHALLOW RECESSED DOWNLIGHT
SHALLOW DISTRIBUTION WITH SPECULAR CLEAR TRIM
SINGLE DRIVER D010TE
Light Source: HIGH LUMEN LED
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5762.5 lumens
Efficiency: N/A
Efficacy: 98.1 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 1.04
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 58.77
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P205433

CATALOG NUMBER: LD6B50D010TE EU6B30508030 6LBSLI1

Luminous Intensity Polar Plot

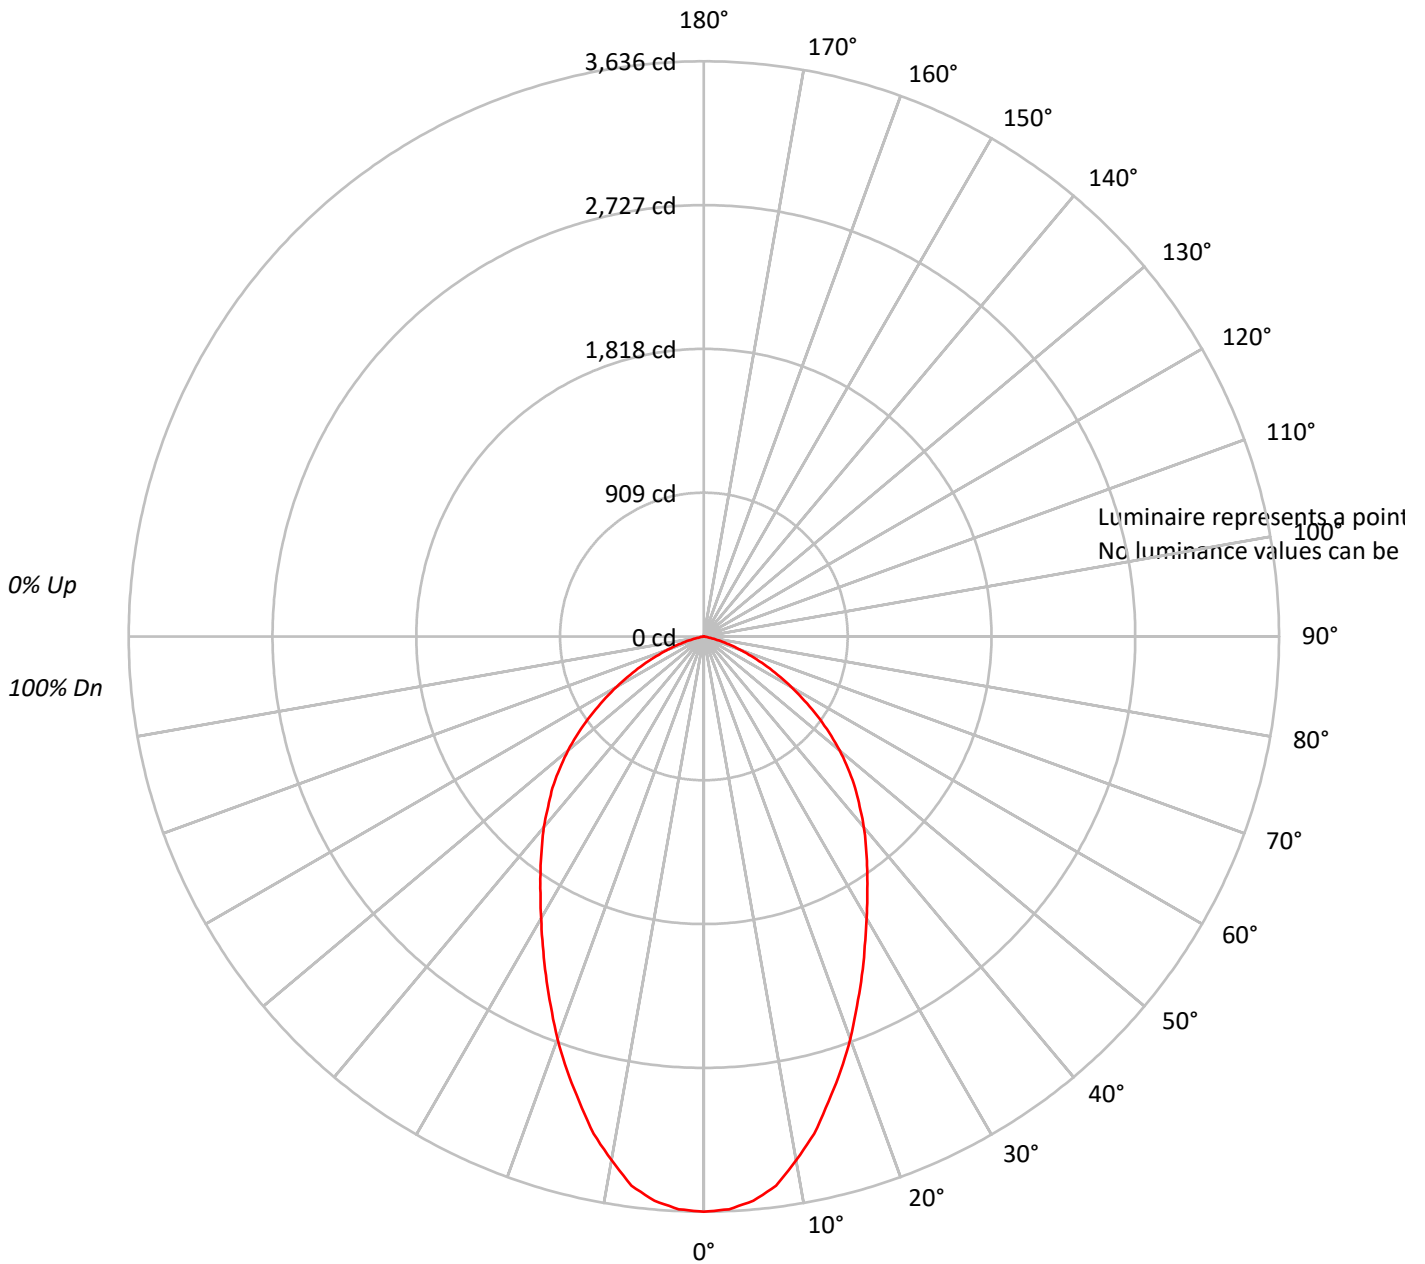



TEST NUMBER: P205433

CATALOG NUMBER: LD6B50D010TE EU6B30508030 6LBSLI1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 99 | 101 | 99 | 96 | 97 | 95 | 93 | 94 | 92 | 91 | 89 | | | | | | | | | | | | | | | | | | | |
| 2 | 103 | 96 | 91 | 86 | 100 | 94 | 89 | 85 | 91 | 87 | 83 | 88 | 84 | 81 | 85 | 82 | 79 | 77 | | | | | | | | | | | | | | | | | | | |
| 3 | 95 | 86 | 79 | 74 | 93 | 85 | 78 | 73 | 82 | 76 | 72 | 79 | 75 | 71 | 77 | 73 | 70 | 68 | | | | | | | | | | | | | | | | | | | |
| 4 | 88 | 78 | 70 | 64 | 86 | 77 | 69 | 64 | 74 | 68 | 63 | 72 | 67 | 62 | 70 | 65 | 62 | 60 | | | | | | | | | | | | | | | | | | | |
| 5 | 82 | 71 | 63 | 57 | 80 | 70 | 62 | 57 | 67 | 61 | 56 | 66 | 60 | 55 | 64 | 59 | 55 | 53 | | | | | | | | | | | | | | | | | | | |
| 6 | 76 | 64 | 56 | 51 | 74 | 63 | 56 | 51 | 62 | 55 | 50 | 60 | 54 | 50 | 59 | 53 | 49 | 47 | | | | | | | | | | | | | | | | | | | |
| 7 | 71 | 59 | 51 | 46 | 70 | 58 | 51 | 45 | 57 | 50 | 45 | 55 | 49 | 45 | 54 | 49 | 45 | 43 | | | | | | | | | | | | | | | | | | | |
| 8 | 67 | 54 | 47 | 41 | 65 | 54 | 46 | 41 | 52 | 46 | 41 | 51 | 45 | 41 | 50 | 45 | 41 | 39 | | | | | | | | | | | | | | | | | | | |
| 9 | 63 | 50 | 43 | 38 | 61 | 50 | 43 | 38 | 49 | 42 | 38 | 48 | 42 | 37 | 47 | 41 | 37 | 36 | | | | | | | | | | | | | | | | | | | |
| 10 | 59 | 47 | 40 | 35 | 58 | 46 | 39 | 35 | 45 | 39 | 35 | 45 | 39 | 34 | 44 | 38 | 34 | 33 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P205433

CATALOG NUMBER: LD6B50D010TE EU6B30508030 6LBSLI1

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 335.1 | 5.8 |
| 10°-20° | 853.1 | 14.8 |
| 20°-30° | 1087.8 | 18.9 |
| 30°-40° | 1128.1 | 19.6 |
| 40°-50° | 1039.5 | 18.0 |
| 50°-60° | 781.9 | 13.6 |
| 60°-70° | 422.1 | 7.3 |
| 70°-80° | 113.3 | 2.0 |
| 80°-90° | 1.7 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2276.0 | 39.5 |
| 0°-40° | 3404.1 | 59.1 |
| 0°-60° | 5225.5 | 90.7 |
| 0°-90° | 5762.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5762.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 3636 | |
| 5° | 3581 | 335 |
| 15° | 3043 | 853 |
| 25° | 2363 | 1088 |
| 35° | 1800 | 1128 |
| 45° | 1353 | 1039 |
| 55° | 875 | 782 |
| 65° | 422 | 422 |
| 75° | 98 | 113 |
| 85° | 0 | 2 |
| 90° | 0 | |



TEST NUMBER: P205433

CATALOG NUMBER: LD6B50D010TE EU6B30508030 6LBSLI1

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 3636.4 |
| 2.5° | 3624.2 |
| 5° | 3581.3 |
| 7.5° | 3501.7 |
| 10° | 3360.9 |
| 12.5° | 3220.1 |
| 15° | 3042.6 |
| 17.5° | 2877.3 |
| 20° | 2705.9 |
| 22.5° | 2528.3 |
| 25° | 2363.1 |
| 27.5° | 2203.9 |
| 30° | 2057.0 |
| 32.5° | 1922.3 |
| 35° | 1799.8 |
| 37.5° | 1683.5 |
| 40° | 1573.3 |
| 42.5° | 1457.0 |
| 45° | 1352.9 |
| 47.5° | 1236.6 |
| 50° | 1120.3 |
| 52.5° | 997.9 |
| 55° | 875.4 |
| 57.5° | 753.0 |
| 60° | 636.7 |
| 62.5° | 526.5 |
| 65° | 422.4 |
| 67.5° | 324.5 |
| 70° | 238.8 |
| 72.5° | 165.3 |
| 75° | 98.0 |
| 77.5° | 42.9 |
| 80° | 12.2 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)